

# HCSO MENTAL HEALTH POD

520 N FALKENBURG ROAD  
TAMPA, FLORIDA 33619

24001.01

#	ISSUED FOR	DATE
	DESIGN DEVELOPMENT	06.20.24
	75% CD (OWNER APPROVAL)	07.26.24
	PERMIT/BID	08.30.24
	ADDENDUM #1	09.04.24

THE  
**LUNZ**  
GROUP

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
p 863.682.1882  
f 863.687.6346  
lic. AR94778


lunz.com




ARCHITECTURAL:  
THE LUNZ GROUP  
58 LAKE MORTON DRIVE  
LAKELAND, FLORIDA 33801

MEPFP:  
MES GROUP  
550 NORTH REO  
STREET SUITE 203  
TAMPA, FL 33609

STRUCTURAL:  
GEORGE F. YOUNG, INC.  
1408 N WESTSHORE BLVD, SUITE 205  
TAMPA, FLORIDA 33607

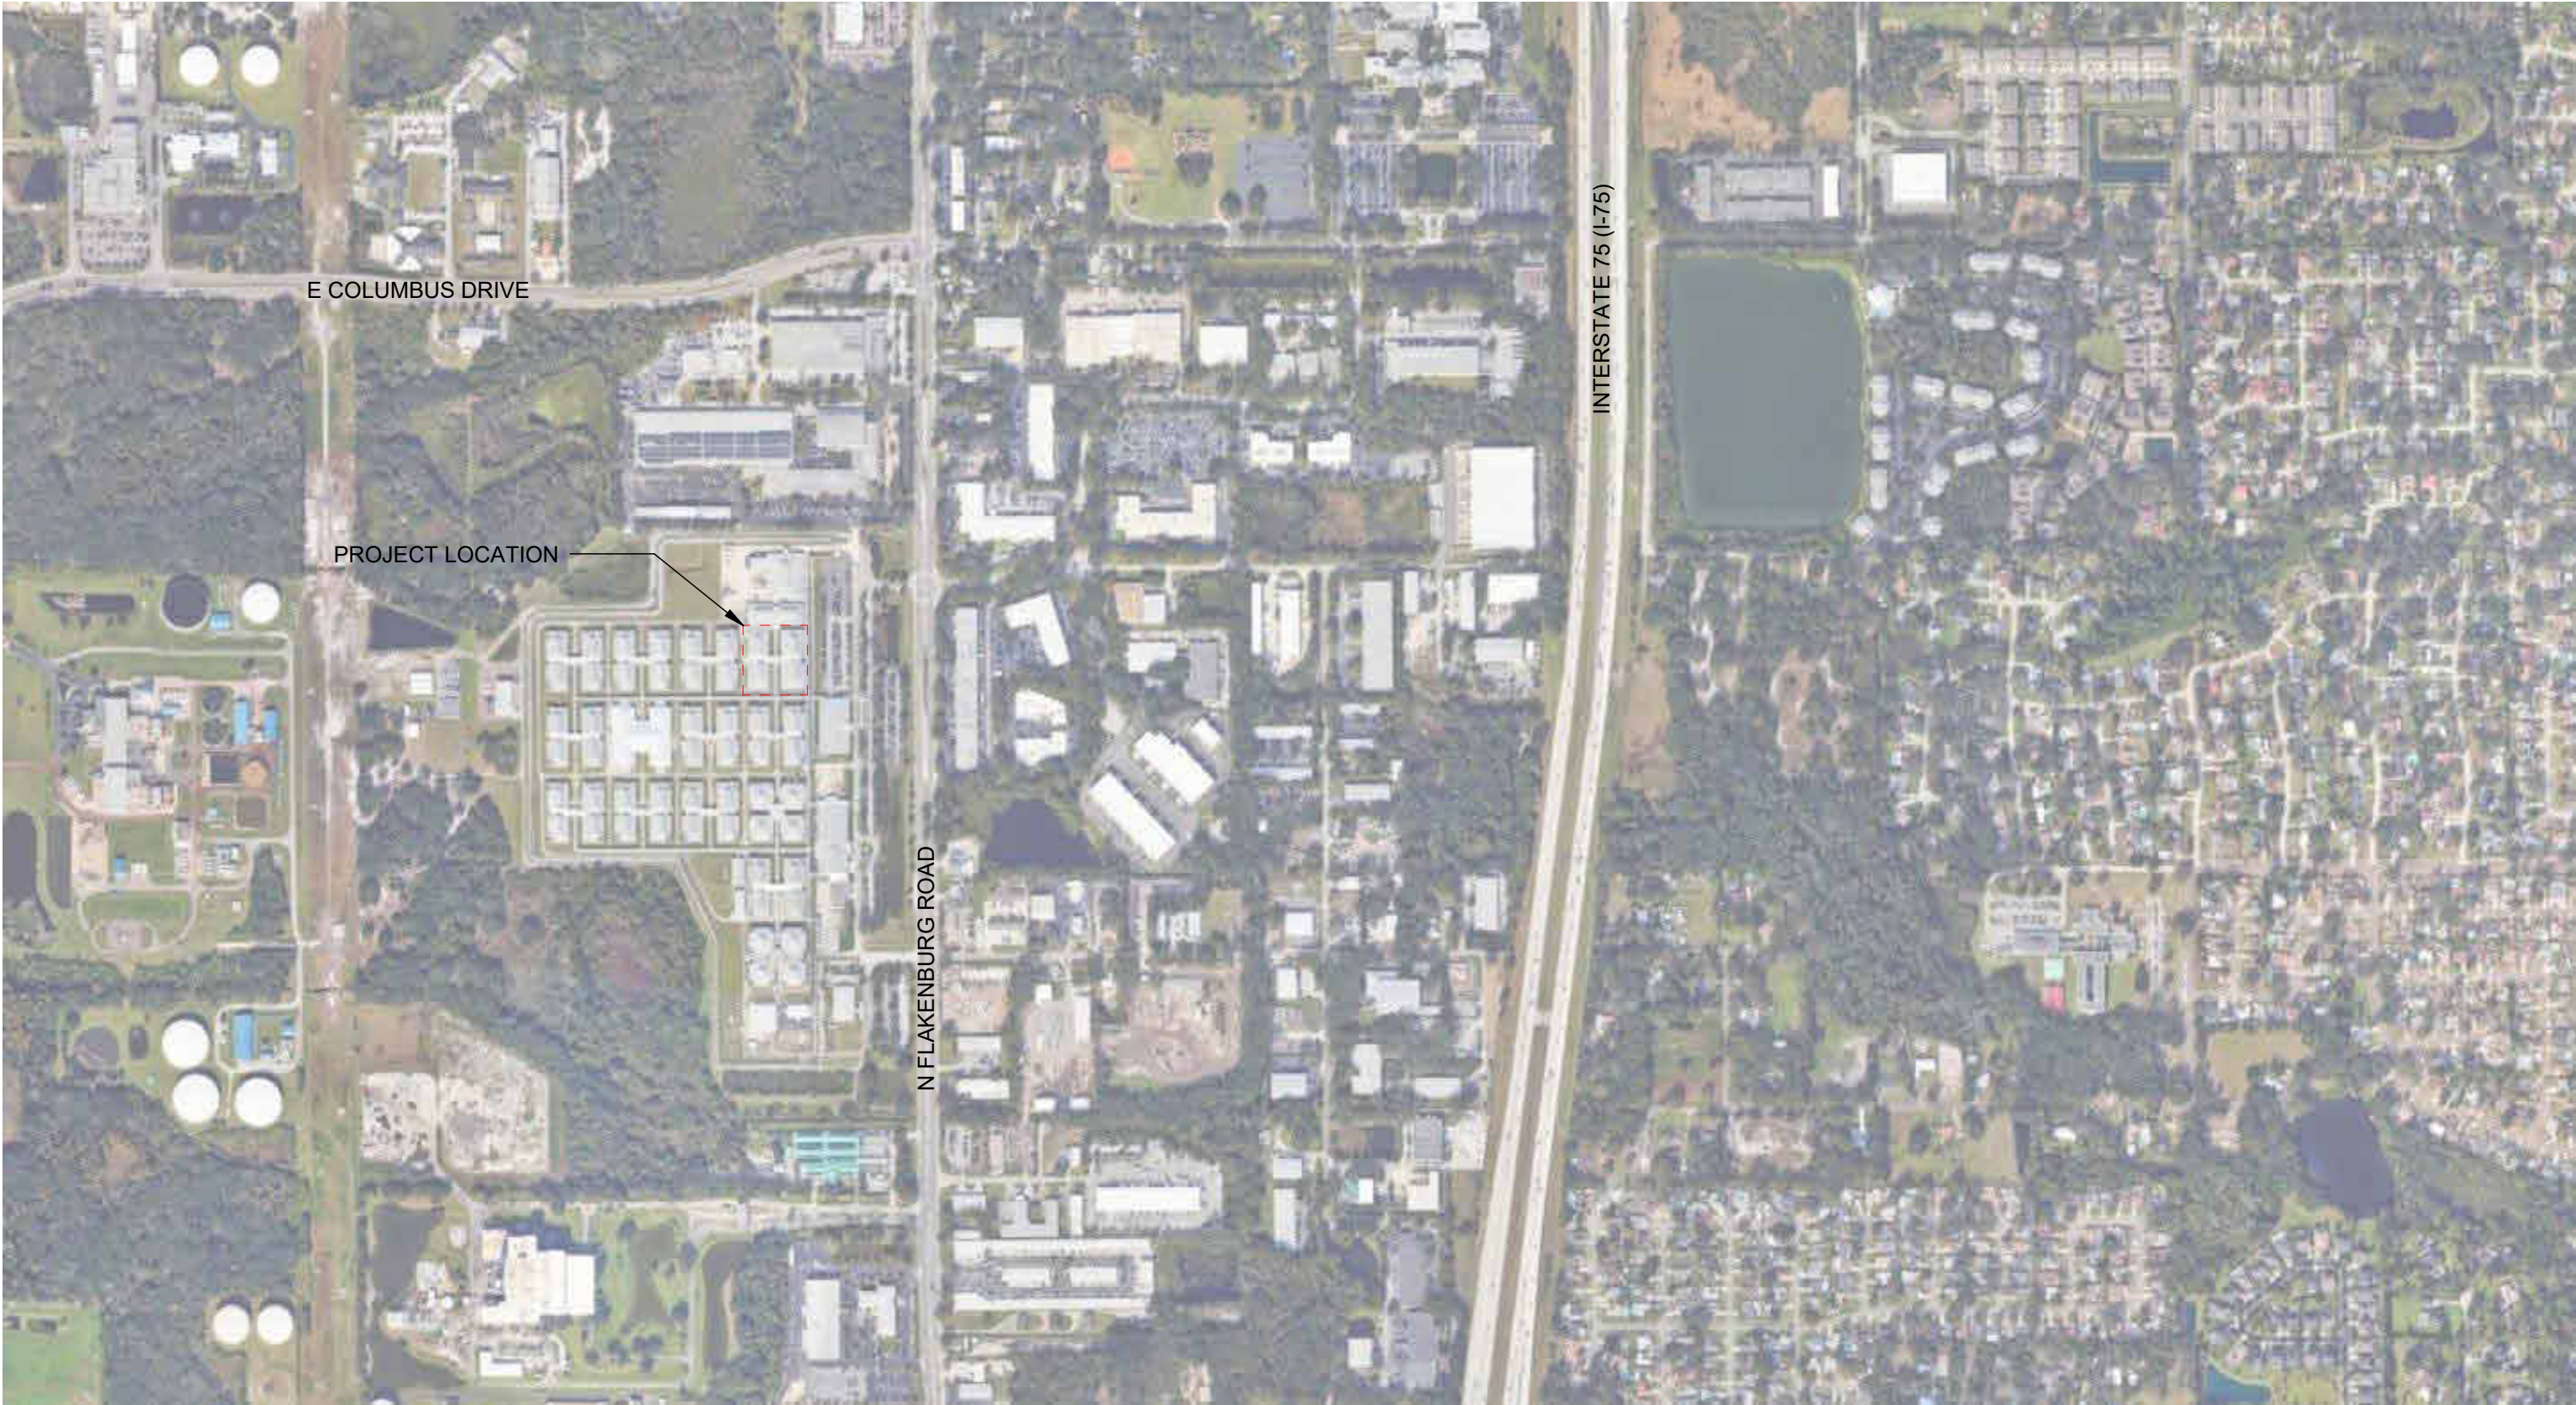

PROJECT VICINITY MAP  
NOT TO SCALE

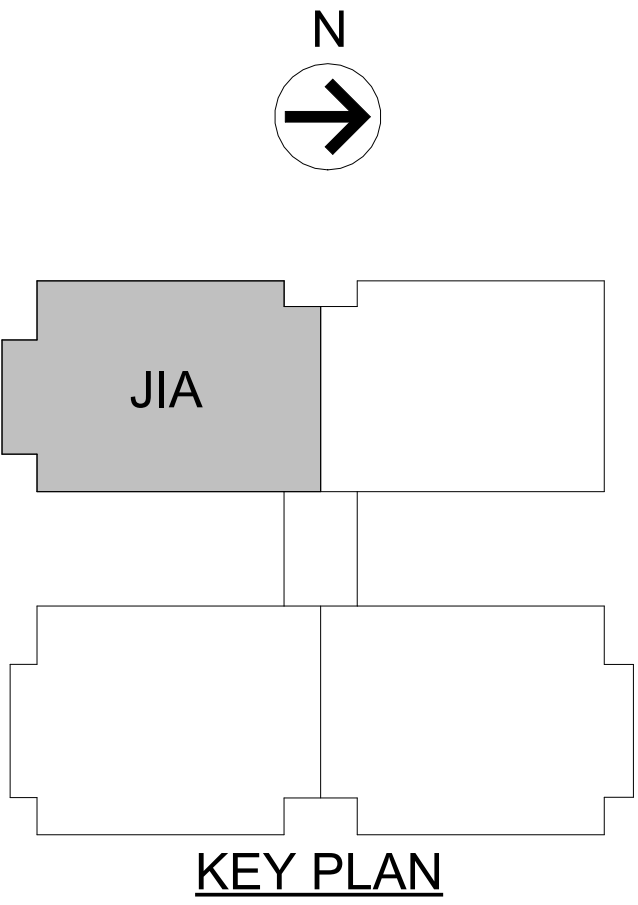



GENERAL		06.20.2024 DD	07.26.2024 75% CD	08.30.2024 PERMIT/81D	09.04.2024 ADDENDU...
G-000A	COVER SHEET - JIA	•	•	•	•
G-001A	CODE DATA - JIA	•	•	•	•
G-002	DRAWING INDEX - JIA			•	•
G-200A	GENERAL NOTES - JIA			•	•
G-300A	ACCESSIBILITY & MOUNTING HEIGHTS - JIA			•	•

LIFE SAFETY				
LS-101A	LIFE SAFETY PLAN - JIA	•	•	•

STRUCTURAL			
S-001A	COVER SHEET - JIA		• •
S-002	STRUCTURAL GENERAL NOTES AND ABBREVIATIONS		• •
S-003	COMPONENTS AND CLADDING		• •
S-100A	DEMOLITION PLAN - JIA		• •
S-101A	GROUND FLOOR PLAN - JIA		• •
S-102A	SECOND FLOOR FRAMING PLAN - JIA		• •
S-201	SCHEDULES & TYPICAL DETAILS		• •
S-301	TYPICAL FOUNDATION DETAILS		• •
S-302	TYPICAL MASONRY DETAILS		• •
S-303	SECTIONS & DETAILS		• •


ARCHITECTURE				
AD-101A	DEMOLITION FLOOR PLAN - JIA	*	*	*
A-101A	DIMENSION FLOOR PLAN - JIA	*	*	*
A-102A	ANNOTATED FLOOR PLAN - JIA	*	*	*
A-111A	REFLECTED CEILING PLAN - JIA	*	*	*
A-401A	ENLARGED PLANS AND ELEVATIONS - JIA	*	*	*
A-402A	ENLARGED RESTROOM PLANS AND ELEVATIONS - JIA	*	*	*
A-403A	MILLWORK DETAILS - JIA	*	*	*
A-500A	WALL TYPES - JIA	*	*	*
A-601A	SCHEDULES	*	*	*
A-602A	ROOM FINISH PLAN & SCHEDULE - JIA	*	*	*

MECHANICAL				
M-001A	MECHANICAL NOTES, LEGENDS & ABBREVIATIONS - JIA	•	•	•
MD-101A	PARTIAL FLOOR PLAN - MECHANICAL DEMOLITION - JIA	•	•	•
MH-101A	PARTIAL FLOOR PLAN - MECHANICAL DUCTWORK - JIA	•	•	•
M-401A	MECHANICAL SECTION VIEWS - JIA	•	•	•
M-501A	MECHANICAL DETAILS - JIA	•	•	•
M-601A	MECHANICAL SCHEDULES - JIA	•	•	•

ELECTRICAL					
E-001A	ELECTRICAL LEGENDS & ABBREVIATIONS - JIA	*	*	*	*
ED-101A	PARTIAL FLOOR PLAN - LIGHTING DEMOLITION - JIA	*	*	*	*
ED-102A	PARTIAL FLOOR PLAN - ELECTRICAL DEMOLITION - JIA	*	*	*	*
E-101A	PARTIAL FLOOR PLAN - LIGHTING - JIA	*	*	*	*
E-102A	PARTIAL FLOOR PLAN - POWER - JIA	*	*	*	*
E-501A	ELECTRICAL DETAILS - JIA	*	*	*	*
E-601A	ELECTRICAL RISER AND SCHEDULES - JIA	*	*	*	*

PLUMBING				
P-001A	PLUMBING NOTES, LEGENDS & SCHEDULES - JIA	•	•	•
PD-101A	PLUMBING DEMOLITION PLAN - SANITARY AND VENT - JIA	•	•	•
PD-201A	PLUMBING AND DEMOLITION PLAN - DOMESTIC WATER - JIA	•	•	•
P-101A	PLUMBING RENOVATION PLAN - SANITARY AND VENT - JIA	•	•	•
P-201A	PLUMBING RENOVATION PLAN - DOMESTIC WATER - JIA	•	•	•
P-401A	PLUMBING RENOVATION - ENLARGED PLANS - JIA	•	•	•
P-501A	PLUMBING DETAILS - JIA	•	•	•
P-901A	SANITARY & VENT ISOMETRIC - JIA	•	•	•
P-902A	DOMESTIC WATER ISOMETRIC - JIA	•	•	•

FIRE PROTECTION (FOR REFERENCE ONLY)				
F-001A	NOTES & LEGENDS - FIRE PROTECTION - JIA	•	•	•
FD-101A	FIRE PROTECTION DEMOLITION PLAN - JIA	•	•	•
F-101A	FIRE PROTECTION RENOVATION PLAN - JIA	•	•	•

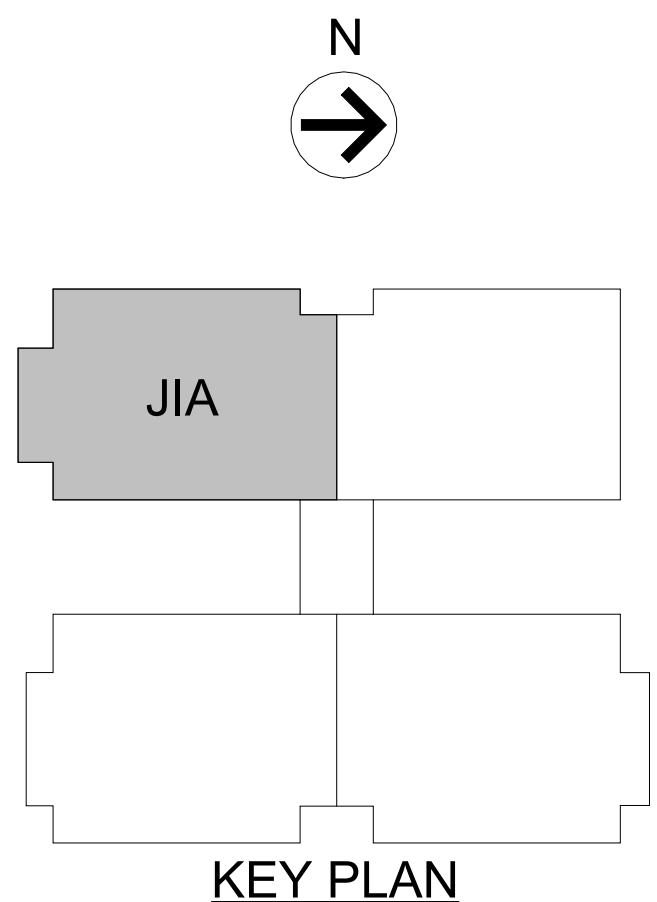[illegible]

DRAWN BY: --  
REVIEW BY: Project  
Manager

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
p 863.682.1882  
f 863.687.6346  
lic. AR94778

lunz.com

24001.01

# G-002

ABV.	ANCHOR BOLT
ACC.	ABOVE
ACCU.	ACCESS
A.C.T.	ACOUSTICAL
	ACOUSTICAL CEILING TILE
	AIR CONDITIONER
ADD.	ADDENDUM
ADH.	ADHESIVE
ADJ.	ADJUSTABLE
A.F.F.	ABOVE FINISH FLOOR
ALUM.	ALTERNATE
ANCH.	ALUMINUM
ANNUNC.	ANCHOR
ANOD.	ANNUNCIATOR
	ANODIZED
	ACCESS PANEL
APPROX.	APPROXIMATE
	ACID RESISTING
ARCH.	ARCHITECTURAL
	ABOVE SLAB
ASPH.	ASPHALT
ASST.	ASSISTANT
AUTO.	AUTOMATIC
	BOTTOM OF
	BASEBOARD
	BOARD
BLDG.	BUILDING
BKL.	BLOCK
BKLG.	BLOCKING
	BEAM
	BENCH MARK
BOT.	BOTTOM
BRG.	BEARING
BRK.	BRICK
	BOTH SIDES
BSE.	BASE
BSMT.	BASEMENT
B.T.B.	BACK TO BACK
B.U.R.	BUILT UP ROOFING
CAB.	CABINET
	CATCH BASIN
CCTV.	CLOSED CIRCUIT TELEVISION
CEM.	CEMENT
C.F.L.	COUNTER FLASHING
	CORNER GUARD
CIRC.	CIRCULATION
	CONTROL JOINT
	CAULK (ING)
	CENTER LINE
CLG.	CEILING
CLO.	CLOSET
CLR.	CLEAR
CLS.	CLOSURE
	CONSTRUCTION MANAGER
C.M.U.	CONCRETE MASONRY UNIT
	CLEAN OUT
COL.	COLUMN
CONC.	CONCRETE
CONF.	CONFERENCE
CONN.	CONNECTION
CONST.	CONSTRUCTION
	CONTINUOUS
CONTR.	CONTRACTOR
COORD.	COORDINATE
CORR.	CORRIDOR
	CONTROL PANEL
CPT.	CARPET
	CLINICAL SINK
	CERAMIC TILE
C.T.C.	CENTER TO CENTER
C.T.G.	CLEAR TEMPERED GLASS
CTR.	CENTER
CTSK.	COUNTRESUNK
	CUBIC
C.W.	COLD WATER
C.W.G.	CLEAR WIRE GLASS
	DRAIN
DBL.	DOUBLE
DEG.	DEGREE
DEMO.	DEMOLISH
DEPT.	DEPARTMENT
DET.	DETAIL
	DRINKING FOUNTAIN
	DIAMETER
DIAG.	DIAGONAL
DIFF.	DIFFUSER
	DIMENSION
DISP.	DISPENSER
	DIVISION
	DOWN
	DOOR OPENING
	DAMP/PROOFING
	DOOR
	DOWNSPOUT
DTL.	DETAIL
	DISH WASHER
DWG.	DRAWING
	EAST
	EACH
	EXPANSION BOLT
E.F.S.	EXTERIOR FINISH SYSTEM
E.I.F.S.	EXTERIOR INSULATION FINISH SYSTEM
	EXPANSION JOINT
	ELEVATION
ELEC.	ELECTRICAL
ELEV.	ELEVATOR
EMER.	EMERGENCY
ENCL.	ENCLOSURE
ENGR.	ENGINEER
ENT.	ENTRANCE
E.P.NL.	ELECTRICAL PANEL
	EQUAL
	EQUIPMENT
EQUIP.	EQUIPMENT
EXH.	EXHAUST
EXIST.	EXISTING
EXP.	EXPANSION
EXPO.	EXPOSED
EXT.	EXTERIOR
	FABRIC
	FACE OF
	FIRE ALARM

F.D.	FLOOR DRAIN	P.F.	PANEL FABRIC
F.E.	FIRE EXTINGUISHER	PFB.	PREFABRICATE(D)
F.E.C.	FIRE EXTINGUISHER CABINET	PN.	PREFINISHED
F.F.	FINISH FLOOR	PL	PLASTER
F.H.	FULL HEIGHT	P.LAM.	PLASTIC LAMINATE
F.H.C.	FIRE HOSE CABINET	PLAS.	PLASTER
F.H.R.	FIRE HOSE RACK	PLBG.	PLUMBING
F.H.S.	FIRE HOSE STATION	PLWD.	PLYWOOD
FIN.	FINISH	P.M.	PRESSED METAL
FL.	FLOOR	PNL.	PANEL
FLASH.	FLASHING	PNT.	PANTRY
FLEX.	FLEXIBLE	POL.	POLISHED
FLUOR.	FLUORESCENT	PR.	PAIR
PPRF.	FIREPROOF	PROP.	PROPERTY
F.P.S.C.	FIREPROOF SELF CLOSING	P.S.	PULL STATION
F.T.	FOOT (FEET)	P.S.F.	POUNDS PER SQUARE FOOT
F.F.F.	FACE TO FACE	P.S.I.	POUNDS PER SQUARE INCHES
FTG.	FOOTING	P.T.	POINT
FURN.	FURNISH	P.T.	PRESSURE TREATED
FURR.	FURRING	PTD.	PAINTED
FUT.	FUTURE	PTN.	PARTITION
GA.	GAGE	Q.T.	QUARRY TILE
GALV.	GALVANIZED	QTY.	QUANTITY
G.C.	GENERAL CONTRACTOR		
GEN.	GENERAL	R.	RISER
GL.	GLASS	RAD.	RADIUS
GND.	GROUND	R.B.	RUBBER BASE
G.N.D.	GYPNUM PLASTER	R.C.P.	REFLECTED CEILING PLAN
GVL.	GROVE	R.D.	R.D. DRAIN
G.W.B.	GYPNUM WALL BOARD	REC.	RECESSED
GYP.	GYPNUM	RECEP.	RECEPTION
GYP. BD.	GYPNUM BOARD	REF.	REFERENCE
		REFR.	REFRIGERATOR
H.	HIGH	REINF.	REINFORCED(REINFORCING)
H.C.	HOLLOW CORE	REOD.	REQUIRE
HDCP.	HANDICAPPED	RESIL.	RESILIENT
HDW.	HARDWARE	REV.	REVISION
HDWD.	HARDWOOD	R.H.	RIGHT HAND
H.M.	HOLLOW METAL	RM.	ROOM
H.O.	HOLD OPEN	R.O.	ROUGH OPENING
HORIZ.	HORIZONTAL		
H.P.	HIGH POINT	S.	SOUTH
HR.	HOOR	SAN.	SANITARY
HT.	HEIGHT	S.C.	SOLID CORE
HTG.	HEATING	SCHED.	SCHEDULE
H.V.A.C.	HEATING, VENTILATING, AIR CONDITIONER	S.D.	SOAP DISPENSER
H.W.	HOT WATER	SECT.	SECTION
		SECUR.	SECURITY
		S.F.	SQUARE FOOT(FEET)
I.D.	INSIDE DIAMETER	SHR.	SHOWER
IN.	INCH(ES)	SHT.	SHEET
INCAND.	INCANDESCENT	SIM.	SIMILAR
INCL.	INCLUDE(D)	SNT.	SEALANT
INFO.	INFORMATION	SQ.	SPECIFICATION
INSUL.	INSULATION	SPKR.	SPEAKER
INT.	INTERIOR	SPE.	SPECIFICATION
INTERM.	INTERMEDIATE	S.S.	STAINLESS STEEL
INV.	INVERT	S.SK.	SERVICE SINK
		STA.	STATION
JAN.	JANITOR	S.T.C.	SOUND TRANSMISSION CLASS
J.B.	JOIST BEARING	STD.	STANDARD
J.C.	JANITOR'S CLOSET	STER.	STERILIZER
JT.	JOINT	STL.	STEEL
		STN.	STONE
K.D.	KNOCK DOWN	STOR.	STORAGE
K.O.	KNOCK OUT	STRUC.	STRUCTURAL
KIT.	KITCHEN	SURG.	SURGICAL
K.S.	KNEE SPACE	SUSP.	SUSPENDED
		SWBD.	SWITCHBOARD
LAB.	LABORATORY	SYM.	SYMMETRICAL
LACQ.	LACQUERED		
LAM.	LAMINATE(D)	T.	TREAD
LAV.	LAVATORY	T/	TOP OF
LB (S)	POUNDS(S)	T & B.	TOP & BOTTOM
L.F.	LINEAR FOOT	T. & G.	TONGUE & GROOVE
LGT.	LENGTH	T.B.D.	TO BE DETERMINED
L.H.	LEFT HAND	TEL.	TELEPHONE
LIN.	LINEN	TEMP.	TEMPERED
LKR.	LOCKER	TERRAZZO	TERRAZZO
L.L.	LEAD LINED	THK.	THICK
L.P.	LOW POINT	THRU.	THROUGH
LT.	LIGHT	TILT	TILT
LT.WT.	LIGHTWEIGHT	T.O.B.	TOP OF BEARING
		T.O.P.	TOP OF PLATE
MAR.	MARBLE	TOPO.	TOPOGRAPHY
MAINT.	MAINTENANCE	T.O.S.	TOP OF SLAB
MAS.	MASONRY	T.O.STL.	TOP OF STEEL
MATL.	MATERIAL	T.V.	TELEVISION
MAX.	MAXIMUM	TYP.	TYPICAL
MECH.	MECHANICAL		
MEMB.	MEMBRANE	UNF.	UNFINISHED
MEZZ.	MEZZANINE	U.N.O.	UNLESS NOTED OTHERWISE
MFR.	MANUFACTURER	U.O.N.	UNLESS OTHERWISE NOTED
MGMT.	MANAGEMENT	UR.	URNAL
MIN.	MINIMUM	UTIL.	UTILITY
MISC.	MISCELLANEOUS		
M.O.	MASONRY OPENING	V.	VINYL
MOV.	MOVABLE	VAC.	VACUUM
M.R.	MOISTURE RESISTANCE	V.B.	VINYL BASE
MTD.	MOUNTED	V.C.T.	VINYL COMPOSITION TILE
MTG.	MOUNTING	VENT.	VENTILATION
MTL.	METAL	VERT.	VERTICAL
MUL.	MULLION	VEST.	VESTIBULE
		V.I.F.	VERIFY IN FIELD
N.	NORTH	VOLUME	VOLUME
N.C.	NURSE CALL	VP.B.	VAPOR BARRIER
N.I.C.	NOT IN CONTRACT	V.T.	VINYL TILE
N.O.	NUMBER	V.V.C.	VINYL WALL COVERING
NOM.	NOMINAL		
N.T.S.	NOT TO SCALE	W	WEST OR WIDE
		W/	WITH
O.A.	OVERALL	W/O	WITHOUT
O.C.	ON CENTER	W.C.	WATER CLOSET
O.D.	OUTSIDE DIAMETER	WD.	WIDED
OFF.	OFFICE	WDT.	WATER
OH.	OVERHEAD	W.F.	WIDE FLANGE
OPNG.	OPENING	W.H.	WATER HEATER
OPP.	OPPOSITE	W.I.	WROUGHT IRON
OPP.H.	OPPOSITE HANG	WIN.	WINDOW
O.T.O.	OUT TO OUT	WM.	WIRE MESH
P.A.	PUBLIC ADDRESS	W/PF.	WATERPROOFING
PART.	PARTITION	WSC.	WAINSCOT
PAV.	PAVEMENT	WT.	WEIGHT
P.C.	PRECAST	YD.	YARD

THE CONTRACTOR SHALL VISIT THE SITE AND BECOME FAMILIAR WITH SITE CONDITIONS AS THEY MAY AFFECT CARRYING OUT THE WORK AS DESCRIBED IN THESE CONTRACT DOCUMENTS. THE CONTRACTOR SHALL INVESTIGATE, VERIFY, AND BE RESPONSIBLE FOR ALL INFORMATION, PROJECT AND NOTING THE ARCHITECT OF ANY CONDITIONS THAT REQUIRE MODIFICATION BEFORE PROCEEDING WITH THE WORK.

2. DIMENSIONS INDICATED ARE TO FACES OF STRUCTURE AND GRID LINES (TYPICAL), UNLESS NOTED OTHERWISE.

REFER TO ENLARGED PLANS FOR DIMENSIONS, DETAIL REFERENCES, AND INTERIOR ELEVATION REFERENCES WITHIN THOSE AREAS.

4. REFER TO STRUCTURAL, MECHANICAL, PLUMBING, AND ELECTRICAL FOR ADDITIONAL GENERAL NOTES, ABBREVIATIONS, AND SYMBOLS. ALL NOTES ARE TO BE REVIEWED, AND APPLIED TO RELATED BUILDING COMPONENTS. DETAILS NOT SHOWN ARE SIMILAR IN CHARACTER TO THOSE THAT ARE SHOWN. WHERE SPECIFIC DIMENSIONS, DETAILS, OR DESIGN INTENT CANNOT BE DETERMINED OR REASONABLY INFERRED, CONSULT THE ARCHITECT BEFORE PROCEEDING WITH THE WORK. REFER TO STRUCTURAL DRAWINGS FOR STRUCTURAL COLUMN AND BEARING WALL LOCATIONS AND SIZES.

5. REFER TO SHEET A-3.21 FOR PARTITION TYPES, DETAILS, AND DESCRIPTIONS.

6. PARTITION TYPES CONTINUE AROUND CORNERS UNLESS INDICATED OTHERWISE.

7. CORNERS TO REFLECTED CEILING PLANS FOR SOFFIT LOCATIONS AND CEILING DETAIL REFERENCES.

8. WHERE DOORS IN METAL STUD/GYPSUM BOARD PARTITIONS ARE NOT SPECIFICALLY LOCATED ON THE PLANS WITH DIMENSION STRIPS, PROVIDE A MINIMUM HINGE-SIDE JAMB DIMENSION OF 6" FROM DOOR OPENING TO ADJACENT PERPENDICULAR WALLS. WHERE DOORS APPEAR TO BE CENTERED WITHIN CORRIDORS, LOCATE THE DOORS IN THE CENTER OF THE CORRIDOR.

9. DRAWINGS ARE PREPARED USING DIMENSIONS AND PRODUCT CONFIGURATIONS OR DETAILS OF SPECIFIC MANUFACTURERS (TYPICALLY THE FIRST MANUFACTURER LISTED UNDER "ACCEPTABLE MANUFACTURERS" IN THE SPECIFICATIONS). DIMENSIONS AND DETAILS FOR SPECIFIC PRODUCTS MAY CHANGE BEFORE THEY ARE ACTUALLY INCORPORATED INTO THE WORK, AND PRODUCTS BY OTHER MANUFACTURERS MAY ALSO BE ACCEPTABLE. THEREFORE, ACTUAL INSTALLATION DETAILS AND DIMENSIONS MAY DIFFER FROM THOSE SHOWN. CONTRACTOR SHALL VERIFY INSTALLATION REQUIREMENTS FOR ALL PRODUCTS TO BE INCORPORATED IN THE WORK (INCLUDING PARTITION THICKNESSES FOR RECESSED OR SEMI-RECESSED PRODUCTS), AND IS RESPONSIBLE FOR ACCOMMODATING AND COORDINATING CHANGES TO THE WORK OF OTHER TRADES OR PRODUCTS THAT ARE NECESSARY BECAUSE OF THESE DIFFERENCES.

10. THE DRAWINGS AND SPECIFICATIONS ARE SEPARATED INTO DISCIPLINES FOR THE CONVENIENCE OF THE ARCHITECT AND THE CONTRACTOR. THE SEPARATIONS USED HEREIN ARE USED ONLY FOR THE PURPOSES OF SCOPE AND REFERENCE AND IN NO WAY DO THEY DEFINE OR LIMIT THE SCOPE OR INTENT OF ANY PART OF THE DRAWINGS, OR OF THE DRAWINGS AND SPECIFICATIONS AS A WHOLE. THE FACT THAT THE DRAWINGS ARE SEPARATED IN NO WAY SUGGESTS THAT THE WORK IS NOT TO BE CONSTRUCTED AS A COMPLETE, INTEGRATED AND UNIFIED WHOLE.

11. THE DRAWINGS AND SPECIFICATIONS, INCLUDING DRAWINGS PREPARED BY SPECIFIC ENGINEERING DISCIPLINES (SUCH AS CIVIL, STRUCTURAL, MECHANICAL, ELECTRICAL, ETC.) ARE COMPLEMENTARY; ITEMS SHOWN IN ANY ONE LOCATION IN THE DRAWINGS SHALL BE CONSIDERED TO BE REQUIREMENTS OF THE CONTRACT FOR CONSTRUCTION. IN THE EVENT OF AN INCONSISTENCY BETWEEN THE DRAWINGS AND SPECIFICATIONS, OR WITHIN EITHER DOCUMENT, THE CONTRACTOR SHALL SEEK CLARIFICATION OR INTERPRETATION FROM THE ARCHITECT PRIOR TO BIDDER. WHERE AN INCONSISTENCY IS NOT CLARIFIED PRIOR TO BIDDING, AND WHERE THE ACTUAL SOLUTION OR INTENT CANNOT BE REASONABLY INFERRED, THE CONTRACTOR SHALL INCLUDE THE BETTER QUALITY OR GREATER QUANTITY OF WORK IN THE BID PROPOSAL.

12. WALL, CEILING, BASE, AND FLOOR FINISHES ARE TO BE PROVIDED IN EVERY ROOM UNLESS THE DRAWINGS SPECIFICALLY INDICATE THAT A ROOM OR PORTION THEREOF IS REMAINING UNFINISHED. IF ROOM FINISHES ARE NOT SPECIFICALLY INDICATED, PROVIDE THE SAME FINISHES AS ARE PROVIDED IN THE ROOM ADJACENT TO THE ROOM IN QUESTIONS, OR OBTAIN CLARIFICATION FROM THE ARCHITECT PRIOR TO BIDDING.

13. FIRE-RATED CORRIDOR PARTITIONS INDICATED ON FLOOR PLANS ARE COMPONENTS OF CONTINUOUS RATED CORRIDOR ASSEMBLIES CONSISTING OF WALLS, FLOOR, AND CEILING. SEE REFLECTED CEILING PLANS AND PARTITION TYPES FOR SPECIFIC METHODS OF ACHIEVING THE NECESSARY RATINGS. WHERE THE SPECIFIC METHOD OF ACHIEVING THE RATING IS NOT INDICATED, OBTAIN CLARIFICATION FROM THE ARCHITECT PRIOR TO BIDDING. THE RATING OF THE ENTIRE CORRIDOR MUST BE MAINTAINED. PROVIDE RATED PARTITIONS, FLOORS, CEILINGS, AND DOOR OR OTHER OPENING ASSEMBLIES TO MAINTAIN THE CONTINUITY OF THE FIRE RATING. PROVIDE FIRE SAFING AND FIRE-RATED SEALANTS TO MAINTAIN THE CONTINUITY OF THE FIRE-RATED SYSTEM. IF A CEILING RATING IS NOT SPECIFICALLY INDICATED, OBTAIN CLARIFICATION FROM THE ARCHITECT PRIOR TO BIDDING; OTHERWISE, ASSUME A RATING TO MATCH THE RATING OF THE CORRIDOR WALLS. WHERE MECHANICAL WORK PENETRATES ANY COMPONENT OF THE FIRE-RATED ASSEMBLY, PROVIDE THE APPROPRIATE FIRE AND/OR SMOKE DAMPERS. IF IT IS NOT CLEAR WHETHER DUCTWORK PENETRATES A PORTION OF THE RATED ASSEMBLY, OBTAIN CLARIFICATION FROM THE ARCHITECT PRIOR TO BIDDING.

14. DOOR ASSEMBLIES IN 1-HOUR RATED PARTITIONS ARE TO BE 60-MINUTE RATED UNLESS A HIGHER RATING IS INDICATED IN THE DOOR SCHEDULE. DOOR ASSEMBLIES IN 2-HOUR RATED PARTITIONS ARE TO BE 60-MINUTE RATED UNLESS A HIGHER RATING IS INDICATED IN THE DOOR SCHEDULE.

15. USE TEMPERED GLASS IN ALL OPENINGS WITHIN 18" OF THE FLOOR OR A DOOR, UNLESS ANOTHER FORM OF SAFETY GLAZING IS SPECIFICALLY INDICATED ON THE DRAWINGS.

16. USE FIRE RATED GLAZING IN ALL GLAZED OPENINGS WITHIN FIRE-RATED CORRIDORS.

17. CAULK ALL JOINTS OR CRACKS WHICH OCCUR WHERE DISSIMILAR MATERIALS INTERSECT PERPENDICULAR TO EACH OTHER, AND THE INTERSECTION IS EXPOSED TO VIEW, UNLESS INDICATED OTHERWISE ON THE DRAWINGS.

18. PROVIDE SLIP JOINT CONNECTIONS AT THE TOPS OF ALL PARTITIONS WHICH INTERSECT THE STRUCTURE ABOVE. PROVIDE FIRE-PROTECT AT ALL SLIP JOINT CONNECTIONS IN FIRE-RATED PARTITIONS. SEE PARTITION TYPES FOR TYPICAL SLIP-JOINT CONNECTION DESIGN. IF AMOUNT OF DEFLECTION TO BE ACCOMMODATED IS NOT INDICATED, OBTAIN CLARIFICATION FROM THE ARCHITECT PRIOR TO INSTALLATIONS.

20. PAINT ALL EXPOSED STEEL, OR WOOD (UNLESS NOTED OTHERWISE).

21. ALL MATERIAL COLORS TO BE SELECTED BY ARCHITECT, UNLESS NOTED OTHERWISE.

22. M.O. (MASONRY OPENING) REFERS TO NOMINAL MASONRY OPENING DIMENSIONS IN MASONRY CONSTRUCTION.

23. GENERAL CONTRACTOR TO PROVIDE ALL NECESSARY MATERIALS TO INSTALL EQUIPMENT PER MANUFACTURER, NEW AND EXISTING.

24. REFER TO CIVIL DRAWINGS FOR SITE GRADING; REFER TO ARCHITECTURAL SITE PLAN AND ENLARGED SITE PLANS FOR CONCRETE PAVING PATTERNS AND SPOT ELEVATIONS.
25. STRUCTURAL STEEL OR PRECAST CONCRETE SHAPES ARE SHOWN FOR DETAILING OF ARCHITECTURAL FINISHES ONLY; REFER TO STRUCTURAL DRAWINGS FOR STRUCTURAL DIMENSIONS, SIZES, SHAPES, AND DETAILS OF CONSTRUCTION FOR SPECIFIC CONDITIONS
26. REFER TO FINISH SCHEDULE AND INTERIOR ELEVATIONS FOR ALL WALL, CEILING, FLOOR, AND BASE MATERIALS AND FINISH DESIGNATIONS.
27. REFER TO REFLECTED CEILING PLANS AND CEILING DETAILS FOR CEILING HEIGHTS, SOFFIT HEIGHTS, AND MATERIALS OF CONSTRUCTION.
28. FLASHING, DAMPROOFING, AND INSULATIONS SHOWN ON WALL SECTIONS INDICATE VERTICAL LOCATIONS ONLY; PROVIDE CONTINUOUS SYSTEMS
29. PROVIDE SEALANT AND BACKER RODS (TYPICAL) AT ALL EXTERIOR DOOR AND WINDOW FRAMES AND LOUVERS.
30. REFER TO WINDOW SCHEDULE AND ELEVATIONS FOR WINDOW AND GLAZING TYPES.
31. REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR INTERFACES WITH THESE SYSTEMS NOT SHOWN ON WALL SECTIONS.
32. CONTRACTOR OR WINDOW MANUFACTURER TO DESIGN, PROVIDE AND INSTALL COMPLETE ATTACHMENT OF WINDOW TO STRUCTURAL STEEL OR STRUCTURAL CONCRETE, OR STRUCTURAL CONCRETE MASONRY PER SPECIFICATIONS AND WINDOW MANUFACTURER'S REQUIREMENTS AND IN ACCORDANCE WITH APPLICABLE CODES.

PROJECT INFORMATION

PROJECT NAME: HSCO MENTAL HEALTH CLINIC - JIA  
PROJECT LOCATION: 520 N. FALKENBURG ROAD  
TAMPA, FLORIDA 33619

PROJECT DESCRIPTION

RENOVATION OF EXISTING MEDICAL OFFICE SPACE TO BUSINESS OFFICE SPACE AND INSTITUTIONAL SPACE. INSTITUTIONAL SPACE INCLUDES ISOLATION AND HOLDING CELLS, RESTROOMS, SHOWERS, GENERAL INMATE SLEEPING AREAS. SCOPE INCLUDES THE ADDITION OF A SECURED OUTSIDE RECREATION YARD TO MATCH EXISTING JID YARD.

BUILDING DATA:

SQUARE FOOTAGES:  
OFFICE/BUSINESS: 2,622 SF  
INSTITUTIONAL GROUP I-3: 8,037 SF  
RENOVATION SQUARE FOOTAGE: 10,659 SF  
TOTAL SQUARE FOOTAGE: 21,318 SF

FLOOD DESIGN DATA:

N/A

CLADDING DESIGN DATA:

N/A

CODE REFERENCE

APPLICABLE CODES:

FLORIDA BUILDING CODE: EIGHTH EDITION 2023  
FLORIDA EXISTING BUILDING: EIGHTH EDITION 2023  
FLORIDA ACCESSIBILITY CODE: EIGHTH EDITION 2023  
FLORIDA MECHANICAL CODE: EIGHTH EDITION 2023  
FLORIDA PLUMBING CODE: EIGHTH EDITION 2023  
FLORIDA FIRE PREVENTION CODE: EIGHTH EDITION 2023  
NFPA 70: NATIONAL ELECTRICAL 2020  
(EXCEPT ARTICLE 80):

OCCUPANCY (FBC CHAPTER 3):  
INSTITUTIONAL - GROUP I-3  
BUSINESS - GROUP B

CLASSIFICATION OF WORK (FBC EXISTING BLDG CHAPTER 6):  
ALTERNATION - LEVEL 2  
CHANGE OF OCCUPANCY

GENERAL BUILDING LIMITATIONS (FBC TABLE 504):		
TYPE 2B (UNPROTECTED, SPRINKLERED)		
	ALLOWABLE:	PROVIDED:
MAX HEIGHT	75'-0"	EXISTING
HEIGHT INCREASE (SECTION 504.2)	N/A	N/A
MAX STORIES	2	1
STORY INCREASE (SECTION 504.2)	--	--
MAX AREA FBC TABLE 506.2	40,000 SQ. FT.	23,214 SQ. FT.
AREA INCREASE (SECTION 506.3, SPRINKLED, 200% INCREASE	--	--

TYPE OF CONSTRUCTION (FBC CHAPTER 6): 2B

FIRE-RESISTANCE RATING FOR BUILDING ELEMENTS: (TABLE 601)

BUILDING ELEMENT	TYPE 2B
PRIMARY STRUCTURAL FRAME	0
BEARING WALLS EXTERIOR INTERIOR	0
NON-BEARING WALLS AND PARTITIONS (INTERIOR)	0
FLOOR CONSTRUCTION AND SECONDARY MEMBERS	0
ROOF CONSTRUCTION AND SECONDARY MEMBERS	0

FIRE RATINGS (FBC CHAPTER 7):		
TYPE 2B (UNPROTECTED, SPRINKLERED)		
DESCRIPTION	REQUIRED	PROVIDED:
SEPERATION OF OCCUPANCY (TABLE 508.4) GROUP B AND I-3	1 HR FIRE RATING	1 HR FIRE RATING
DOOR RATINGS AT 1 HR RATED FIRE PARTITION (TABLE 716.5)	3/4 HR FIRE RATING	3/4 HR FIRE RATING

INTERIOR FINISHES (TABLE 803.11):			
OCCUPANCY	EXIT ENCLOSURES AND PASSAGEWAYS	CORRIDORS	ROOMS AND ENCLOSED SPACES
GROUP I-3	CLASS A	CLASS A	CLASS C
GROUP B	CLASS B	CLASS C	CLASS C

AUTOMATIC SPRINKLER SYSTEMS: (FBC 903.2)  
GROUP I-3 : REQUIRED  
GROUP B : NOT REQUIRED

AN AUTOMATIC SPRINKLER SYSTEM IS EXISTING TO REMAIN THROUGHOUT.

FIRE ALARM: (FBC 907, NFPA 72)  
GROUP I-3 : REQUIRED  
GROUP B : NOT REQUIRED

A MANUAL FIRE ALARM SYSTEM AND AUTOMATIC SMOKE DETECTION SYSTEM FOR ALERTING STAFF IS EXISTING TO REMAIN THROUGHOUT.

MEANS OF EGRESS (FBC CHAPTER 10)  
POPULATION/ OCCUPANCY LOAD (FROM TABLE 1004.1.2)

FUNCTION OF SPACE	AREA	AREA /PERSON	OCCUPANTS
INSTITUTIONAL (I-3) - SLEEPING AREAS	8,037 SF	120 GROSS	31*
BUSINESS (B)	2,622 SF	150 GROSS	18
TOTAL OCCUPANT LOAD			49 PERSONS

\*OCCUPANT LOAD IS DETERMINED BY ACTUAL COUNT OF INMATES

MEANS OF EGRESS

(FBC CHAPTER 10)	SPRINKLERED, I-3 AND B-OCCUPANCY	
OCCUPANCY:	REQUIRED	PROVIDED
MAXIMUM TRAVEL DISTANCE (TABLE 1017.2.2)	I-3: 200'- 0" B: 300'- 0"	I-3: 138' - 6" B: 99' - 6"
MAXIMUM DEAD-END CORRIDOR (FBC 1020.4)	50'- 0"	N/A
TOTAL # OF BLDG EXITS (SECTION 1006.3.1)	2 PER STORY	3 PER STORY
TOTAL # OF SPACE EXITS (SECTION 1006.2.1)	2 IF GREATER THAN 49 OCCUPANTS	2
COMMON PATH OF EGRESS TRAVEL (SECTION 1006.3.2 (2))	100' - 0"	N/A
EGRESS STAIR WIDTH PER LEVEL (SECTION 1005.3.1)	0.3 x (0.4)=	N/A
OTHER EGRESS WIDTH PER LEVEL (SECTION 1005.3.2)	0.2 49 x (0.2)= 9.8	AT LEAST 36"
MINIMUM CORRIDOR AISLE WIDTH (TABLE 1020.2)	44"	104"
EXIT PASSAGE WAY FIRE RATING (SECTION 1023.3)	N/A	N/A
MINIMUM CLEAR OPENING OF EXIT DOORS (SECTION 1010.1.1)	32"	AT LEAST 36"

CORRIDOR FIRE RESISTANCE RATING: (FROM TABLE 1020.1)


OCCUPANCY CLASSIFICATION	OCCUPANT LOAD	FIRE RESISTANCE RATING (SPRINKLED)
GROUP I-3	49 PERSONS	1 HR
GROUP B	>30	NA

MINIMUM PLUMBING FACILITES (FPC CHAPTER 403.1)  
INSTITUTIONAL - 31 PERSONS  
BUSINESS - 17 PERSONS / 9 EACH SEX

CATEGORY	WATER CLOSETS		LAVATORIES		BATH/SHOWERS		DRINKING FOUNTAINS		OTHER - SERVICE SINK
	REQUIRED	PROVIDED	REQUIRED	PROVIDED	REQUIRED	PROVIDED	REQUIRED	PROVIDED	
INSTITUTIONAL (13 CELLS / 18 GENERAL)									
CELLS	13	13	13	13	0.87	1	0.32	--	1
GENERAL	1.2	4	1.2	4	1.2	4			
BUSINESS (9 PERSONS EACH SEX)									
MALE	0.36	2*	0.23	2*	--	--	0.17	--	1
FEMALE	0.36	2*	0.23	2*	--	--			

\*FIXTURES ARE EXISTING TO REMAIN

NOTE: ALL INMATE AREAS SHALL MEET FLORIDA MODEL JAIL STANDARDS (EFFECTIVE DATE: 04.25.2024)

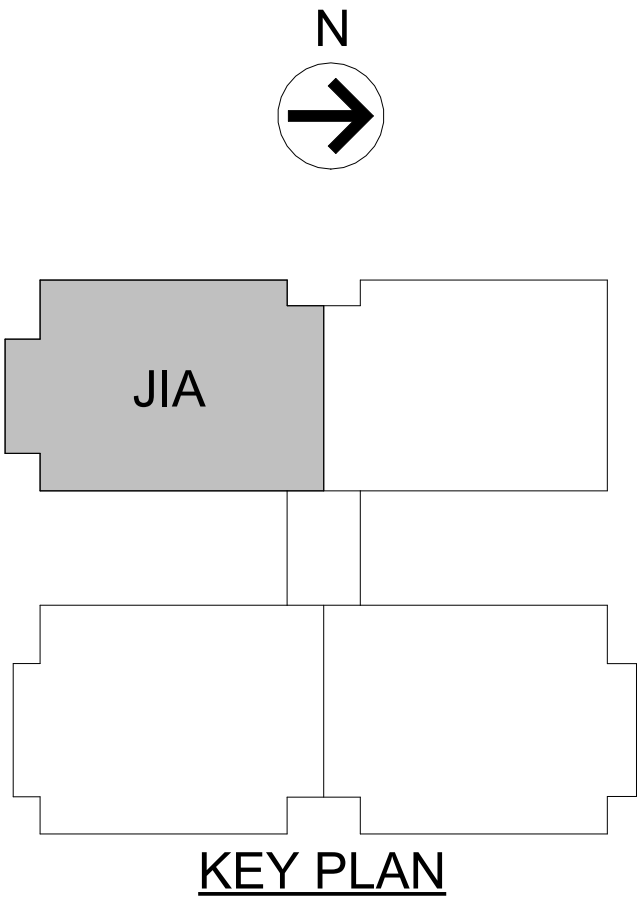

#	ISSUED FOR	DATE
	75% CD (OWNER APPROVAL)	07.25.24
	PERMIT/BID	08.30.24
	ADDENDUM #4	09.04.24

DRAWN BY: --  
REVIEW BY: Project Manager  
THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED



58 Lake Morton Dr  
Lakeland, FL 33801  
P 883.685.1162  
F 883.687.6346  
LC: AR04778

lunz.com

24001.01


G-001A



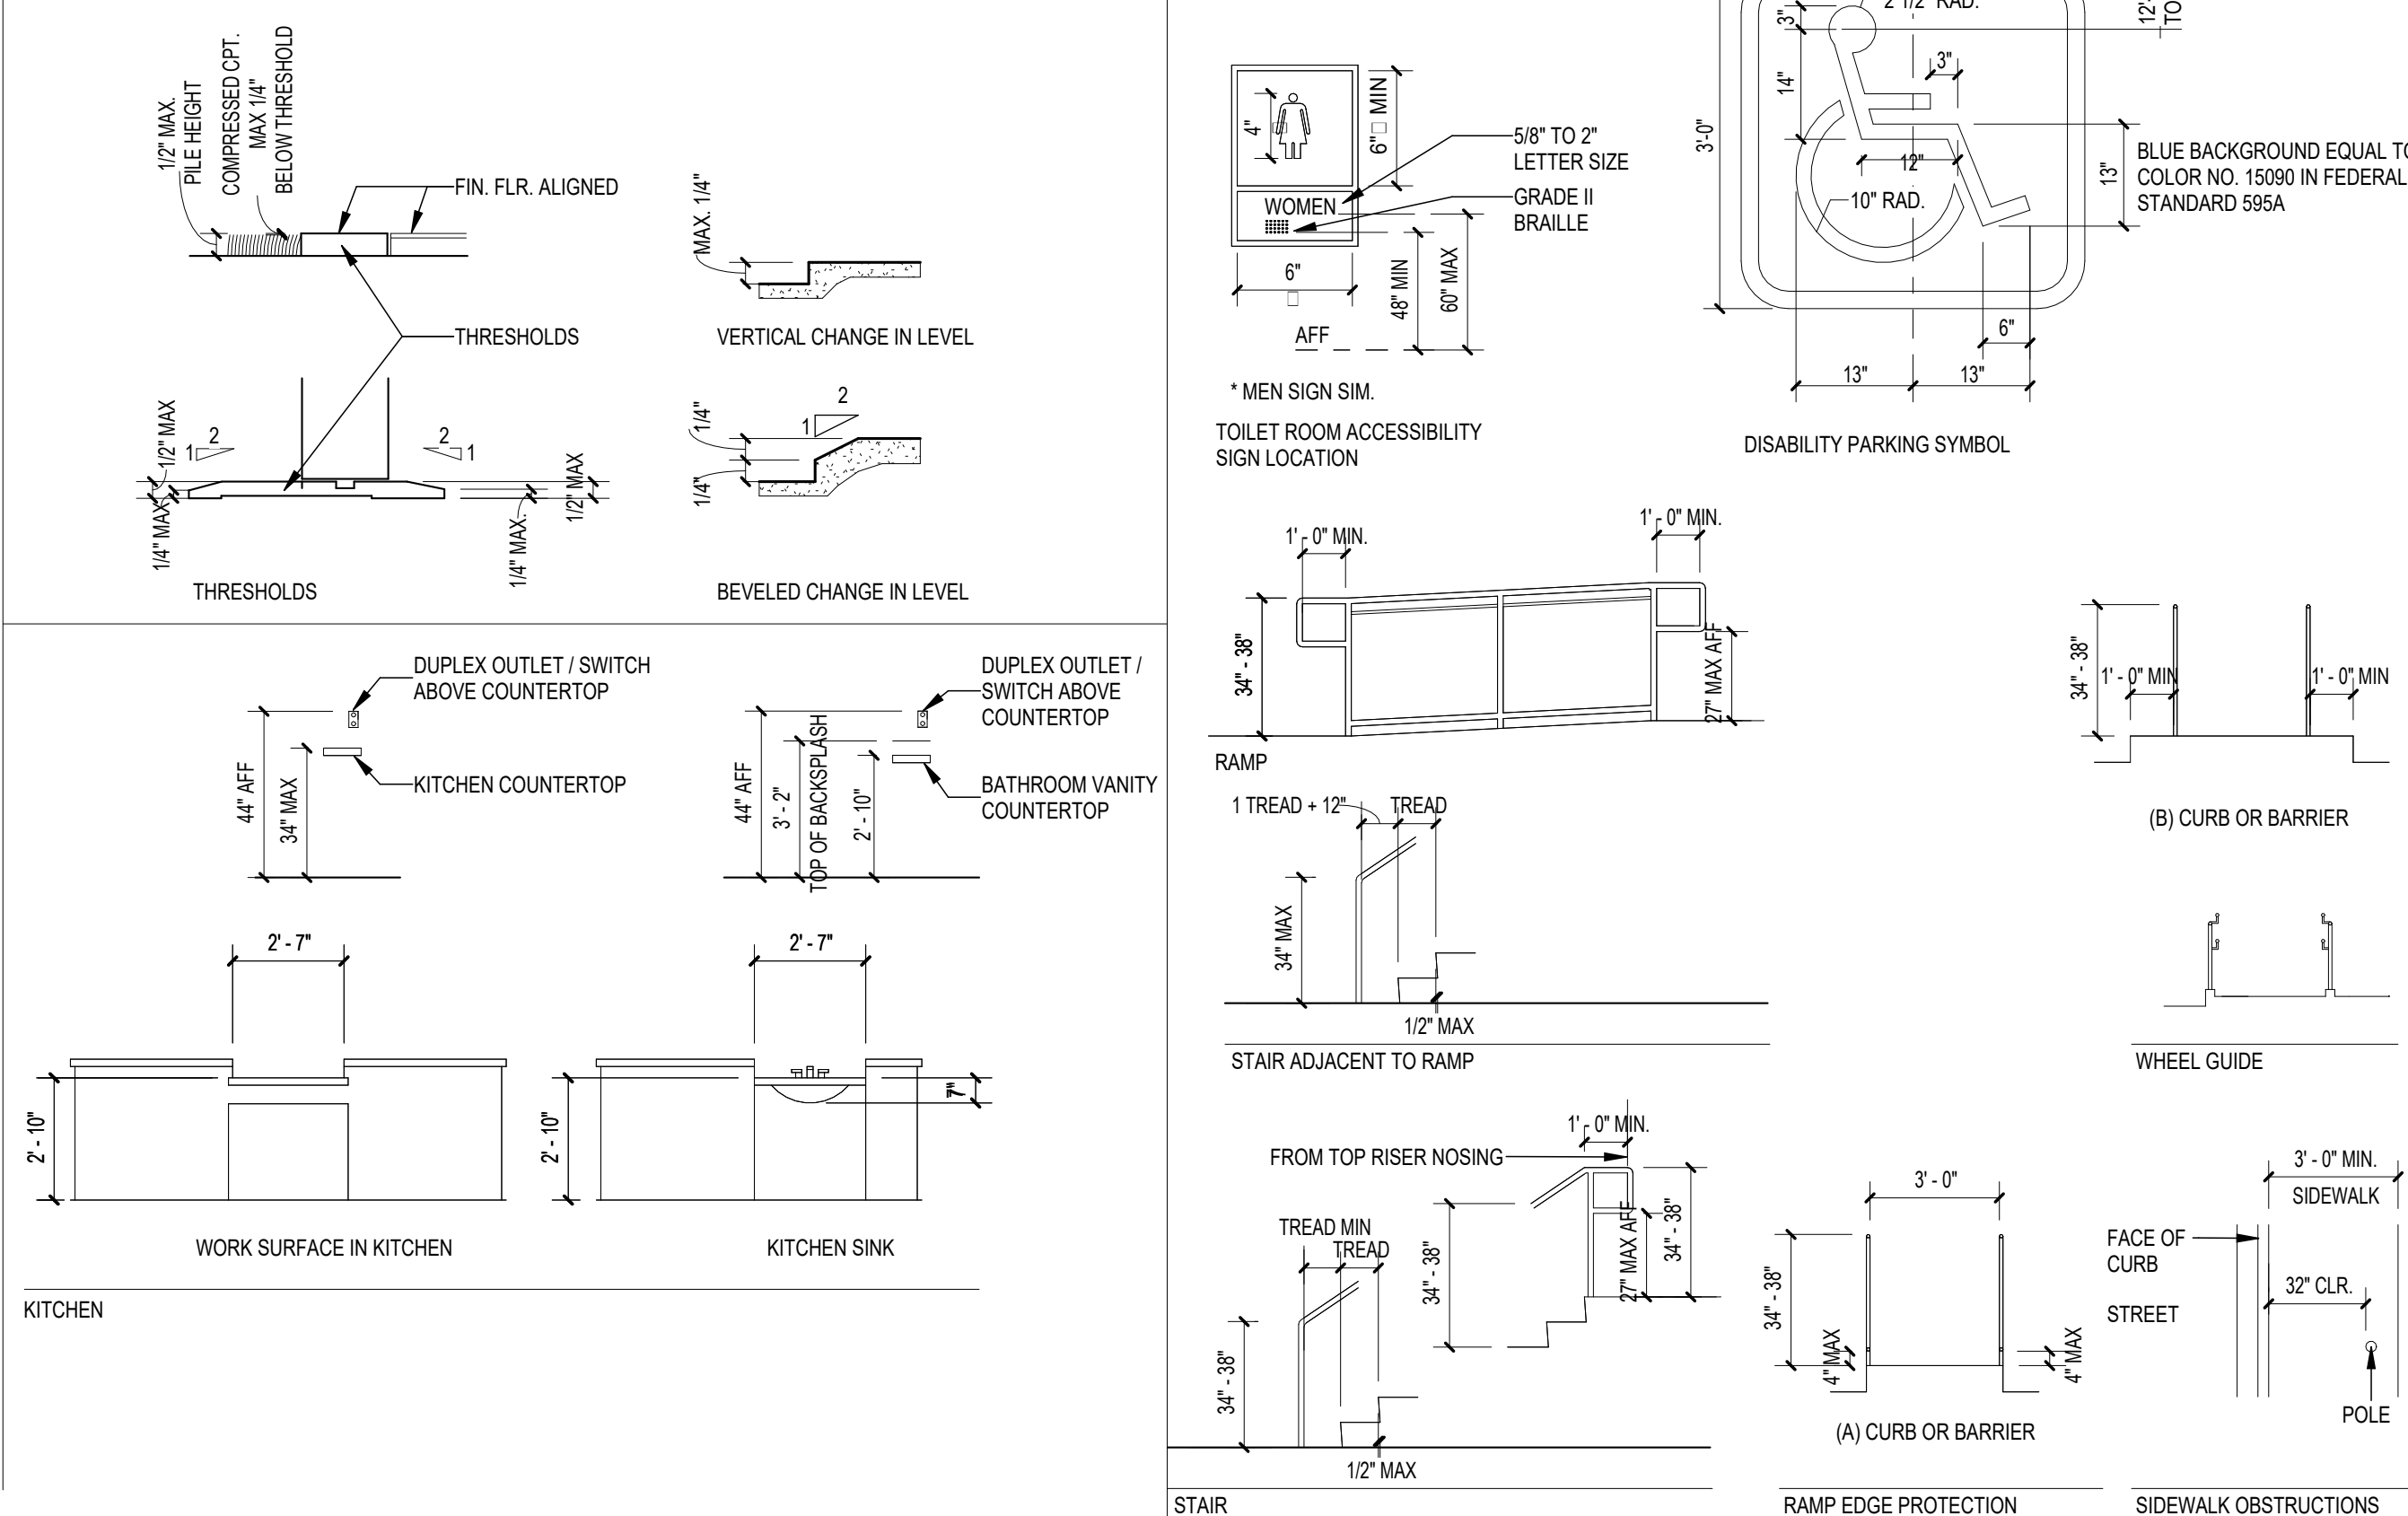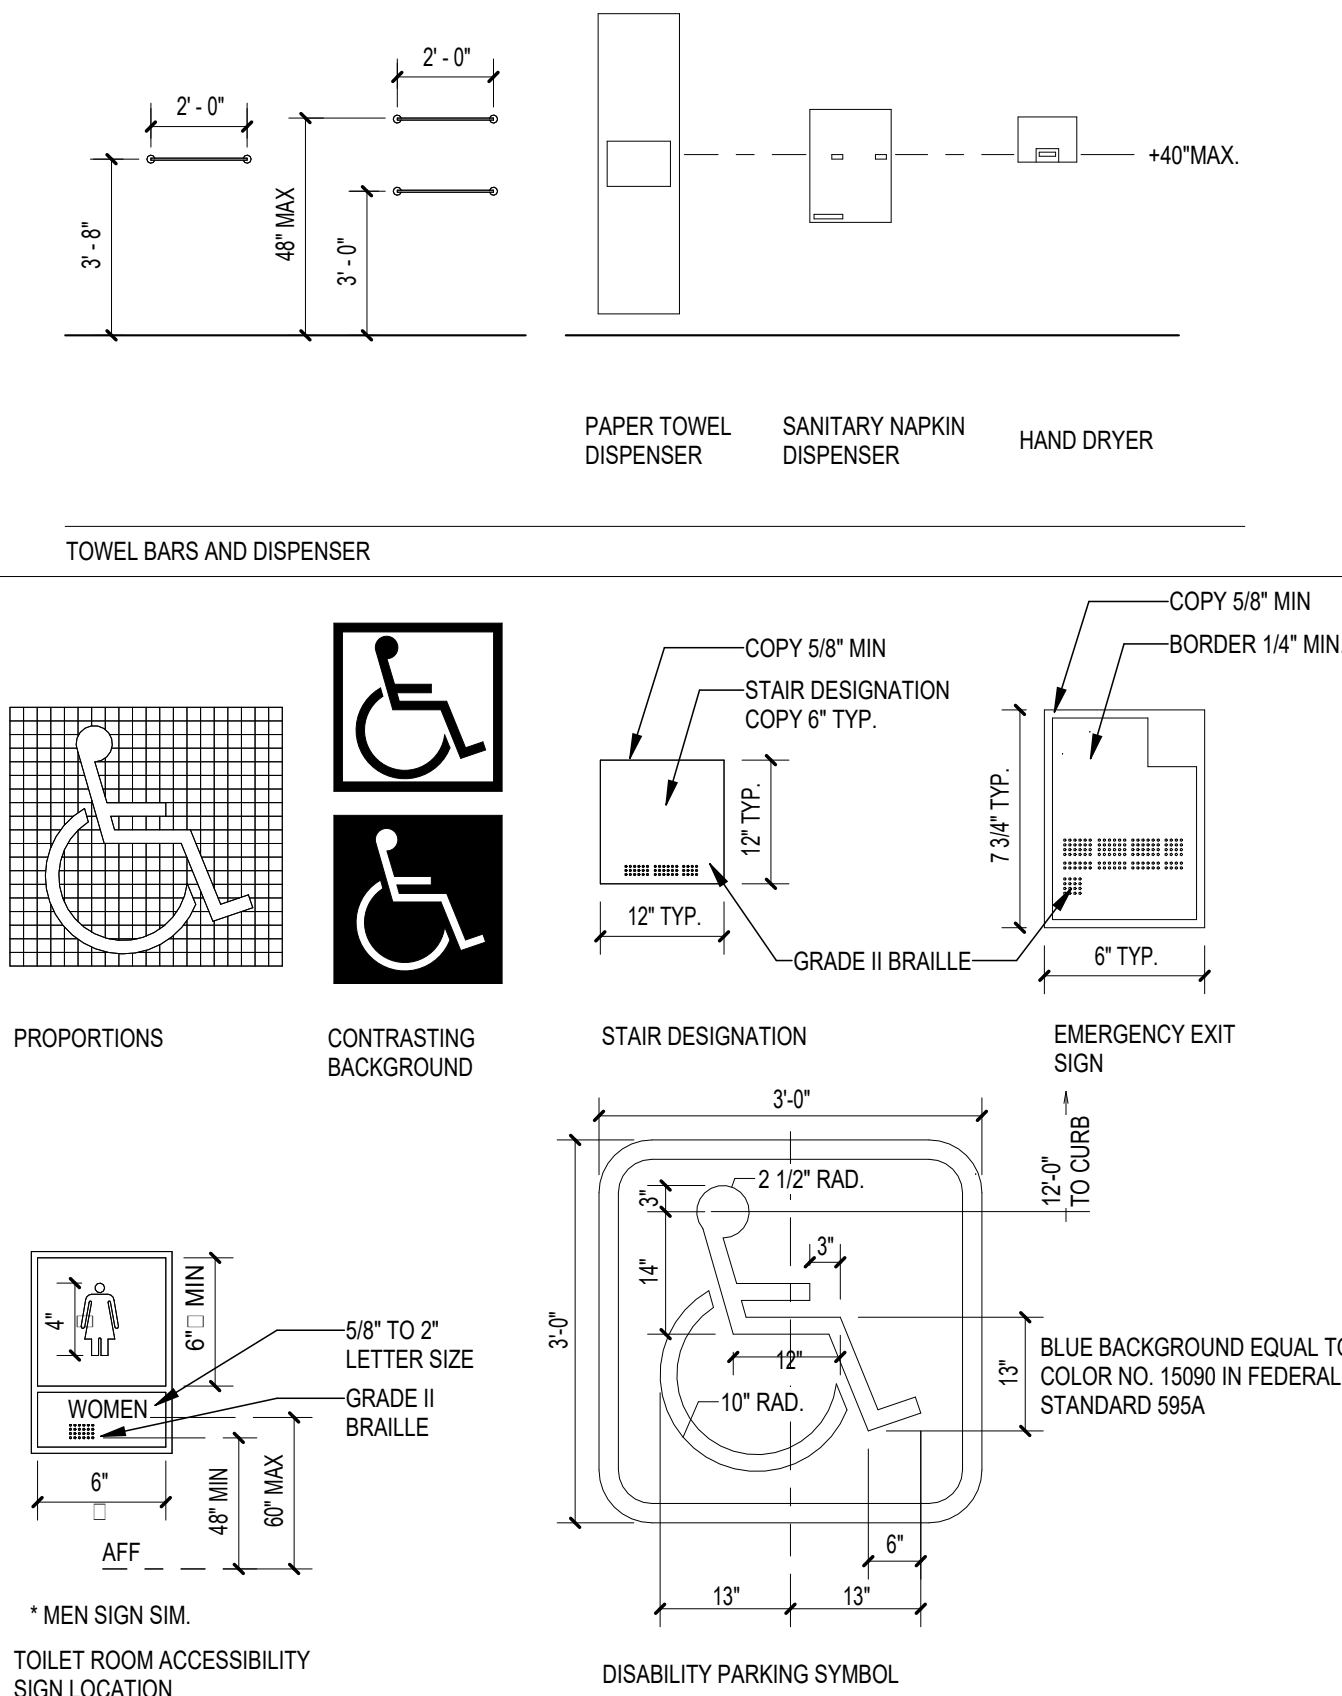



U:\042024\230304 PM

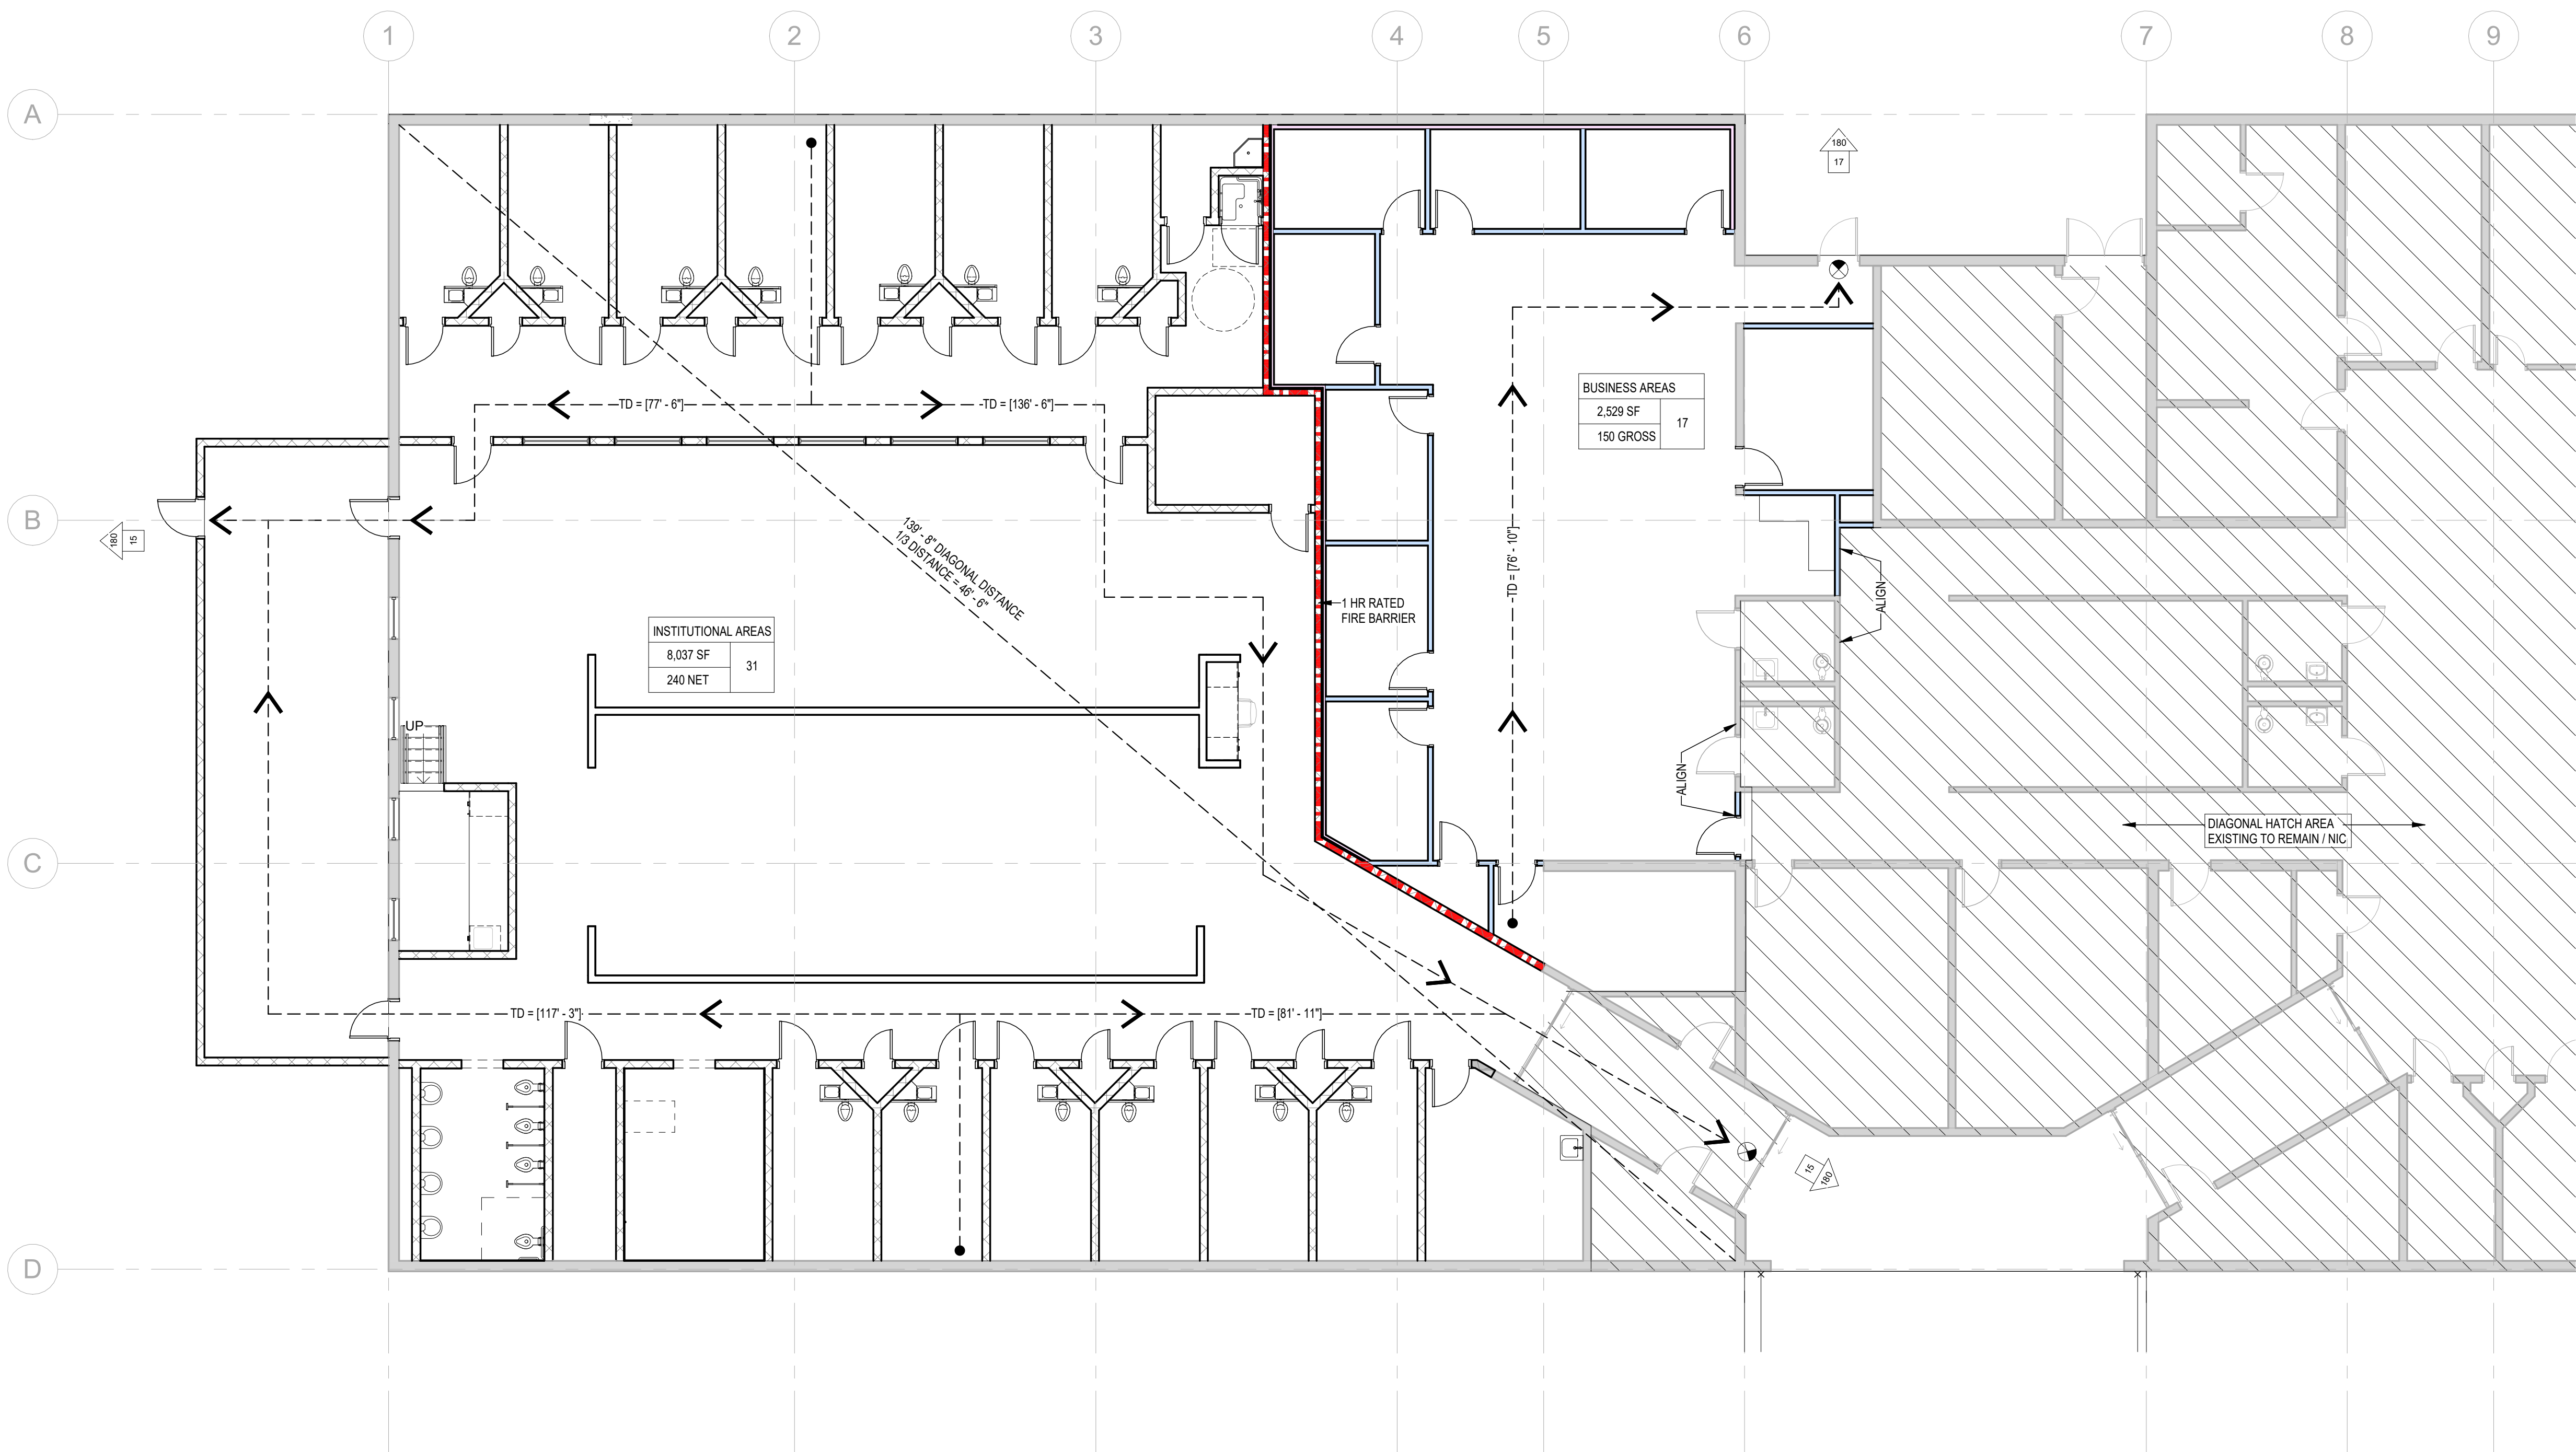

- GENERAL SHEET NOTES:
1. FIRE EXTINGUISHERS SHALL BE PROVIDED IN ACCORDANCE WITH NFPA 10 REQUIREMENTS AND AS DIRECTED BY LOCAL BUILDING OFFICIAL.
  2. SEE FLOOR PLAN FOR FIRE-RATED WALL LOCATIONS.
  3. REFER TO DOOR, WINDOW, AND HARDWARE SCHEDULES FOR DOOR AND WINDOW FIRE RATING REQUIREMENTS AND EGRESS HARDWARE REQUIREMENTS.
  4. SEE ELECTRICAL DRAWINGS FOR MORE INFORMATION ON EXIT SIGNS, EMERGENCY LIGHTS, FIRE ALARM AND SMOKE DETECTORS.
  5. ALL FURNITURE AND EQUIPMENT SHOWN ARE FOR REFERENCE ONLY.
  6. STANDARD EGRESS CAPACITY OF EXIT THROUGH 36\"/>

THE  
**LUNZ**  
GROUP

## HCSO MENTAL HEALTH POD

520 N FALKENBURG ROAD  
TAMPA, FLORIDA 33619

## LIFE SAFETY PLAN - JIA

#	ISSUED FOR	DATE
	DESIGN DEVELOPMENT	06.20.24
	75% CD (OWNER APPROVAL)	07.26.24
	PERMIT/BID	08.30.24
	ADDENDUM #4	09.04.24

DRAWN BY: --  
REVIEW BY: Project Manager  
THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED


58 Lake Morton Dr  
Lakeland, FL 33801  
P 883.682.1162  
F 883.687.6346  
lic. AR04778

lunz.com

24001.01

LS-101A



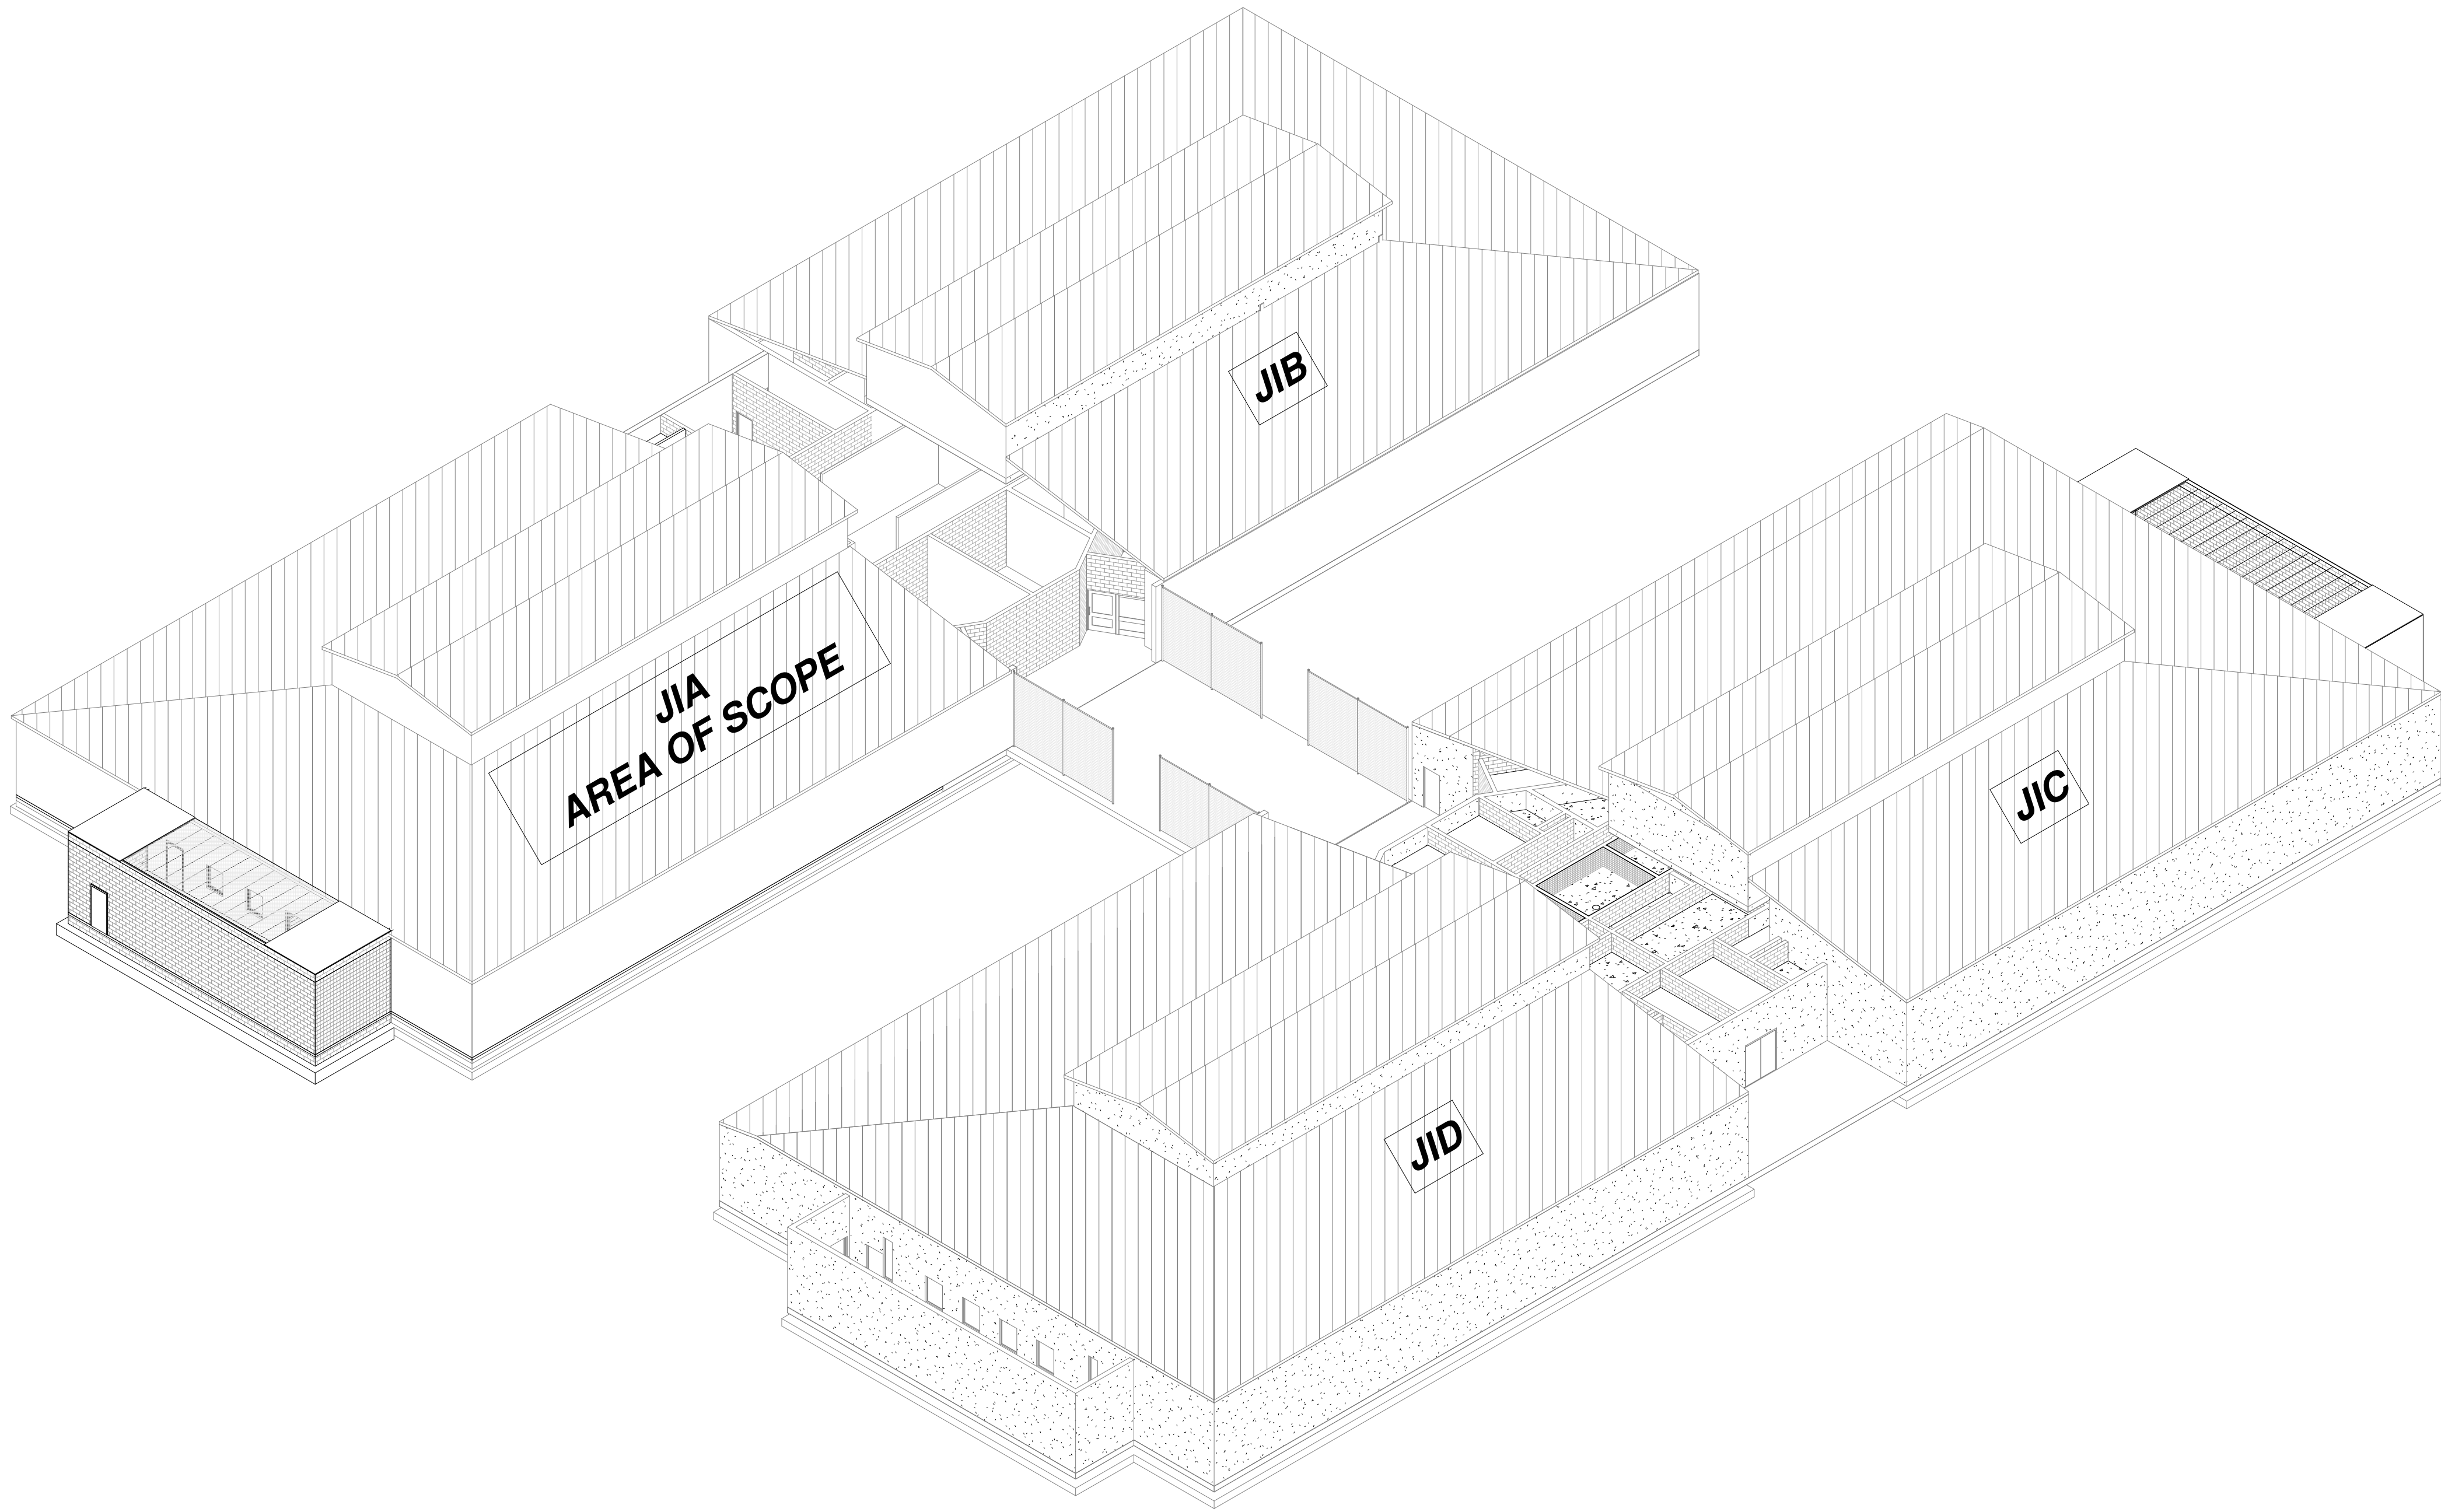

SHEET INDEX - JIA				
SHT NO#	SHEET NAME	REVIEW SET 08.14.2024	PERMIT BID SET 08.30.2024	ADDENDUM # 09.04.2024
S-001A	COVER SHEET - JIA	•	•	•
S-002	STRUCTURAL GENERAL NOTES AND ABBREVIATIONS	•	•	•
S-003	COMPONENTS AND CLADDING	•	•	•
S-100A	DEMOLITION PLAN - JIA	•	•	•
S-101A	GROUND FLOOR PLAN - JIA	•	•	•
S-102A	SECOND FLOOR FRAMING PLAN - JIA	•	•	•
S-201	SCHEDULES & TYPICAL DETAILS	•	•	•
S-301	TYPICAL FOUNDATION DETAILS	•	•	•
S-302	TYPICAL MASONRY DETAILS	•	•	•
S-303	SECTIONS & DETAILS	•	•	•

1 ISOMETRIC VIEW - JIA

ISOMETRIC VIEW IS A GRAPHICAL REPRESENTATION ONLY AND SHALL NOT BE USED FOR CONSTRUCTION PURPOSES

THE  
LUNZ  
GROUP



George F. Young, Inc.

1408 N WESTSHORE BLVD, TAMPA, FL 33607  
PHONE (727) 822-4317 WWW.GEORGEFYOUNG.COM  
ENGINEERING CERTIFICATE OF AUTHORIZATION NUMBER 21  
CIVIL, TRANSPORTATION, SUBSURFACE & STRUCTURAL ENGINEERING  
ECOLOGY | GIS | PLANNING | SURVEYING  
ST. PETERSBURG • LAKEWOOD RANGE • TAMPA • GAINSVILLE • LAKE WALES  
PUNTA GORDA

HCSO MENTAL HEALTH POD - JIA

2310 N. FALKENBURG ROAD  
TAMPA, FLORIDA 33619

COVER SHEET - JIA

NOT FOR CONSTRUCTION		
#	ISSUED FOR	DATE
	REVIEW	08.14.2024
	PERMIT/BID	08.30.2024
	ADDENDUM #4	09.04.2024

DRAWN BY: GFY  
REVIEW BY: YA / DD

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P 883.682.1882  
F 883.687.6346  
tsc 4084778

lunz.com


24000700TT

S-001A








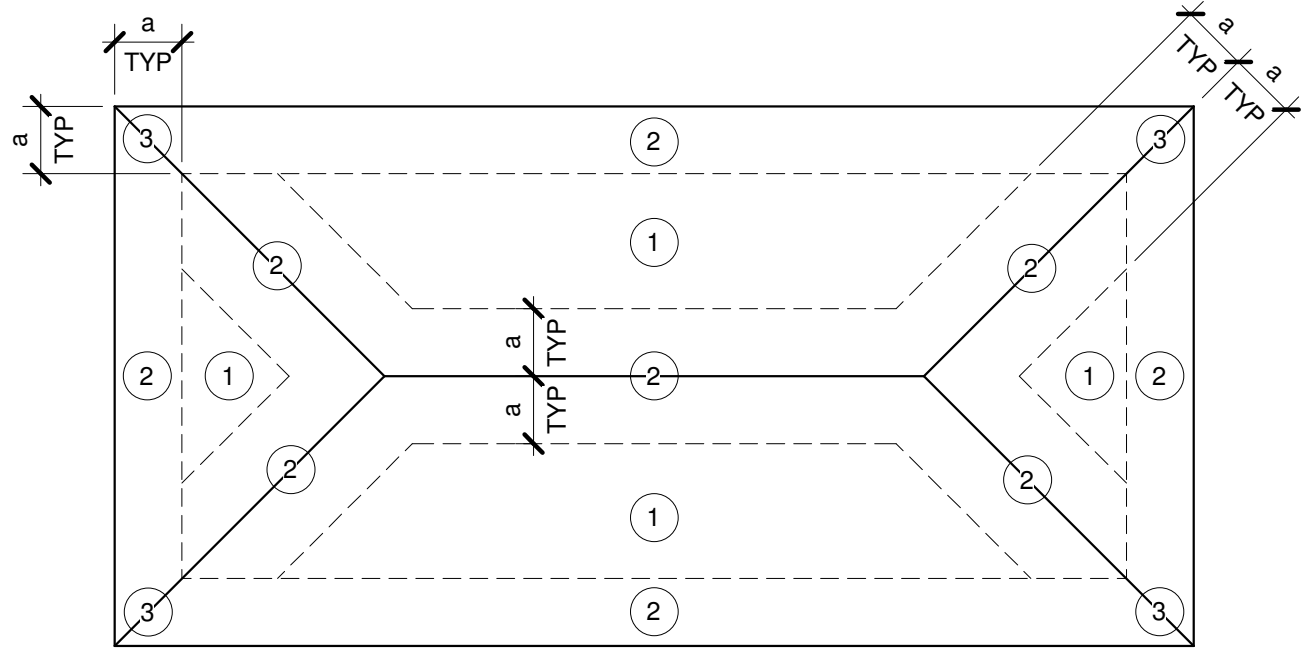

ROOF UPLIFT DIAGRAM  
COMPONENT & CLADDING

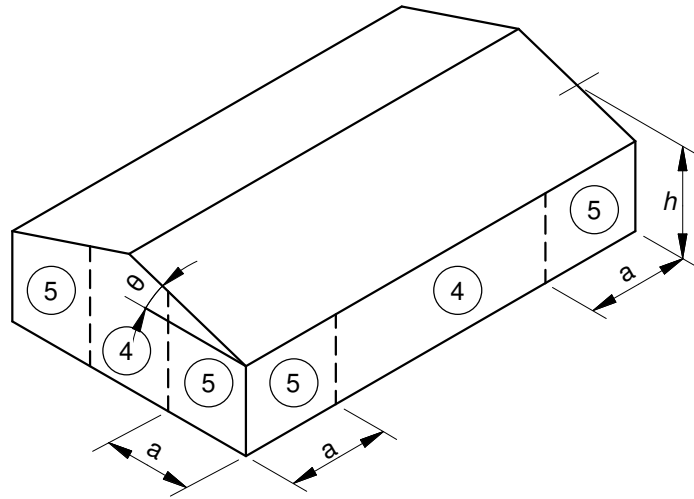

COMPONENT & CLADDING  
WINDOW & DOOR  
WIND PRESSURES

COMPONENTS & CLADDING NOMINAL WIND PRESSURES											
(PER ASCE 7-22)											
ULTIMATE WIND SPEED, $V_{ult}$		149 mph		NOMINAL WIND SPEED, $V_{asd}$		115.4 mph		EDGE DISTANCE, "a"		8'-9"	
EXPOSURE CATEGORY		C		RISK CATEGORY		III		ROOF SLOPE		4/12	
				DIRECTIONALITY FACTOR, $K_d$		0.85					
COMPONENT LOCATION				POSITIVE PRESSURES (psf)				NEGATIVE PRESSURES (psf)			
EFFECTIVE AREA				10 ft²	20 ft²	50 ft²	100 ft²	10 ft²	20 ft²	50 ft²	100 ft²
ROOFS	ZONE 1			25.8	24.4	22.7	21.3	-65.8	-63.1	-59.6	-56.9
	ZONE 2			25.8	24.4	22.7	21.3	-79.1	-73.8	-66.7	-61.4
	ZONE 3			25.8	24.4	22.7	21.3	-136.9	-124.9	-109.0	-96.9
WALLS	ZONE 4: INTERIOR			52.5	50.1	47.0	44.6	-56.9	-54.5	-51.4	-49.1
	ZONE 5: EXTERIOR			52.5	50.1	47.0	44.6	-70.2	-65.5	-59.3	-54.5

- NOTES:
- PRESSURE VALUES IN ABOVE TABLE ARE BASED ON THE PARAMETERS LISTED AT THE TOP OF THE TABLE.
  - PRESSURE VALUES IN ABOVE TABLE ARE FOR A FULLY ENCLOSED CONDITION WITH AN INTERNAL PRESSURE COEFFICIENT OF ±0.18.
  - GLAZED OPENINGS SHALL BE PROTECTED IN ACCORDANCE WITH SECTION 26.10.3 OF ASCE 7.
  - POSITIVE OR NEGATIVE DESIGN PRESSURES SHALL NOT BE TAKEN LESS THAN 16 psf (ULTIMATE VALUE).
  - PRESSURES IN ABOVE TABLE ARE ULTIMATE VALUES. WHERE TESTING IS BASED ON NOMINAL (ALLOWABLE) PRESSURES, ABOVE VALUES ARE PERMITTED TO BE MULTIPLIED BY 0.60 FOR THE PURPOSE OF SUCH TESTING.

THE  
LUNZ  
GROUP

George F. Young, Inc.

1408 N WESTSHORE BLVD, TAMPA, FL 33607

PHONE (727) 822-4317 WWW.GEORGEFYOUNG.COM

ENGINEERING CERTIFICATE OF AUTHORIZATION NUMBER 21

CIVIL, TRANSPORTATION, SUBSURFACE & STRUCTURAL ENGINEERING

ECOLOGICAL | GIS | PLANNING | SURVEYING

ST. PETERSBURG ■ LAKEWOOD RANCH ■ TAMPA ■ GAINESVILLE ■ LAKE WALES

■ PUNTA GORDA

HCSO MENTAL HEALTH POD - JIA

2310 N. FALKENBURG ROAD  
TAMPA, FLORIDA 33619

COMPONENTS AND CLADDING

NOT FOR CONSTRUCTION		
#	ISSUED FOR	DATE
	REVIEW	08.14.2024
	PERMIT/BID	08.30.2024
	ADDENDUM #4	09.04.2024

DRAWN BY: GFY  
REVIEW BY: YA / DD

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P 888.682.1882  
F 888.687.6346  
or 888.478

lunz.com

24000700TT

S-003



1408 N WESTSHORE BLVD, TAMPA, FL 33607  
PHONE (727) 822-4317 WWW.GEORGEFYOUNG.COM  
ENGINEERING CERTIFICATE OF AUTHORIZATION NUMBER 21  
CIVIL, TRANSPORTATION, SUBSURFACE & STRUCTURAL ENGINEERING  
ECOLOGY | GIS | PLANNING | SURVEYING  
ST. PETERSBURG ■ LAKEWOOD RANGE ■ TAMPA ■ GAINESVILLE ■ LAKE WALES  
■ PUNTA GORDA

2310 N. FALKENBURG ROAD  
TAMPA, FLORIDA 33619


# DEMOLITION PLAN - JIA

NOT FOR CONSTRUCTION		
#	ISSUED FOR	DATE
	REVIEW	08.14.2024
	PERMIT/BID	08.30.2024
	ADDENDUM #4	09.04.2024

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

lunz.com

S-100A

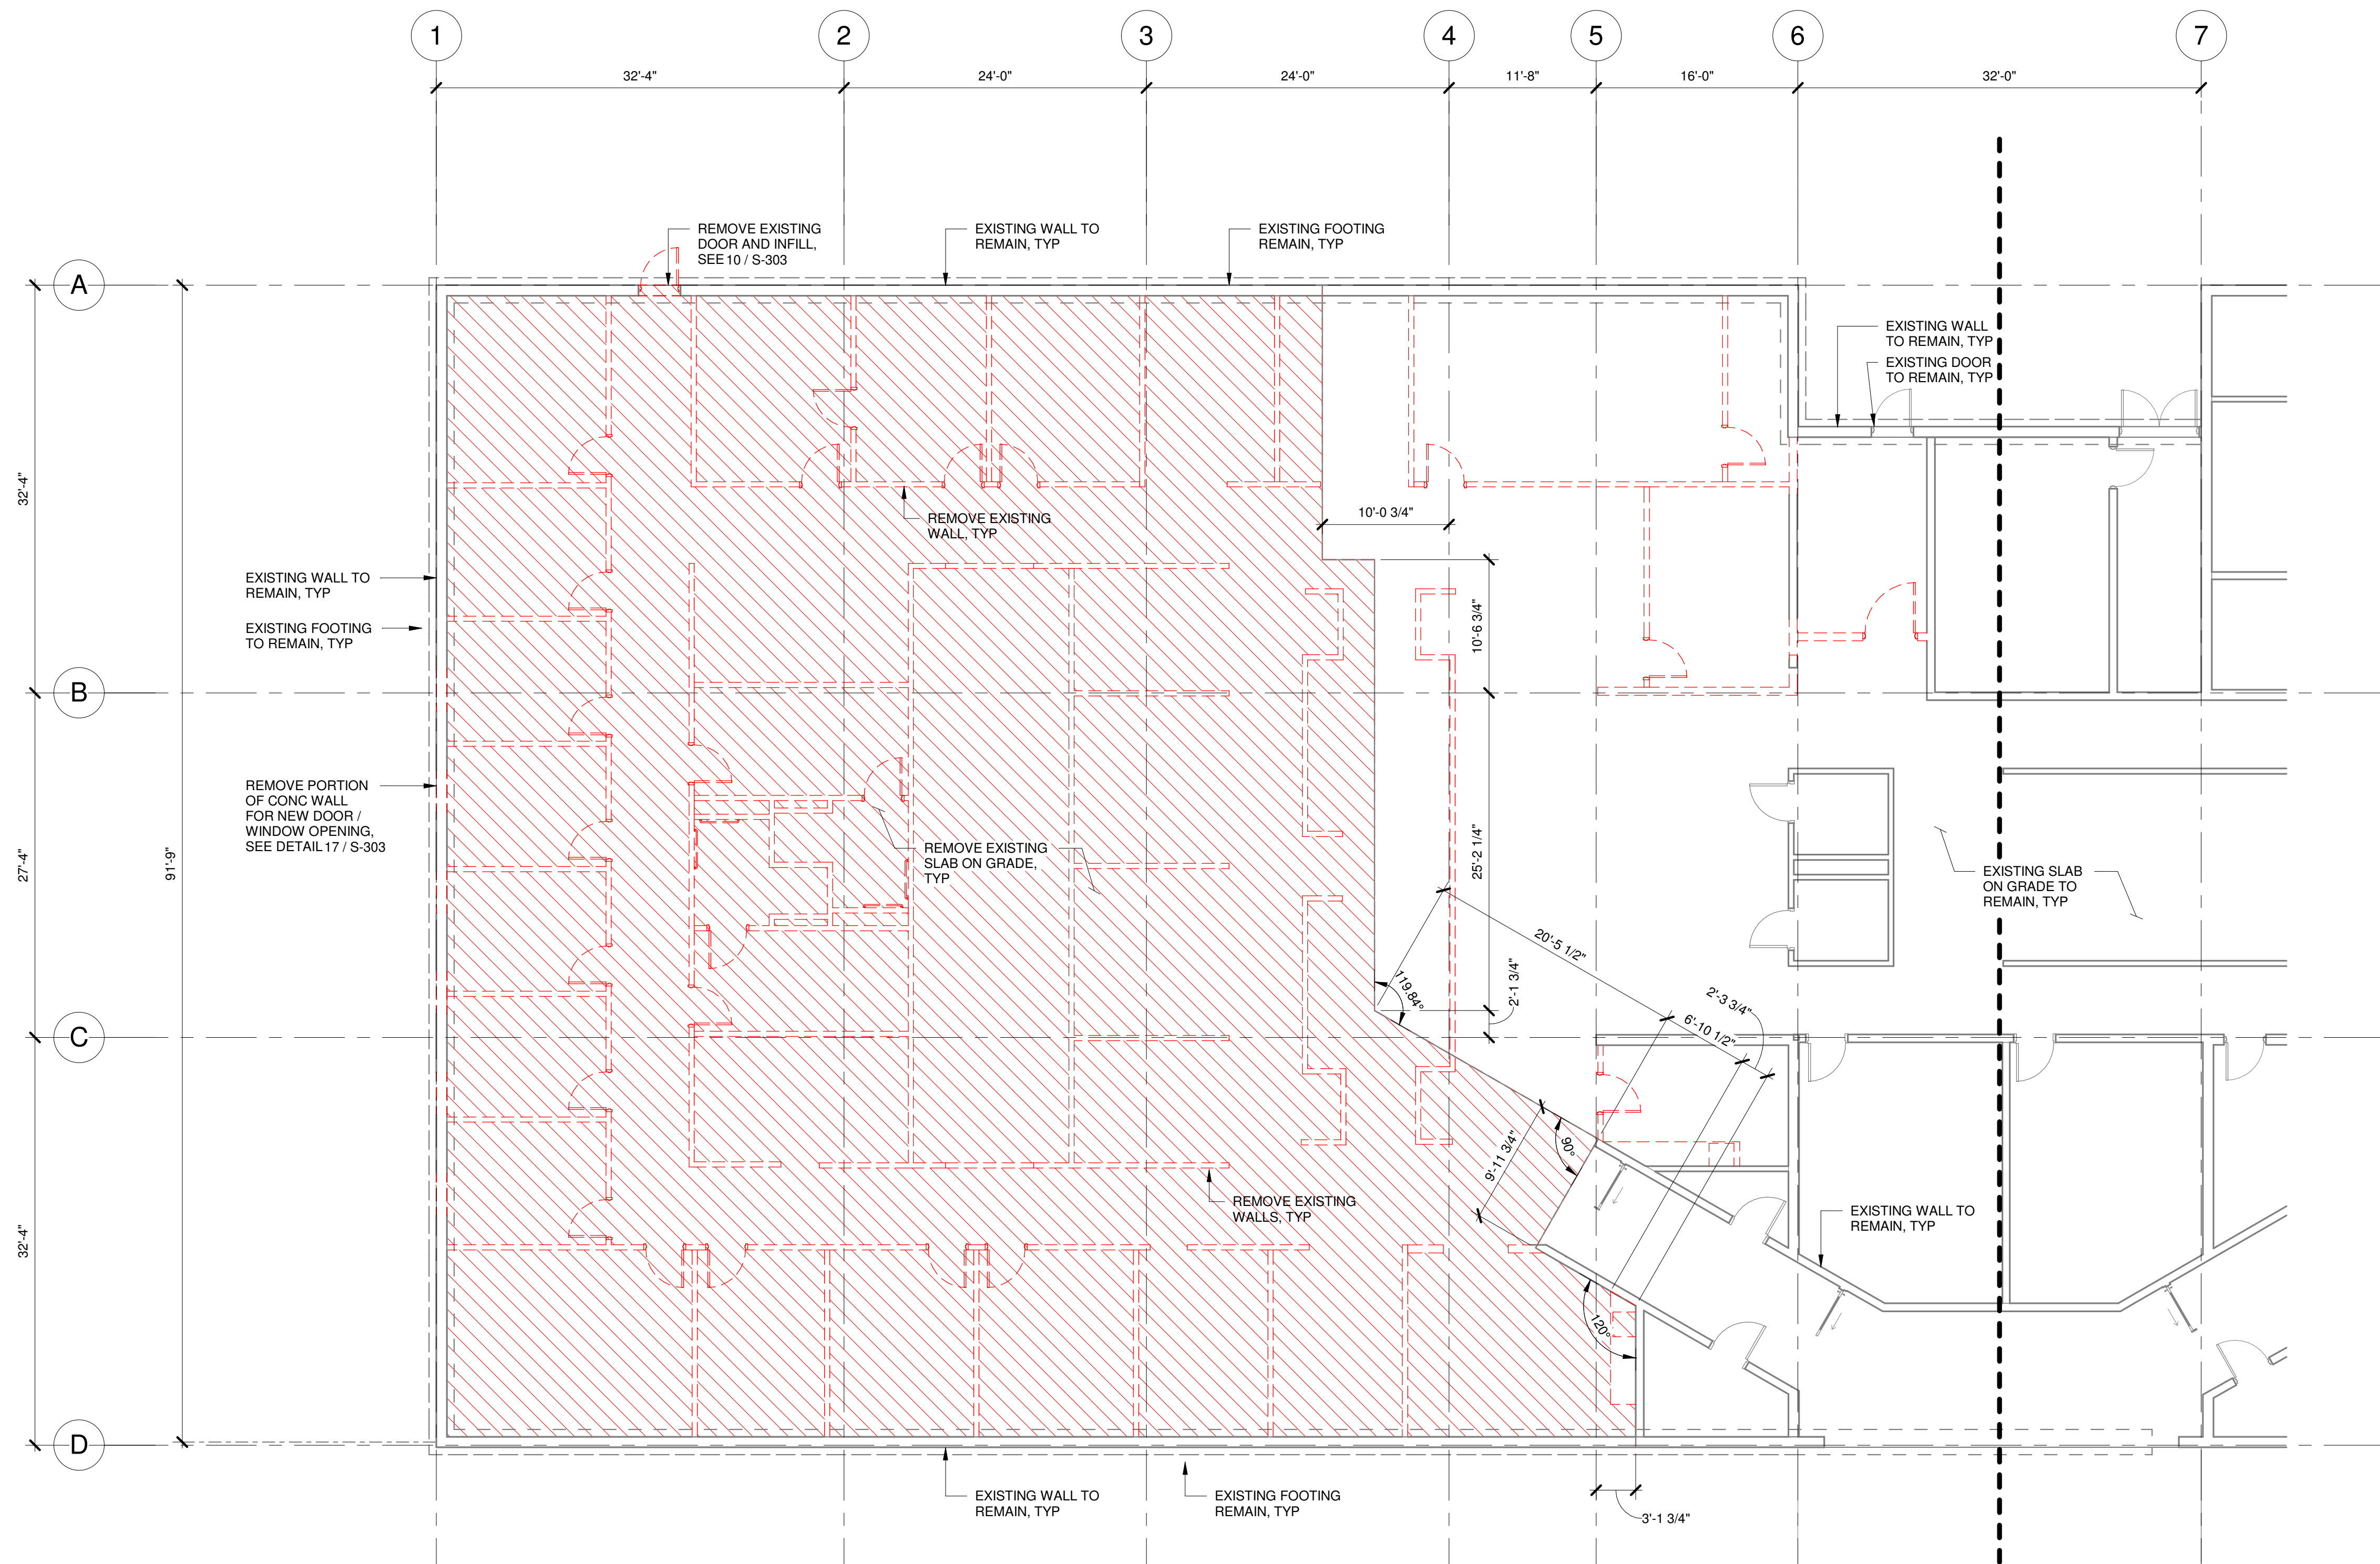
$$3'' = 1'-0''$$

1. CONTRACTOR SHALL REMOVE EXISTING ITEMS AS REQUIRED BY ARCHITECTURAL CONSTRUCTION DOCUMENTS TO COMPLETE THE JOB.
2. NOT ALL ITEMS TO BE DEMOLISHED ARE SHOWN ON THE PLAN. CONTRACTOR SHALL BE RESPONSIBLE FOR PERFORMING A WALK-THRU OF THE SITE AND BECOME FAMILIAR WITH ALL EXISTING CONDITIONS FOR IDENTIFYING POSSIBLE CRITICAL ITEMS, NOT ADDRESSED OR INCORRECTLY ADDRESSED, WHICH REQUIRE REMOVAL/RELOCATION. NOTIFY EOR BEFORE ANY ADDITIONAL CMU WALLS ARE PROPOSED TO BE REMOVED, NOT INDICATED ON PLANS.
3. CONTRACTOR SHALL ALSO CHECK AND IDENTIFY ALL EXISTING WATER, SANITARY AND ELECTRIC LINES WHICH ARE TO REMAIN AND BE PROTECTED FROM DAMAGE DURING DEMOLITION AND ALTERATION OF WORK.
4. GC TO PERFORM X-RAY OF EXISTING EXTERIOR WALL PRIOR TO DEMOLITION. X-RAY TO BE PROVIDED TO OWNER, ARCHITECT & STRUCTURAL ENGINEER FOR REVIEW.

5. THE DEMOLITION WORK SHALL INVOLVE INTERVENTIONS IN AREA OUTSIDE OF THE IMMEDIATE SCOPE OF WORK, INCLUDING WORK ABOVE AND/OR BELOW THE FLOOR LEVEL WITHIN THE SCOPE. IT SHALL REQUIRE WORK INVOLVING REMOTE UTILITY LINES (FIRE SPRINKLERS, PLUMBING, MECHANICAL, ELECTRICAL, COMMUNICATIONS, ETC.) ANY SUCH WORK SHALL BE INCLUSIVE OF ALL STRUCTURES, UTILITIES, FINISHES AND EQUIPMENT REQUIRED TO RESTORE THE AREA TO FULLY OPERATIONAL CONDITION. THE WORK SHALL BE IN COMPLIANCE WITH ALL APPLICABLE BUILDING AND SAFETY CODE REQUIREMENTS AND TO MEET OWNER'S APPROVAL. ALL WORK AS DESCRIBED IN THIS NOTE SHALL BE INCLUDED AS PART OF THE BASE CONTRACT PRICE.





1408 N WESTSHORE BLVD, TAMPA, FL 33607  
PHONE (727) 822-4317 [WWW.GEORGEFYOUNG.COM](http://WWW.GEORGEFYOUNG.COM)  
ENGINEERING CERTIFICATE OF AUTHORIZATION NUMBER 21  
CIVIL, TRANSPORTATION, SUBSURFACE & STRUCTURAL ENGINEERING  
ECOLOGY | GIS | PLANNING | SURVEYING  
ST. PETERSBURG ■ LAKEWOOD RANGE ■ TAMPA ■ GAINESVILLE ■ LAKE WALES  
■ PUNTA GORDA

2310 N. FALKENBURG ROAD  
TAMPA, FLORIDA 33619

# GROUND FLOOR PLAN - JIA

[illegible]

DRAWN BY: GFY  
REVIEW BY: YA / DD


THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
p 863.682.1882  
f 863.687.6346  
lic. AR94778

lunz.com

24000700TT

# S-101A

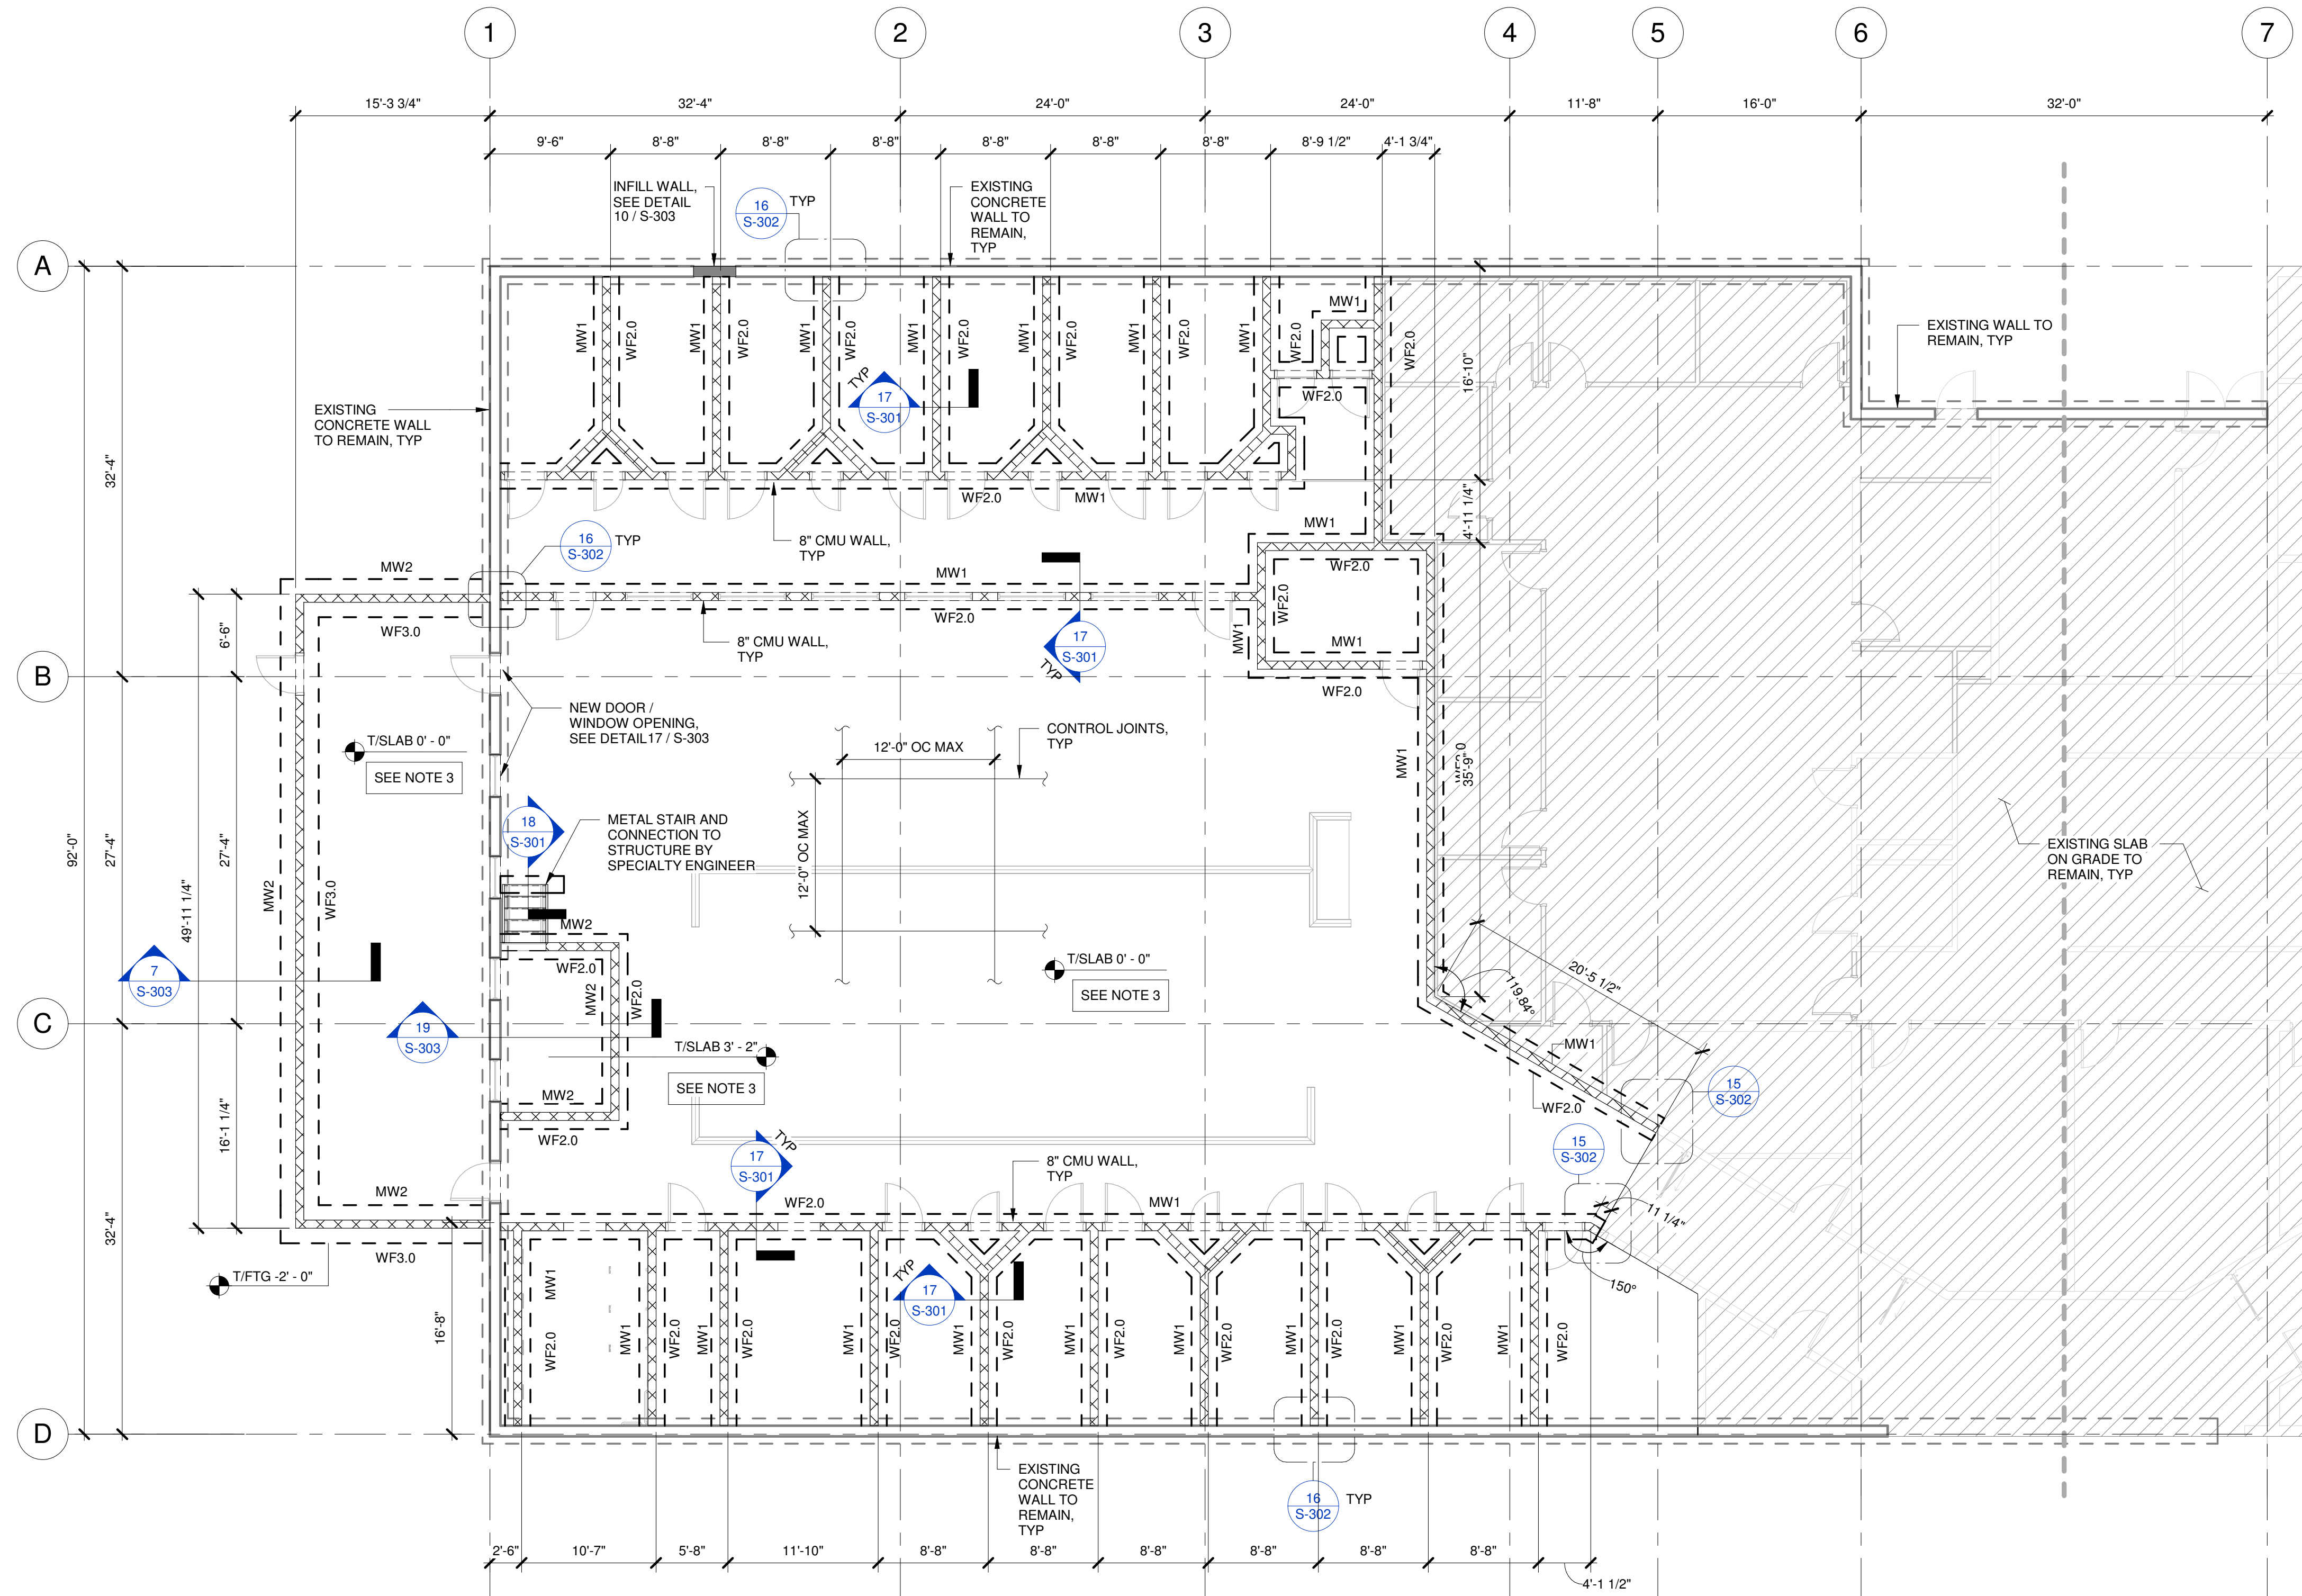




**1** GROUND FLOOR PLAN - JIA  
1/8" = 1'-0"

**FOUNDATION NOTES:**

1. FINISH FLOOR (SLAB ON GRADE) ELEVATION 0'-0", UNLESS NOTED ON PLAN.
2. VERIFY DIMENSIONS AND ELEVATIONS WITH ARCHITECTURAL DRAWINGS BEFORE COMMENCING CONSTRUCTION.
3. 5" THICK SLAB (UNO) W/ 4% DOSE OF EUCLID CONEX. PROVIDE 6x6xW2.9xW2.9 WWF IN SHEETS NOT ROLLS CHAINED TO TOP OF SLAB. PROVIDE TOOLED OR SAW-CUT CONTROL JOINTS (CJ). SEE TYPICAL DETAILS & GENERAL NOTES.
4. DROP FOOTING BELOW UNDERGROUND UTILITIES ENTERING THE BUILDING. COORDINATE LOCATIONS OF UTILITIES WITH SITE OR CIVIL DRAWINGS. SEE TYPICAL DETAILS FOR HOW TO STEP FOUNDATION.
5. "TE" INDICATES A THICKENED SLAB EDGE. SEE TYPICAL DETAILS FOR TYPES AND REINFORCING.
6. "MW#X" INDICATES CONCRETE MASONRY WALL. ALL WALLS ARE **MW1** UNO. SEE CMU SCHEDULE FOR SIZE & REINFORCEMENT.
7. "FX-X" AND "WF-X-X" INDICATES SPREAD FOOTING AND WALL FOOTING RESPECTIVELY. REFER TO FOUNDATION SCHEDULE ON THIS SHEET FOR SIZES AND REINFORCEMENT.
8. FOR OPENINGS LARGER THAN 9'-0" GROUT END BLOCKS SOLID W/ #6 BARS IN EACH BLOCK CELL.


### LEGEND

LEGEND	
	INDICATES CMU WALL (MW-#), SEE SCHEDULE
	INDICATES CIP INFILL WALL
	INDICATES EXISTING SLAB ON GRADE, REFER ARCH DWGS

## FOUNDATION SCHEDULE

FOUNDATION SCHEDULE								
MARK	LENGTH	FTG WIDTH	THICKNESS	BOTTOM REINFORCING LW	BOTTOM REINFORCING SW	TOP REINFORCING LW	TOP REINFORCING SW	COMMENTS
WF2.0	CONT	2'-0"	1'-4"	(3) #5	#5@12" OC	-	-	
WF3.0	CONT	3'-0"	2'-0"	(4) #5	#5@12" OC	(4) #5	#5@12" OC	



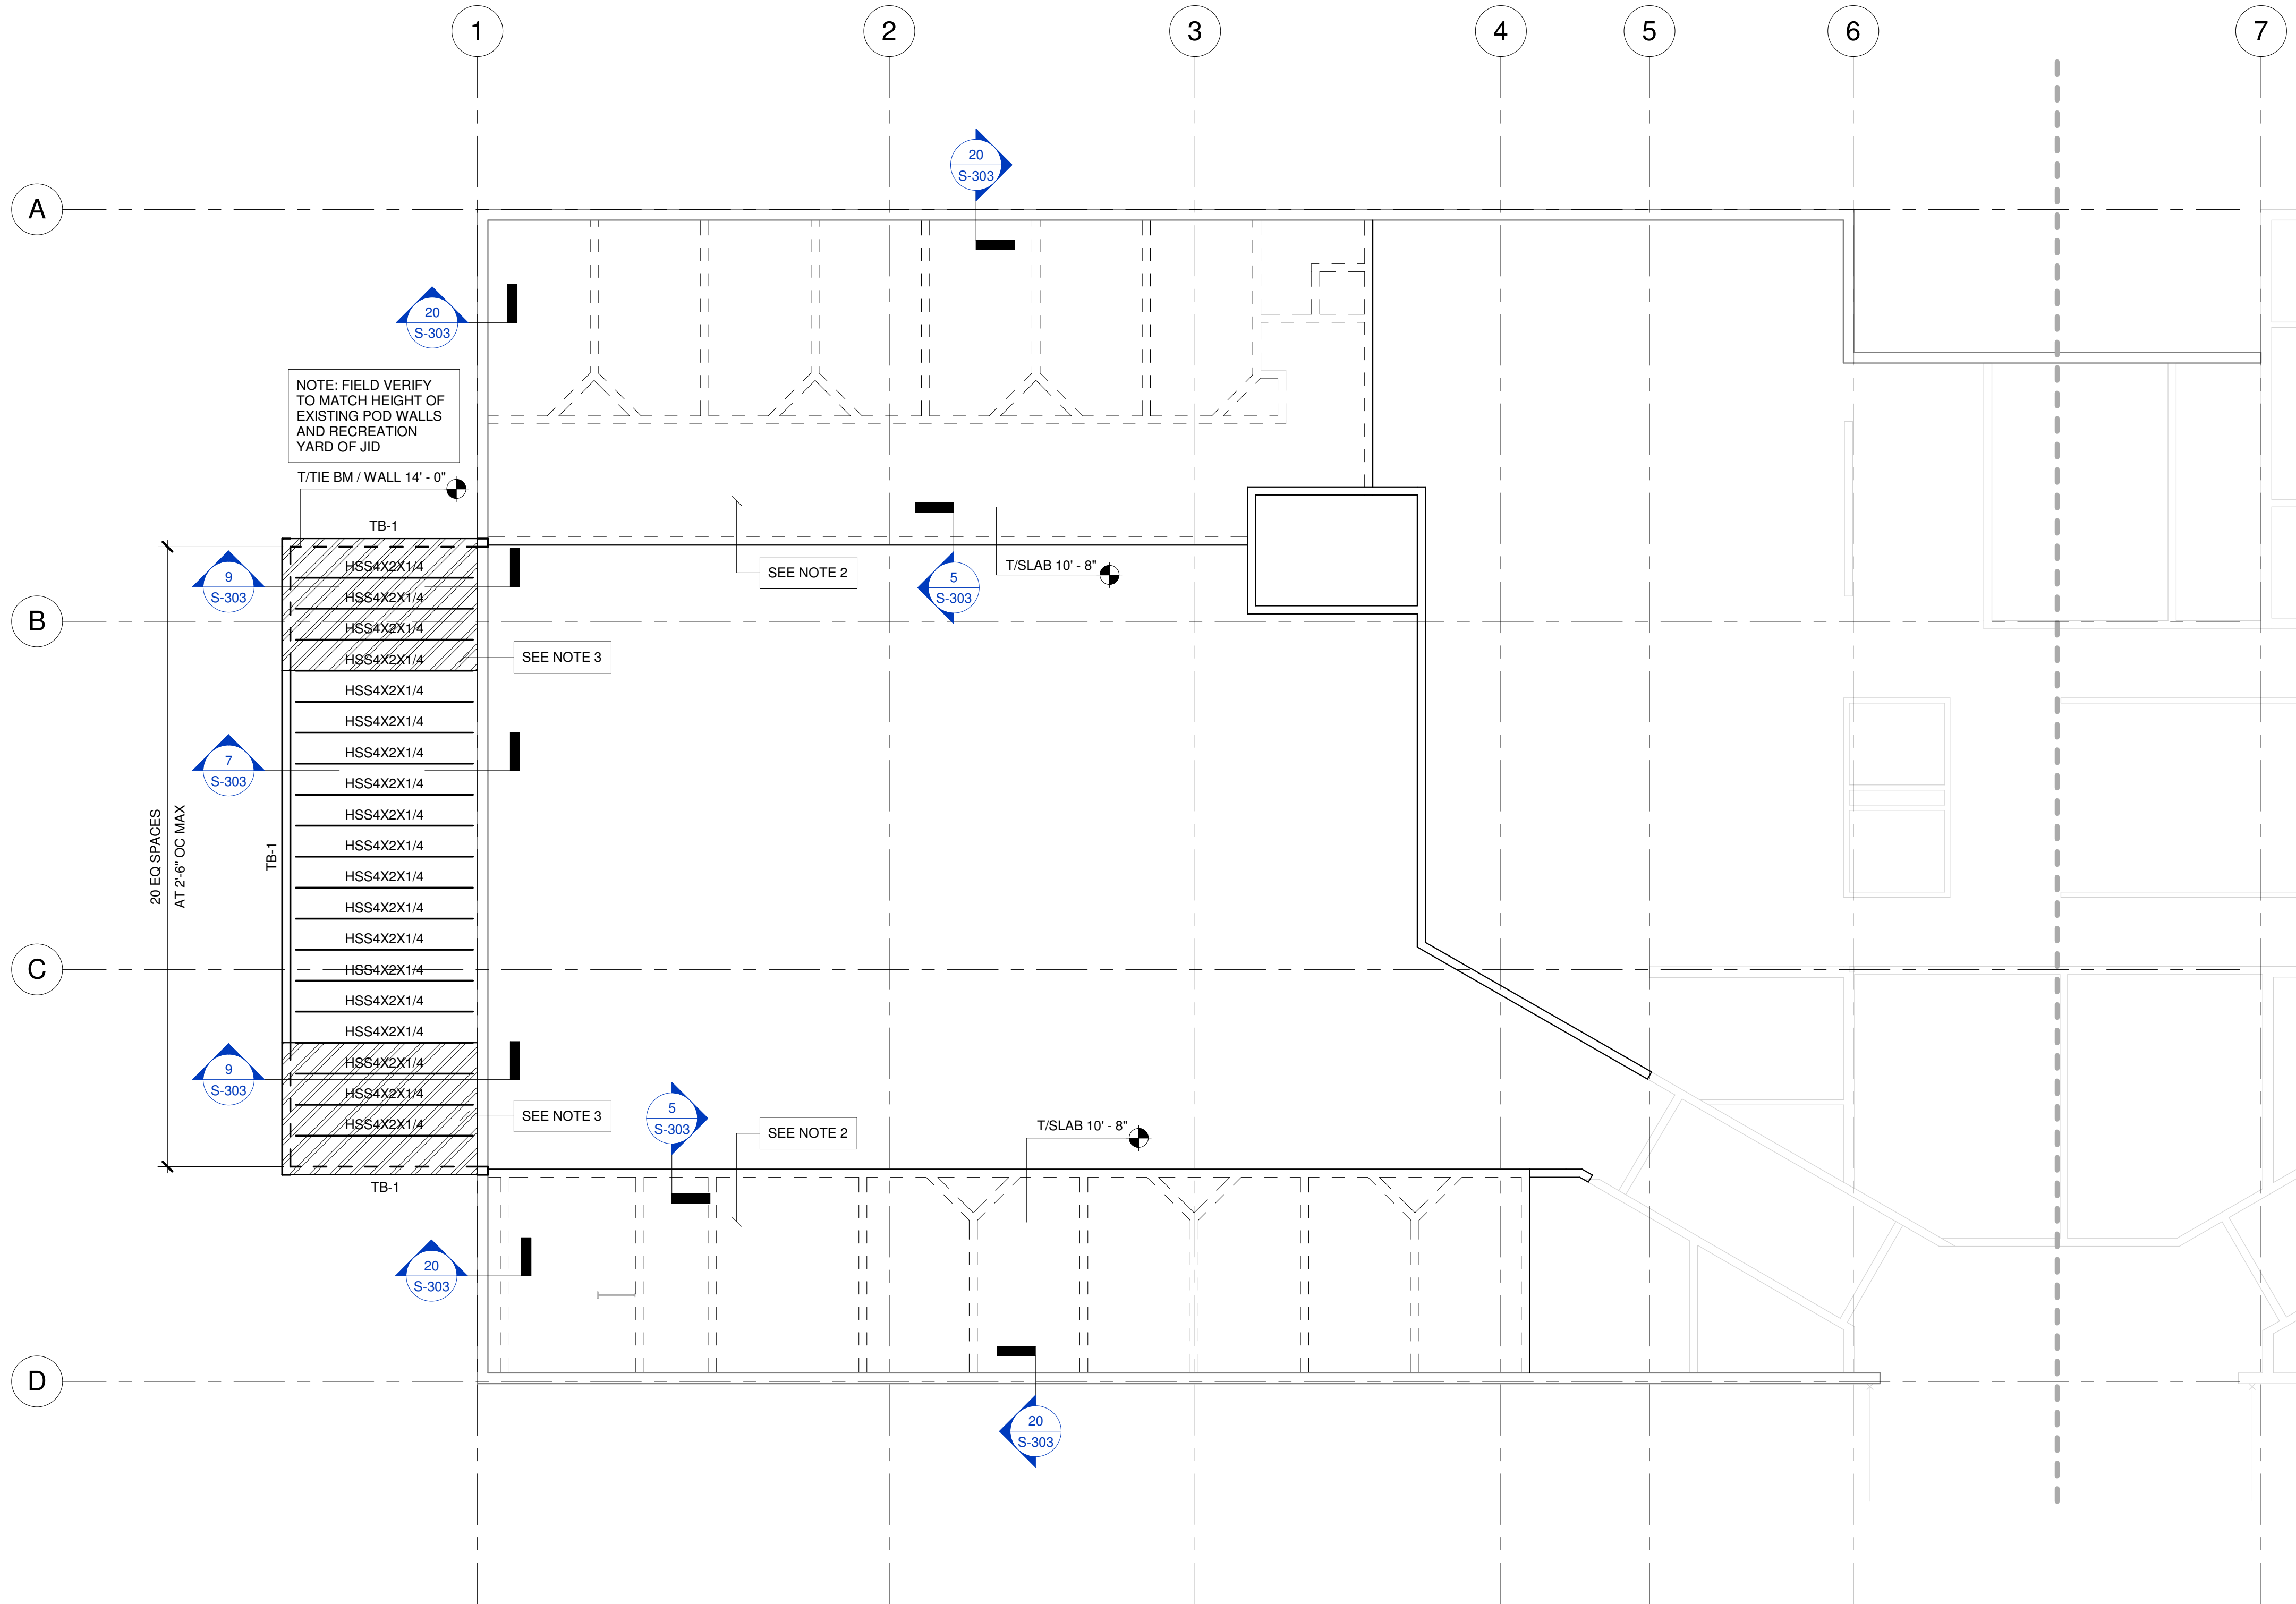

**1** SECOND FLOOR FRAMING PLAN - JIA  
1/8" = 1'-0"

**FLOOR FRAMING NOTES:**

1. VERIFY DIMENSIONS AND ELEVATIONS WITH ARCHITECTURAL DRAWINGS BEFORE COMMENCING CONSTRUCTION.
2. 6" CONCRETE SLAB W/ #5@12" OC TOP AND BOTTOM BOTH WAYS.
3. 1-1/2" (20 GAGE) G90 GALV TYPE B ROOF DECK. FASTEN ROOF DECK TO SUPPORTS PER ROOF DECK ATTACHMENT SCHEDULE ON SHEET S-201.
4. TB-# - INDICATES CONCRETE TIE BEAM, SEE SCHEDULE ON S-201 FOR REINF DETAIL.

**CONCRETE BEAM SCHEDULE**

MARK	SIZE WxD (IN)	BOTTOM REINFORCING	TOP REINFORCING	"I" BARS	STIRRUP	COMMENTS
TB-1	7 5/8" x 16"	(2) #5	(2) #5	-	#3@8" OC	



NOT FOR CONSTRUCTION

#	ISSUED FOR	DATE
	REVIEW	08.14.2024
	PERMIT/BID	08.30.2024
	ADDENDUM #4	09.04.2024

DRAWN BY: GFY  
REVIEW BY: YA / DD

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P 883.682.1182  
F 883.687.5346  
E: AYG@LUNZ.COM

lunz.com

24000700TT

S-102A



CLASS 'A' SPLICE SCHEDULE								
DEVELOPMENT LENGTH SHALL BE PER FOLLOWING TABLE MODIFIED PER NOTES BELOW								
GRADE 60 STEEL								
NORMAL WEIGHT CONCRETE STRENGTH								
BAR	3000 PSI	4000 PSI	5000 PSI	6000 PSI	7000 PSI	8000 PSI	9000 PSI	10000 PSI AND HIGHER
#3	1'-5"	1'-3"	1'-1"	1'-0"	1'-0"	1'-0"	1'-0"	1'-0"
#4	1'-10"	1'-7"	1'-5"	1'-4"	1'-3"	1'-2"	1'-1"	1'-1"
#5	2'-3"	2'-0"	1'-10"	1'-8"	1'-6"	1'-5"	1'-4"	1'-4"
#6	2'-9"	2'-5"	2'-2"	2'-0"	1'-10"	1'-10"	1'-8"	1'-8"
#7	4'-0"	3'-6"	3'-2"	2'-10"	2'-8"	2'-6"	2'-4"	2'-3"
#8	4'-7"	4'-0"	3'-7"	3'-3"	3'-0"	2'-10"	2'-8"	2'-7"
#9	5'-2"	4'-6"	4'-0"	3'-8"	3'-5"	3'-2"	3'-1"	3'-0"
#10	5'-10"	5'-1"	4'-6"	4'-2"	3'-10"	3'-7"	3'-5"	3'-4"
#11	6'-6"	5'-7"	5'-0"	4'-7"	4'-3"	4'-0"	3'-10"	3'-8"
GRADE 75 STEEL								
NORMAL WEIGHT CONCRETE STRENGTH								
BAR	3000 PSI	4000 PSI	5000 PSI	6000 PSI	7000 PSI	8000 PSI	9000 PSI	10000 PSI AND HIGHER
#3	1'-9"	1'-6"	1'-4"	1'-3"	1'-2"	1'-1"	1'-0"	1'-0"
#4	2'-3"	2'-0"	2'-0"	1'-9"	1'-6"	1'-5"	1'-4"	1'-4"
#5	2'-10"	2'-6"	2'-3"	2'-1"	2'-0"	1'-9"	1'-8"	1'-7"
#6	3'-5"	3'-0"	2'-8"	2'-5"	2'-3"	2'-2"	2'-1"	2'-0"
#7	5'-0"	4'-4"	4'-0"	3'-7"	3'-4"	3'-1"	3'-0"	2'-9"
#8	5'-9"	5'-0"	4'-5"	4'-1"	3'-9"	3'-6"	3'-4"	3'-2"
#9	6'-5"	5'-7"	5'-0"	4'-7"	4'-3"	4'-0"	3'-10"	3'-7"
#10	7'-3"	6'-4"	5'-8"	5'-2"	4'-9"	4'-6"	4'-3"	4'-1"
#11	8'-1"	7'-0"	6'-3"	5'-9"	5'-4"	5'-0"	4'-9"	4'-6"

- NOTES:
- FOR CLEAR SPACING BETWEEN BARS <db AND/OR CLEAR COVER <db, MULTIPLY BY 1.5.
  - FOR TOP BARS MULTIPLY BY 1.3.
  - FOR EPOXY COATED BARS, IF SPECIFIED OR APPROVED AS AN ALTERNATE, MULTIPLY BY 1.3.
  - FOR MMFX BARS, IF SPECIFIED OR USED, USE GRADE 75 KSI VALUES.
  - WHERE MORE THAN ONE FACTOR APPLIES, PRODUCT OF ALL APPLICABLE FACTORS SHALL BE APPLIED.
  - IF DETAILER IS TO USE A DIFFERENT SCHEDULE, HE/SHE MUST SUBMIT A SEALED LETTER INDICATING THAT HIS/HER VALUES CORRESPOND TO CURRENT ACI 318 CODE.

4 CLASS 'A' SPLICE SCHEDULE  
12" = 1'-0"

Concrete Cover Requirements		
Structural Element	Reinforcement	Cover (in)
Members Not Exposed to Weather or in Contact With Ground		
Slabs	All	3/4"
Joists	All	3/4"
Walls	All	3/4"
Beams	To Stirrups	1 1/2"
Columns	To Stirrups	1 1/2"
Members Exposed to Weather or in Contact With Ground		
Slabs	#5 or Smaller	1 1/2"
	#6 or Larger	2"
Columns/Pedestals	#5 or Smaller	1 1/2"
	#6 or Larger	2"
Walls	#5 or Smaller	1 1/2"
	#6 or Larger	2"
Slab on Grade	WWR	2" From Top
Foundations and Grade Beams	Bottom/Side Top	3" 2"

8 CONCRETE COVER REQUIREMENTS  
3/4" = 1'-0"

CLASS 'B' SPLICE SCHEDULE								
DEVELOPMENT LENGTH SHALL BE PER FOLLOWING TABLE MODIFIED PER NOTES BELOW								
GRADE 60 STEEL								
NORMAL WEIGHT CONCRETE STRENGTH								
BAR	3000 PSI	4000 PSI	5000 PSI	6000 PSI	7000 PSI	8000 PSI	9000 PSI	10000 PSI AND HIGHER
#3	1'-9"	1'-6"	1'-5"	1'-3"	1'-2"	1'-1"	1'-0"	1'-0"
#4	2'-4"	2'-1"	1'-10"	1'-8"	1'-7"	1'-5"	1'-4"	1'-4"
#5	3'-3"	2'-7"	2'-4"	2'-1"	2'-0"	1'-10"	1'-9"	1'-8"
#6	3'-7"	3'-1"	2'-9"	2'-6"	2'-4"	2'-2"	2'-1"	2'-0"
#7	5'-2"	4'-6"	4'-0"	3'-8"	3'-5"	3'-2"	3'-0"	2'-10"
#8	6'-0"	5'-2"	4'-7"	4'-2"	4'-0"	3'-8"	3'-5"	3'-3"
#9	6'-8"	5'-10"	5'-2"	4'-9"	4'-5"	4'-1"	3'-10"	3'-8"
#10	7'-6"	6'-6"	5'-10"	5'-4"	5'-0"	4'-7"	4'-4"	4'-2"
#11	8'-4"	7'-3"	6'-6"	6'-0"	5'-6"	5'-1"	4'-10"	4'-7"
GRADE 75 STEEL								
NORMAL WEIGHT CONCRETE STRENGTH								
BAR	3000 PSI	4000 PSI	5000 PSI	6000 PSI	7000 PSI	8000 PSI	9000 PSI	10000 PSI AND HIGHER
#3	2'-3"	2'-0"	1'-9"	1'-7"	1'-5"	1'-4"	1'-3"	1'-3"
#4	3'-0"	2'-7"	2'-4"	2'-1"	2'-0"	1'-10"	1'-9"	1'-8"
#5	3'-9"	3'-3"	2'-10"	2'-7"	2'-5"	2'-3"	2'-2"	2'-0"
#6	4'-5"	3'-10"	3'-5"	3'-2"	3'-0"	2'-9"	2'-7"	2'-5"
#7	6'-6"	5'-7"	5'-0"	4'-7"	4'-3"	4'-0"	3'-9"	2'-9"
#8	7'-5"	6'-5"	5'-9"	5'-3"	4'-10"	4'-7"	4'-3"	4'-1"
#9	8'-4"	7'-3"	6'-6"	6'-0"	5'-6"	5'-1"	4'-10"	4'-7"
#10	9'-5"	8'-2"	7'-4"	6'-8"	6'-2"	5'-9"	5'-5"	5'-2"
#11	10'-5"	9'-1"	8'-1"	7'-5"	6'-10"	6'-5"	6'-0"	5'-9"

- NOTES:
- FOR CLEAR SPACING BETWEEN BARS <db AND/OR CLEAR COVER <db, MULTIPLY BY 1.5.
  - FOR TOP BARS MULTIPLY BY 1.3.
  - FOR EPOXY COATED BARS, IF SPECIFIED OR APPROVED AS AN ALTERNATE, MULTIPLY BY 1.3.
  - FOR MMFX BARS, IF SPECIFIED OR USED, USE GRADE 75 KSI VALUES.
  - WHERE MORE THAN ONE FACTOR APPLIES, PRODUCT OF ALL APPLICABLE FACTORS SHALL BE APPLIED.
  - IF DETAILER IS TO USE A DIFFERENT SCHEDULE, HE/SHE MUST SUBMIT A SEALED LETTER INDICATING THAT HIS/HER VALUES CORRESPOND TO CURRENT ACI 318 CODE.


3 CLASS 'B' SPLICE SCHEDULE  
12" = 1'-0"

- ENG NOTES:
- TABLE IS AN EXAMPLE OF TYPES OF STRUCTURAL ELEMENTS AND THEIR DESIGN STRENGTHS.
  - EXPOSURE CLASSES NOTED ARE FOR STANDARD INTERIOR CONSTRUCTION AND SOILS WITH NO CHLORIDES. VERIFY EXPOSURE CLASS WITH PROJECT SPECIFIC CONDITIONS.

Concrete Compressive Strengths		
Structural Element	Exposure Class	Design Strength, f <sub>c</sub> (PSI)
Foundations and Stem Walls	C1	3000
Slab on Grade	C1	3000
Concrete on Metal Deck	W0	3500
Columns	W0	5000
Walls	W0	5000
Beams	W0	5000
Elevated Slabs	W0	5000


- NOTED EXPOSURE CLASSES ARE IN REFERENCE TO CHAPTER 19 OF ACI 318-14. MINIMUM AND MAXIMUM REQUIREMENTS BASED ON TABLE 19.3.2.1.
- CONCRETE COMPRESSIVE STRENGTHS NOTED ARE MINIMUM REQUIREMENTS USED IN DESIGN.

7 CONCRETE COMPRESSIVE STRENGTHS  
3/4" = 1'-0"

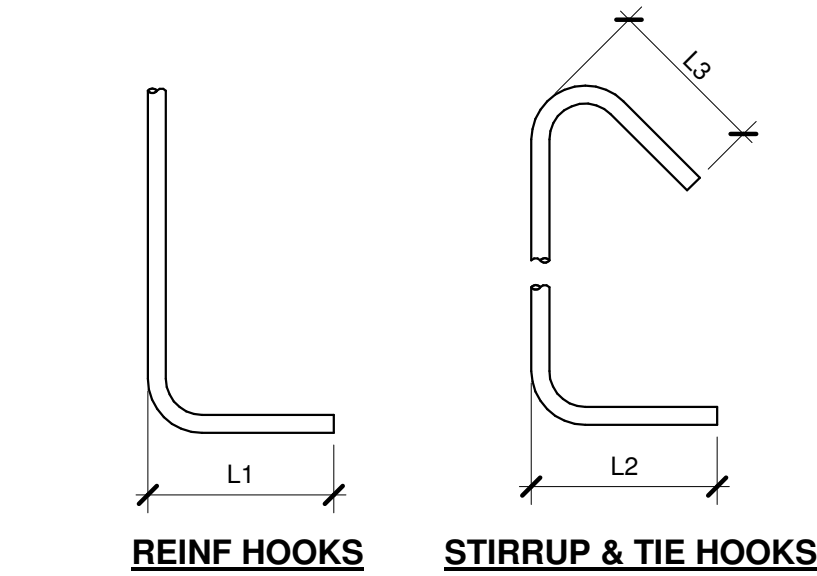


SCHEDULE			
BAR SIZE	REINF HOOK	STIRRUP & TIE HOOKS	
	L1	L2	L3
#3	6"	4"	2 1/2"
#4	8"	4 1/2"	3"
#5	10"	-	-
#6	1'-0"	-	-
#7	1'-2"	-	-
#8	1'-4"	-	-
#9	1'-7"	-	-
#10	1'-10"	-	-
#11	2'-0"	-	-


6 STD HOOK LENGTHS  
1" = 1'-0"

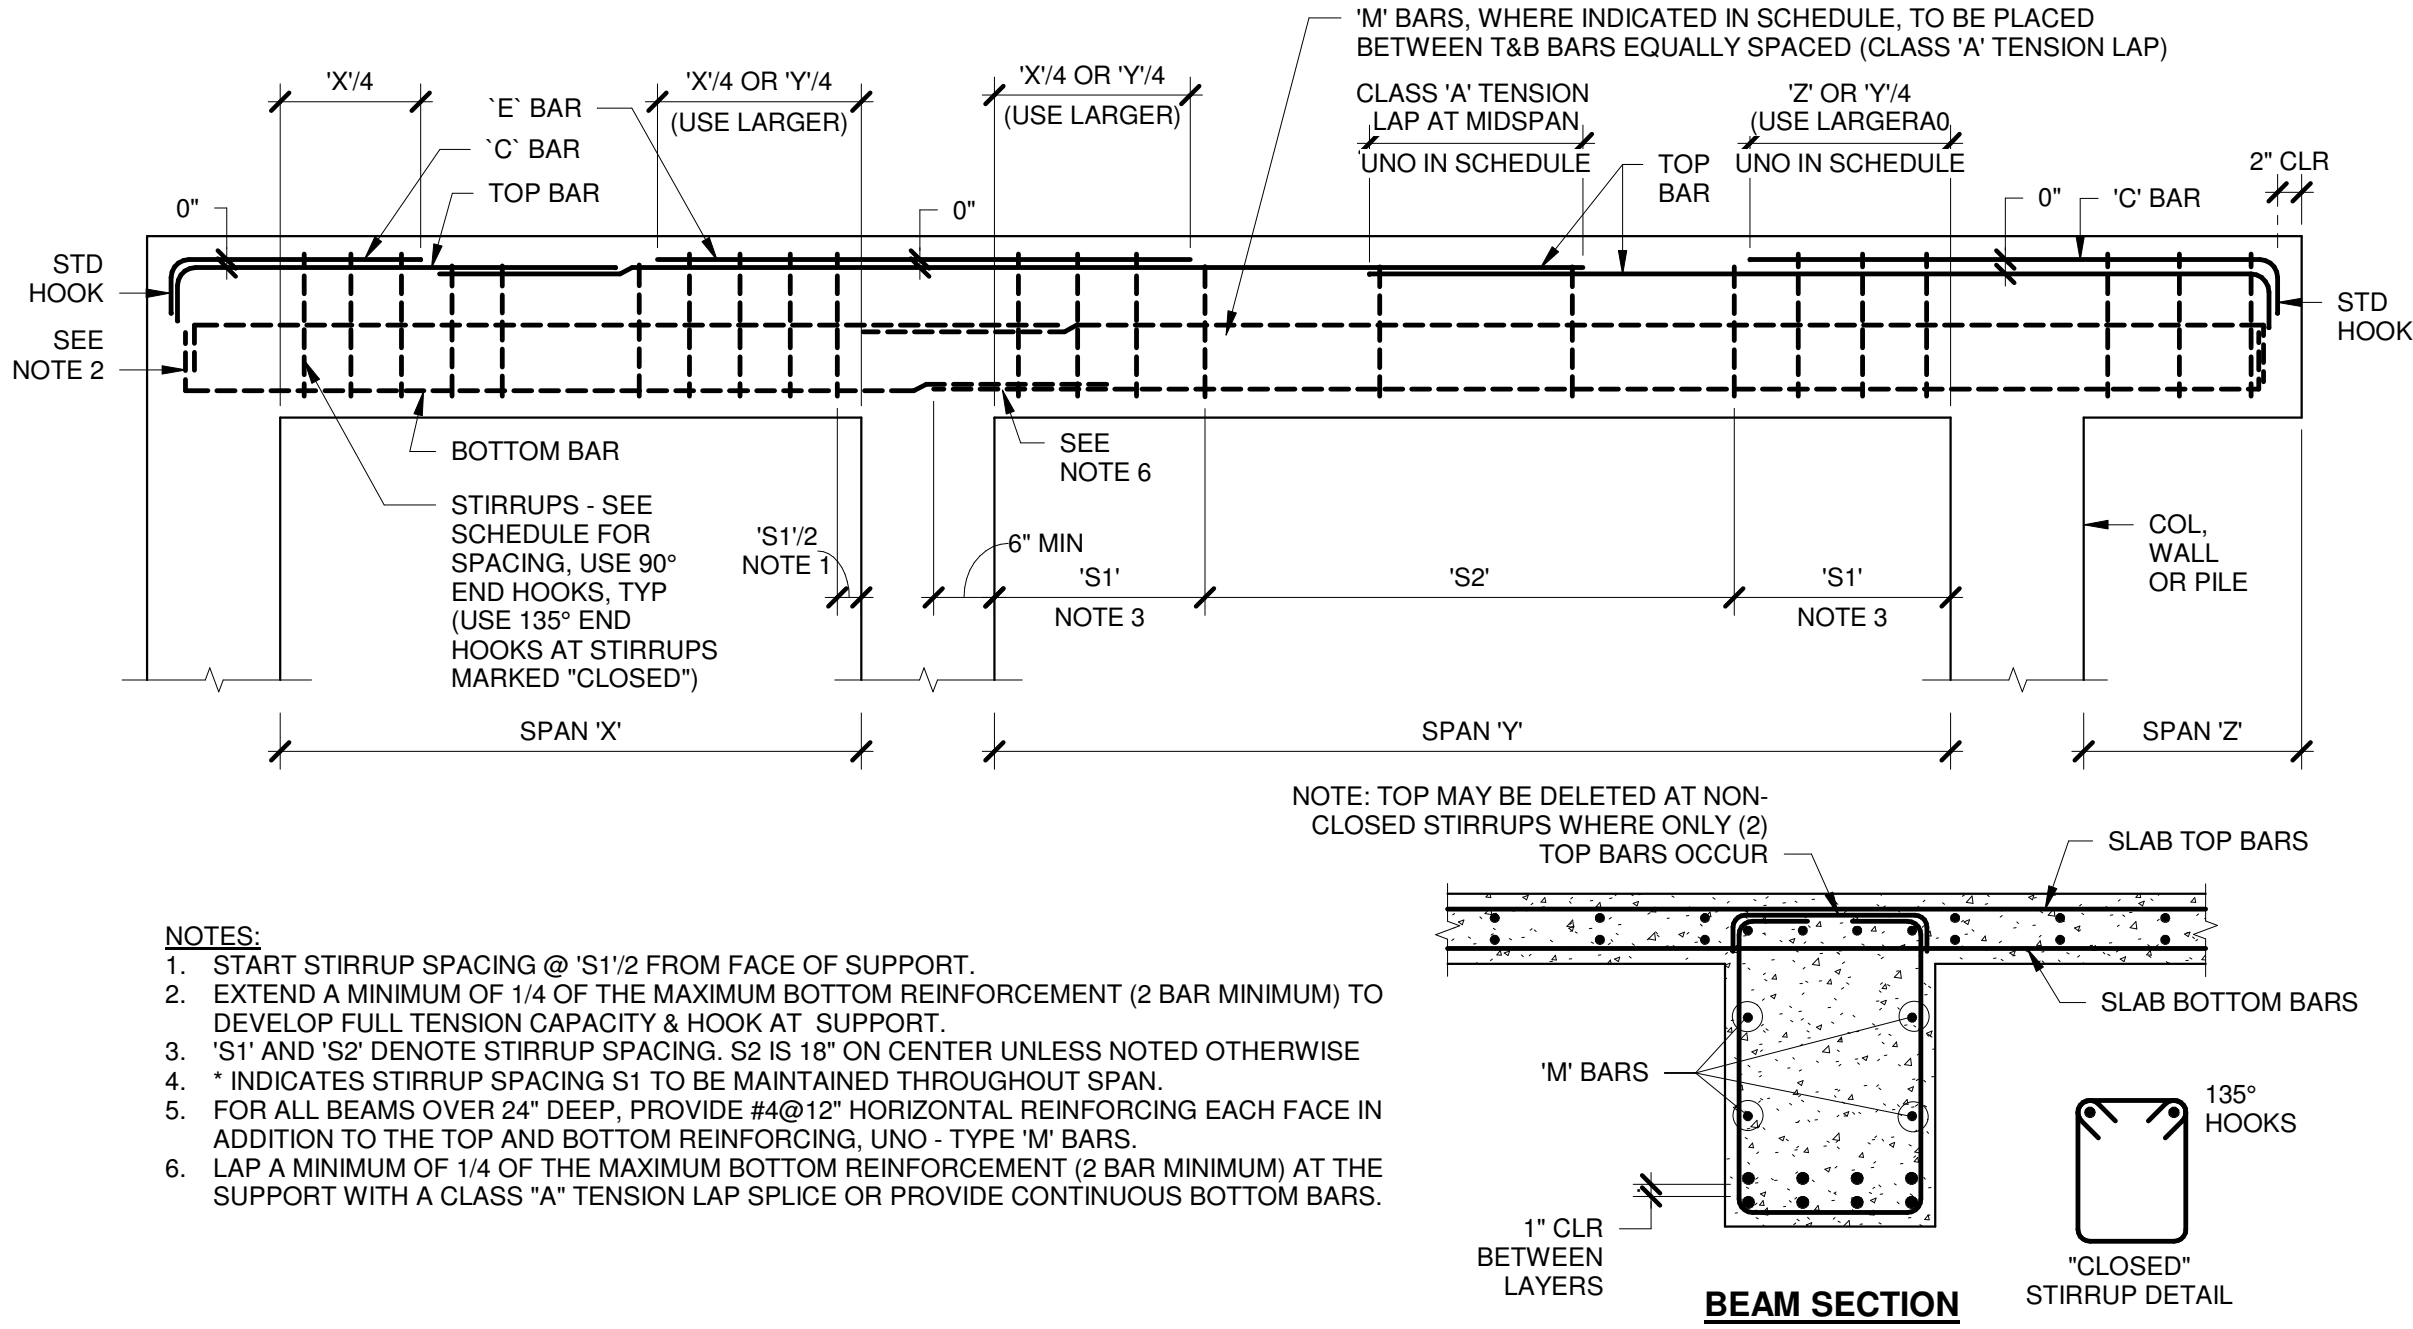

1 TYPICAL BENDING DIAGRAM FOR BEAMS & ONE WAY SLABS  
3/4" = 1'-0"

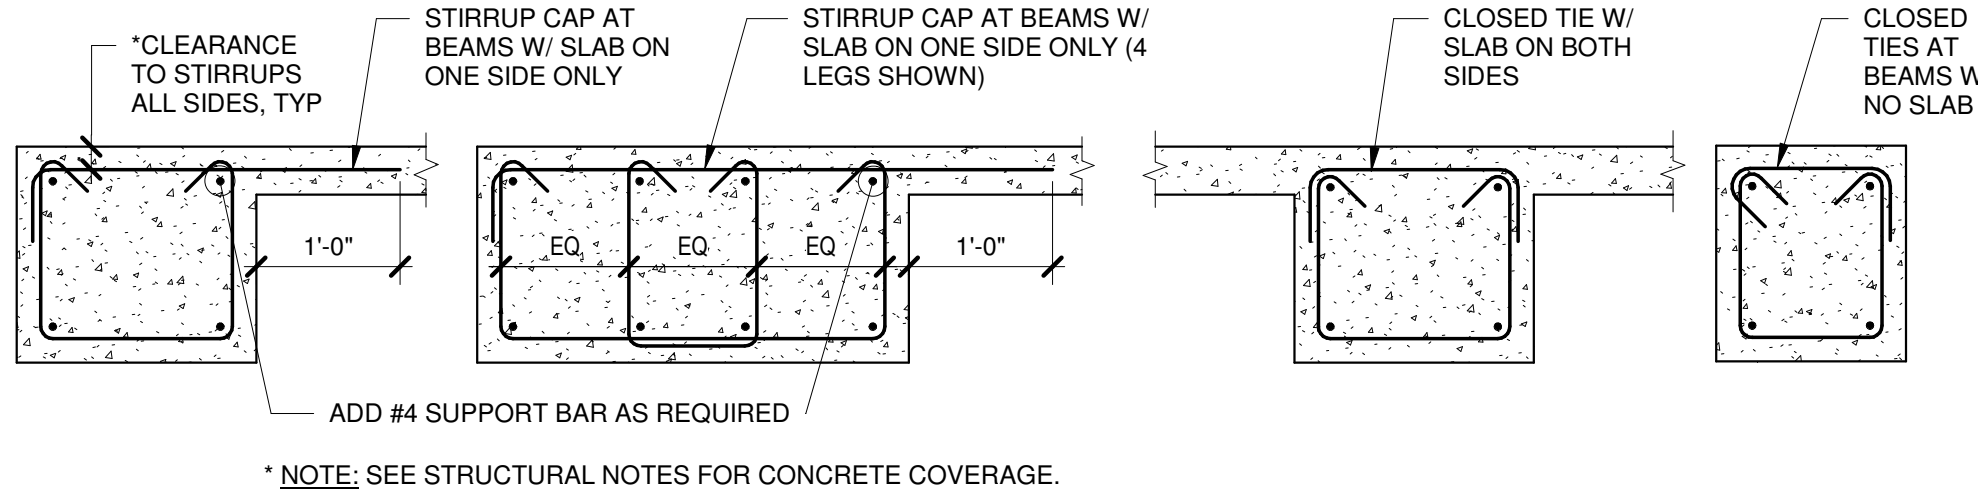

2 TYPICAL BEAM STIRRUP / TIES DETAILS  
3/4" = 1'-0"

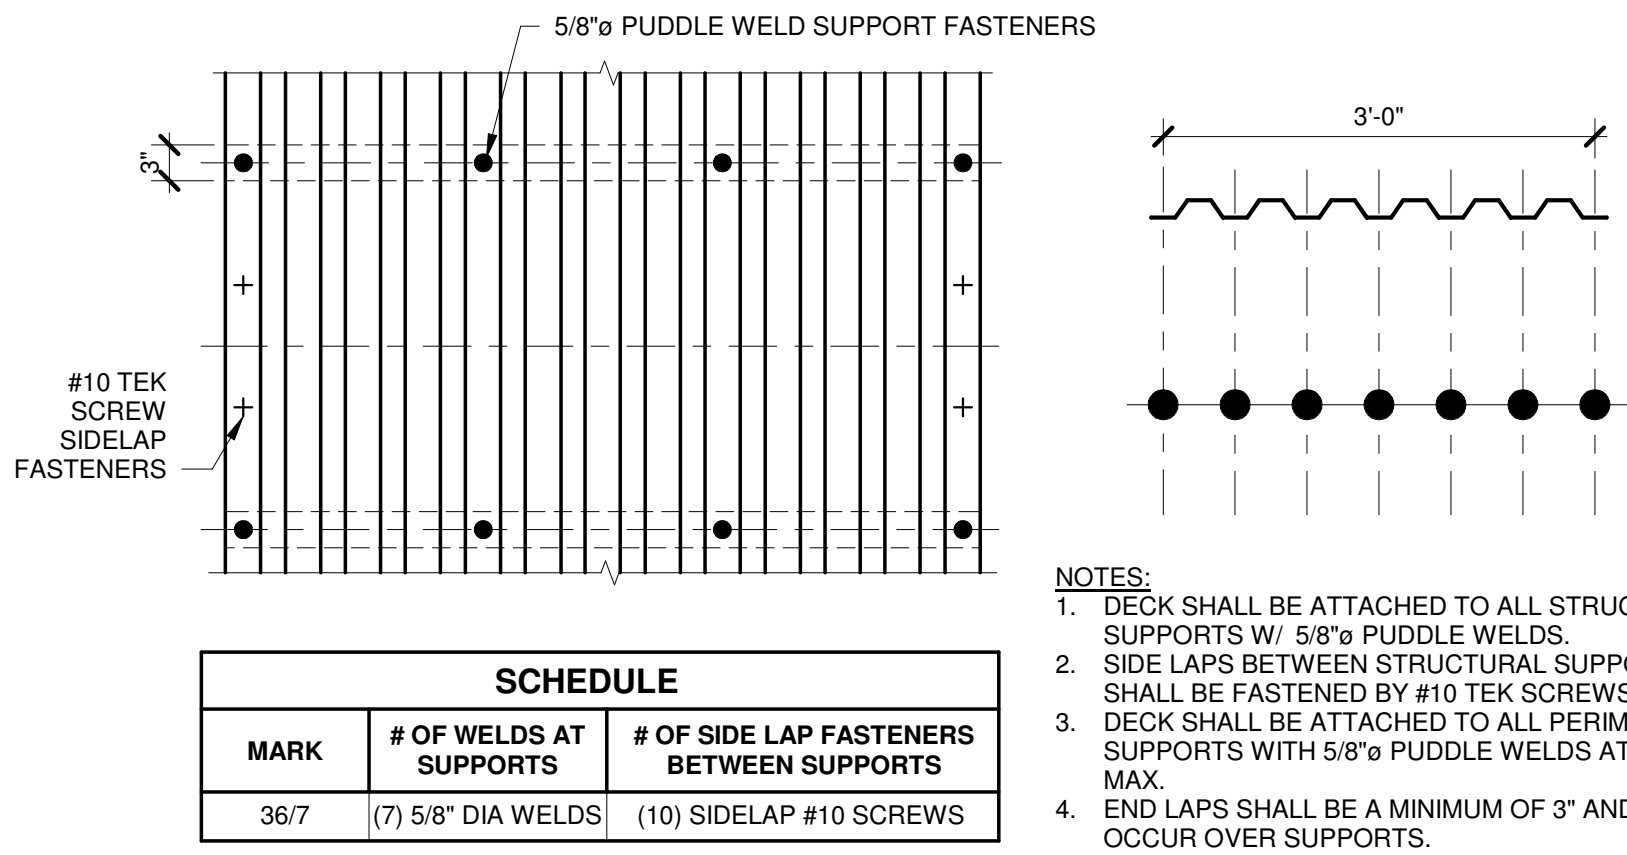

5 ROOF DECK ATTACHMENT SCHEDULE  
3/4" = 1'-0"

THE  
**LUNZ**  
GROUP



George F. Young, Inc.

1408 N WESTSHORE BLVD, TAMPA, FL 33607  
PHONE (727) 822-4317 WWW.GEORGEFYOUNG.COM  
ENGINEERING CERTIFICATE OF AUTHORIZATION NUMBER 21  
CIVIL, TRANSPORTATION, SUBSURFACE & STRUCTURAL ENGINEERING  
ECOLOGY | GIS | PLANNING | SURVEYING  
ST. PETERSBURG ■ LAKEWOOD RANGE ■ TAMPA ■ GAINESVILLE ■ LAKE WALES  
■ PUNTA GORDA

HCSO MENTAL HEALTH POD - JIA

2310 N. FALKENBURG ROAD  
TAMPA, FLORIDA 33619

SCHEDULES & TYPICAL DETAILS

NOT FOR CONSTRUCTION		
#	ISSUED FOR	DATE
	REVIEW	08.14.2024
	PERMIT/BID	08.30.2024
	ADDENDUM #4	09.04.2024

DRAWN BY: GIFY  
REVIEW BY: YA / DD

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P 883.682.1082  
F 883.687.6346  
lic: AR04478

lunz.com


24000700TT

S-201







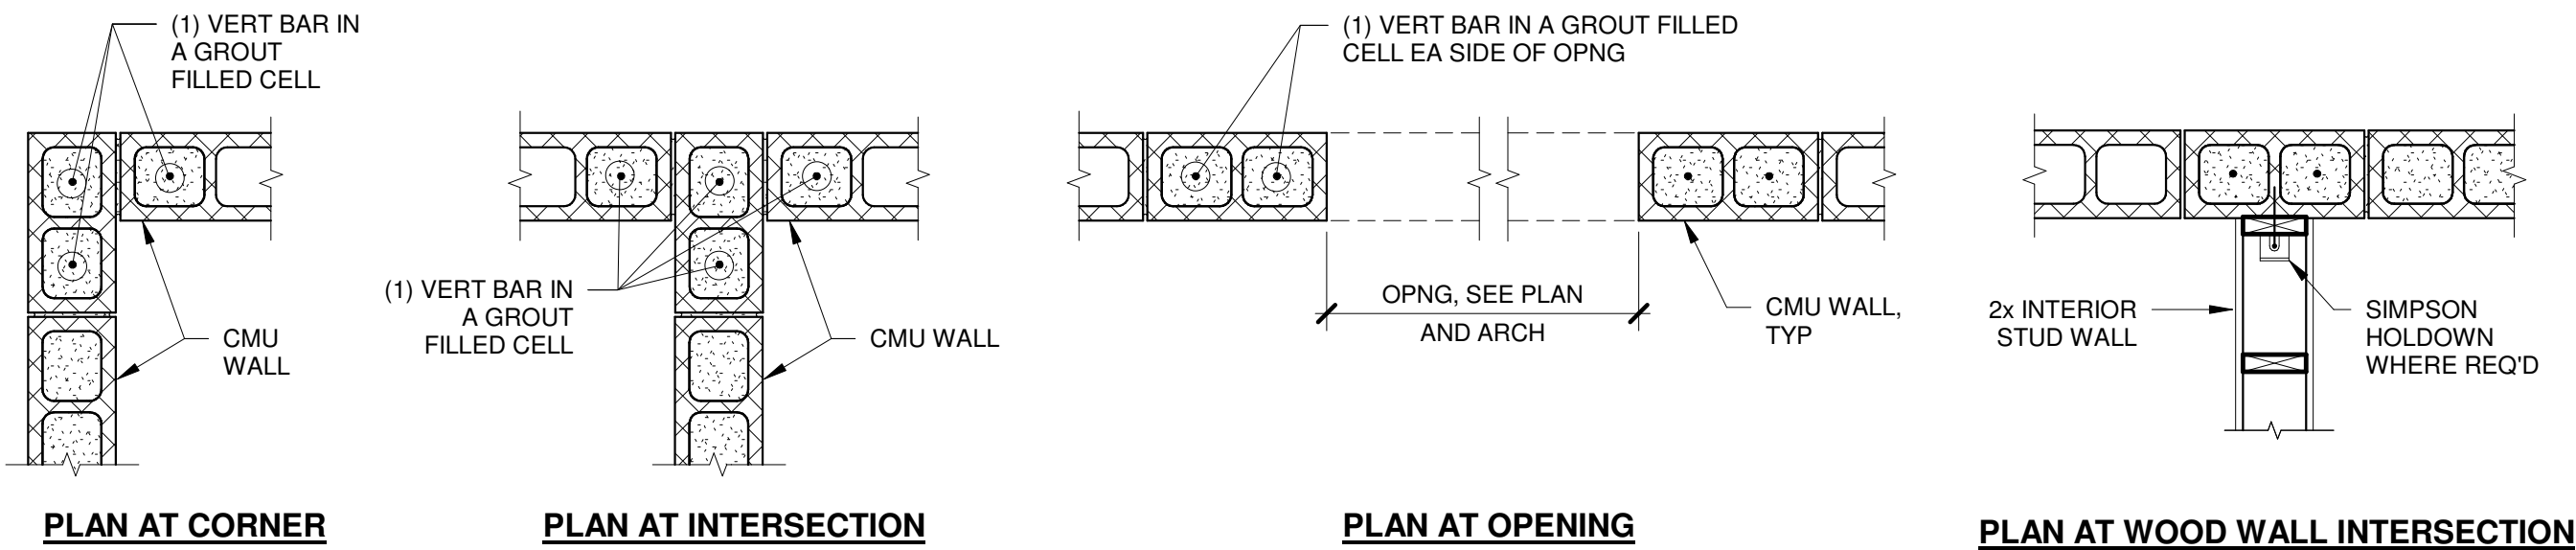

NOTES:  
1. SEE TYP MASONRY WALL CONSTRUCTION FOR JOINT REINFORCING NOT SHOWN HERE.  
2. SEE PLAN FOR REINFORCING SIZE.

5 REINFORCING AT CMU WALL CORNERS, INTERSECTIONS AND OPENINGS  
3/4" = 1'-0"


LINTEL SCHEDULE		
LINTEL SPAN	LINTEL DESIGNATION	REMARKS
UP TO 4'-0"	8 F8-1B	-
FROM 4'-1" TO 6'-0"	8 F16-1B/1T	-
FROM 6'-1" TO 8'-0"	8 F20-1B/2T	-
FROM 8'-1" TO 10'-0"	8 F24-2B/2T	-
OVER 10'-0"	CAST IN PLACE BEAM	SEE PLANS

NOTES:  
1. LINTELS SHALL BE "CAST-CRETE" OR EQUIVALENT PRECAST CONCRETE UNO.  
2. LINTELS SHALL BEAR 8" MIN ON CMU/CONCRETE AND 3" MINIMUM ON STEEL ANGLES.

TYPE DESIGNATION  
F = FILLED W/ GROUT  
U = UNFILLED

QTY OF #5 REBAR AT TOP  
QTY OF #5 REBAR AT BOT

10 LINTEL SCHEDULE AND DETAILS  
3/4" = 1'-0"

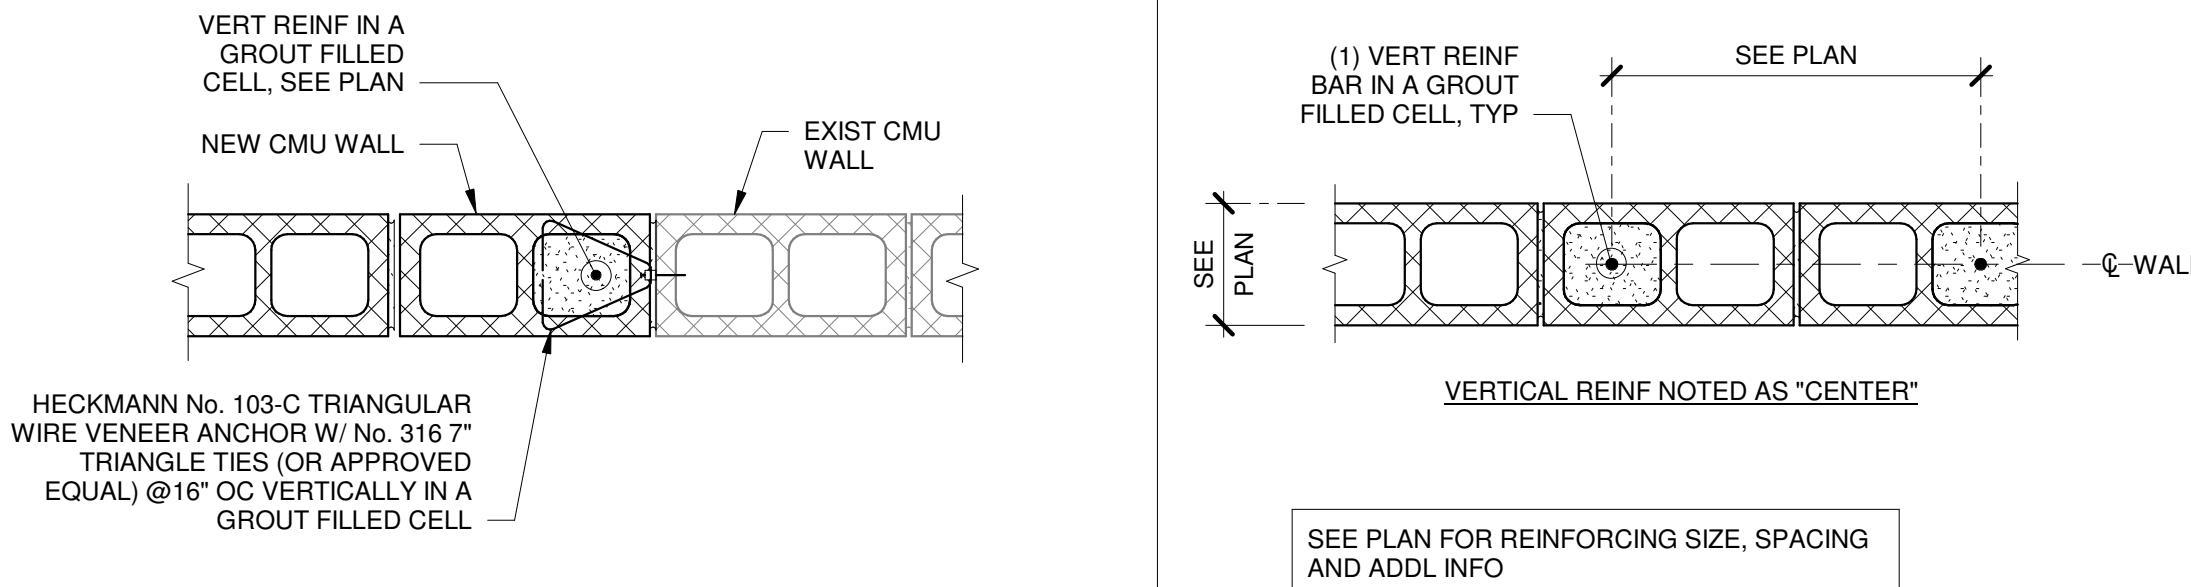

15 NEW TO EXIST CMU ANCHORAGE  
1" = 1'-0"

CMU WALL SCHEDULE			
MARK	THICKNESS	REINFORCING	COMMENTS
MW1	8"	#5@32" OC	9-GA HORIZ. REINF. PER TYP. DETAILS
MW2	8"	#5@16" OC	9-GA HORIZ. REINF. PER TYP. DETAILS


NOTES:  
PROVIDE A MINIMUM OF (1) #5 VERT REINF BAR IN A GROUT FILLED CELL AT ALL WALL INTERSECTIONS, CORNERS, ENDS OF WALLS AND AT EDGES OF ALL WALL OPENINGS EXCEEDING 2'-0" IN WIDTH.  
INTERIOR WALLS DO NOT REQUIRE VERT REINF UNLESS SPECIFICALLY SHOWN OR NOTED OTHERWISE ON PLAN. SEE TYP MASONRY (CMU) WALL CONSTRUCTION DETAIL FOR ADDITIONAL CMU WALL REINFORCING REQUIREMENTS.

19 CMU WALL SCHEDULE  
3/4" = 1'-0"


13 CMU WALL OPNG AT CONC TIE BEAM  
1/2" = 1'-0"

SCHEDULE		
WALL THICKNESS	BAR	LAP
8"	#4	1'-8"
8"	#5	2'-1"
8"	#6	3'-7"
8"	#7	4'-11"
12"	#4	1'-8"
12"	#5	2'-1"
12"	#6	3'-3"
12"	#7	3'-10"


18 CMU VERTICAL REINFORCING LAP SCHEDULE  
3/4" = 1'-0"

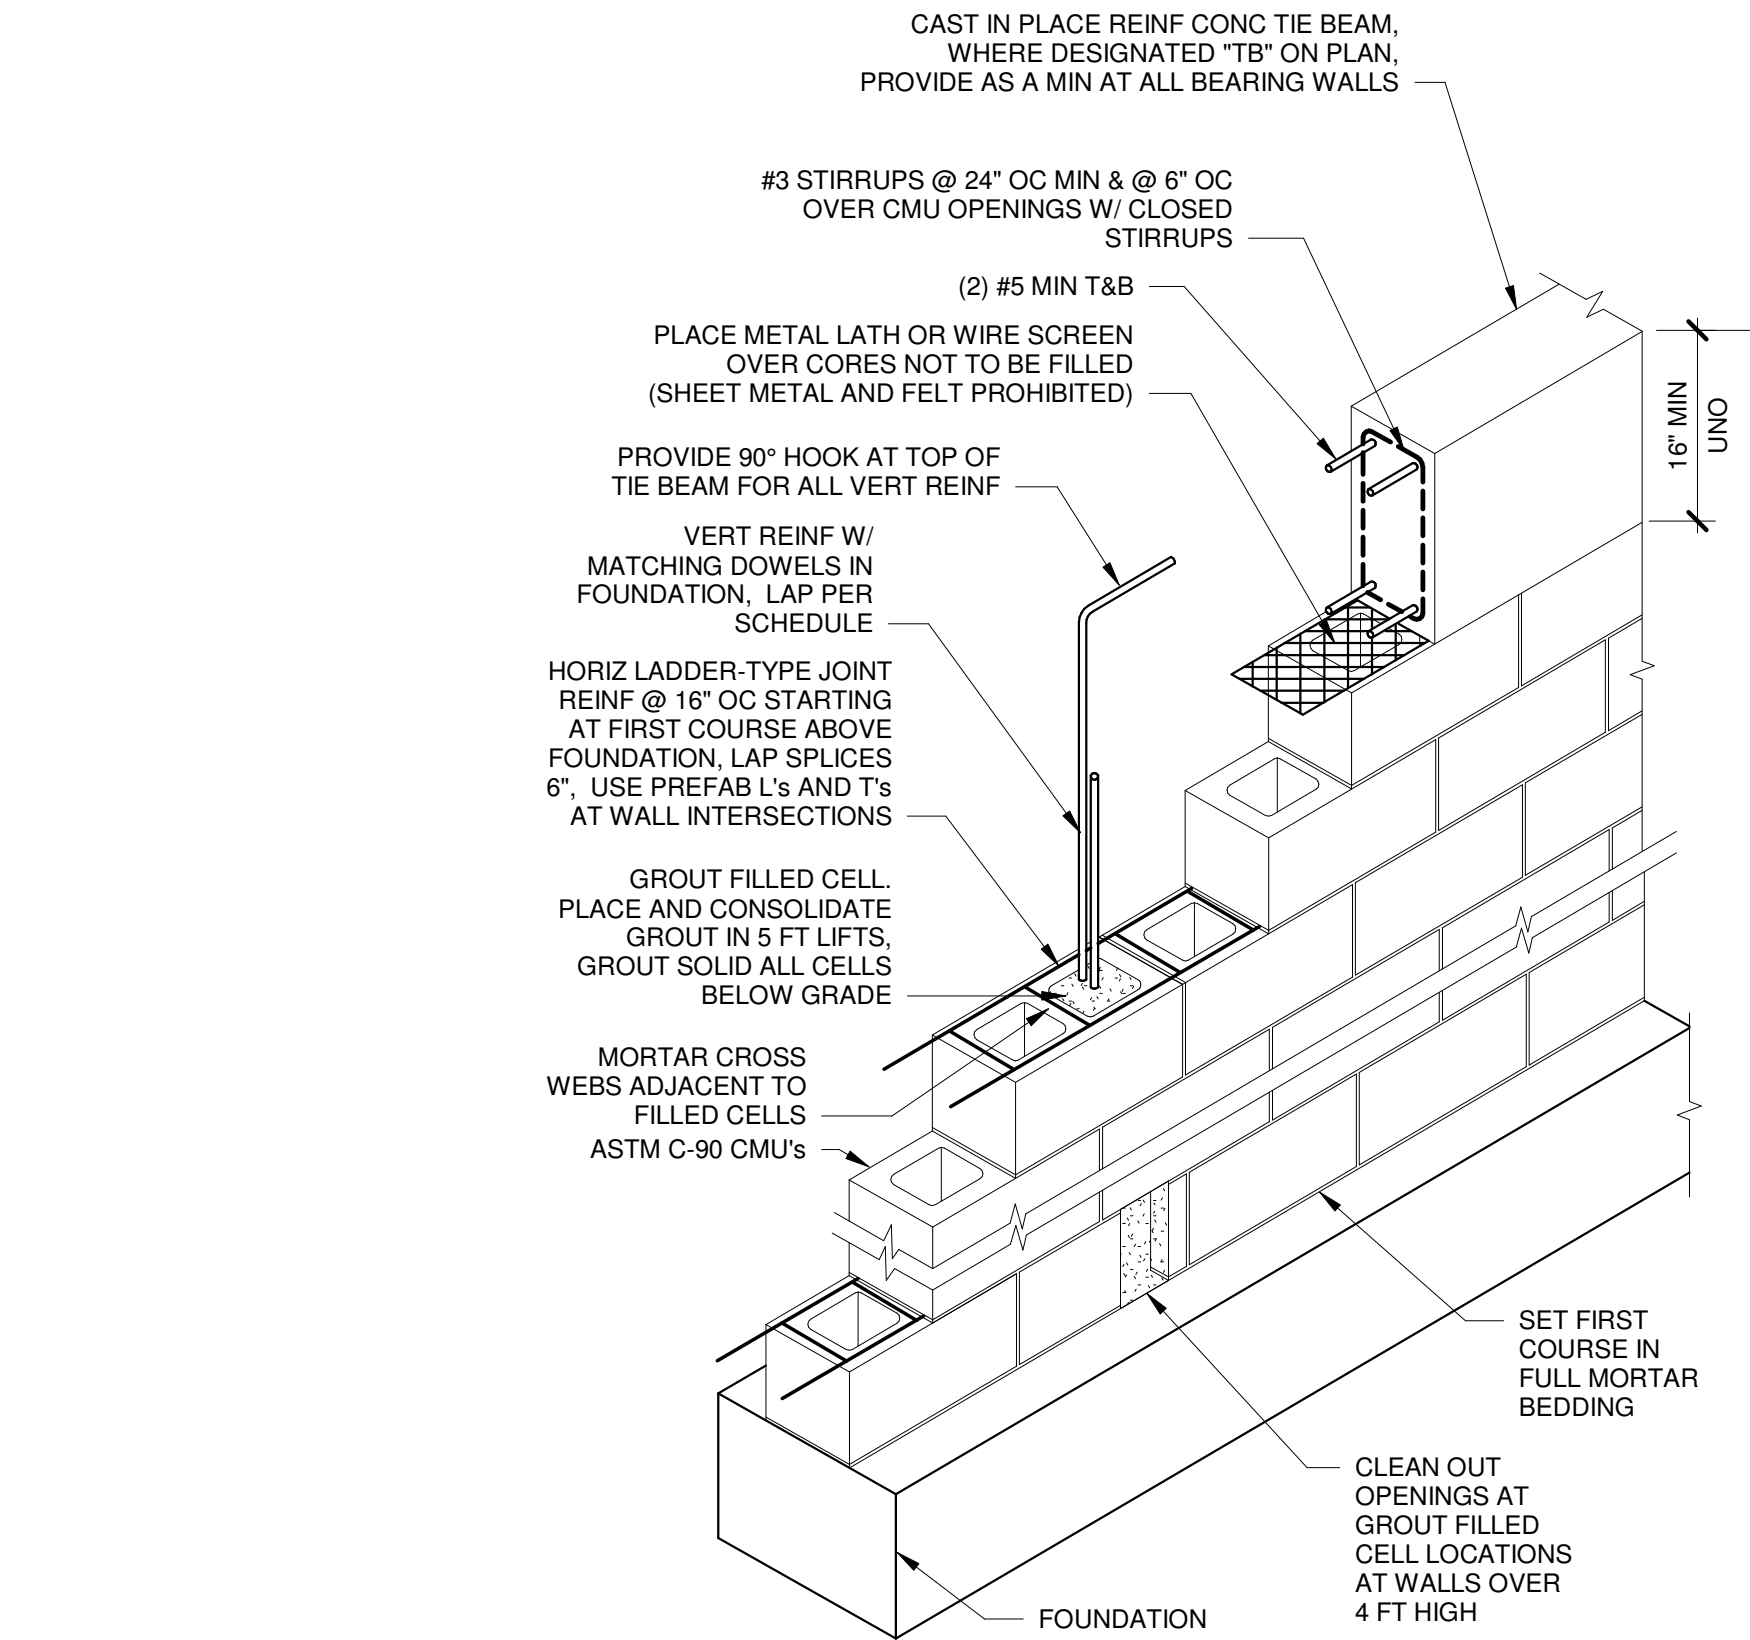


7 TYPICAL MASONRY WALL CONSTRUCTION DETAIL FOR RUNNING BOND LAYOUT  
3/4" = 1'-0"

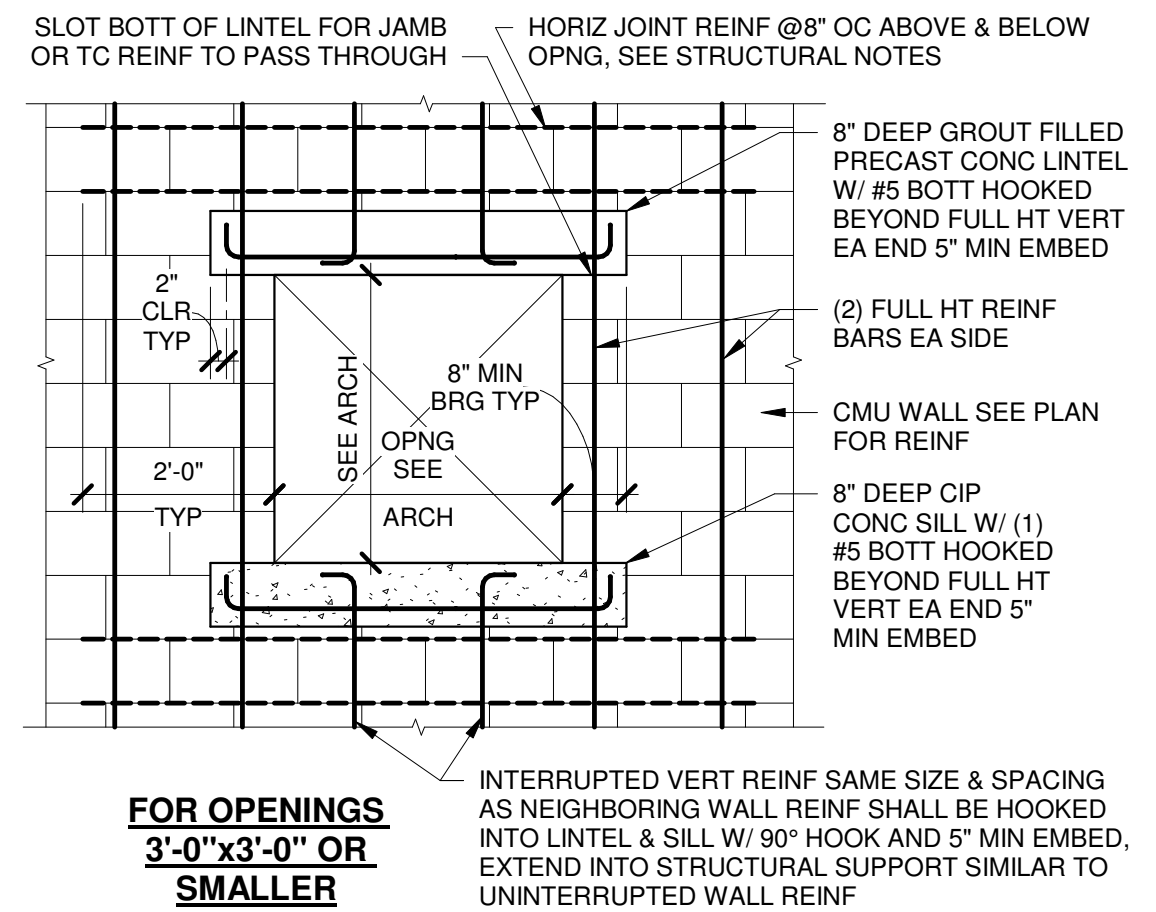


12 MINOR CMU WALL OPNGS  
1/2" = 1'-0"

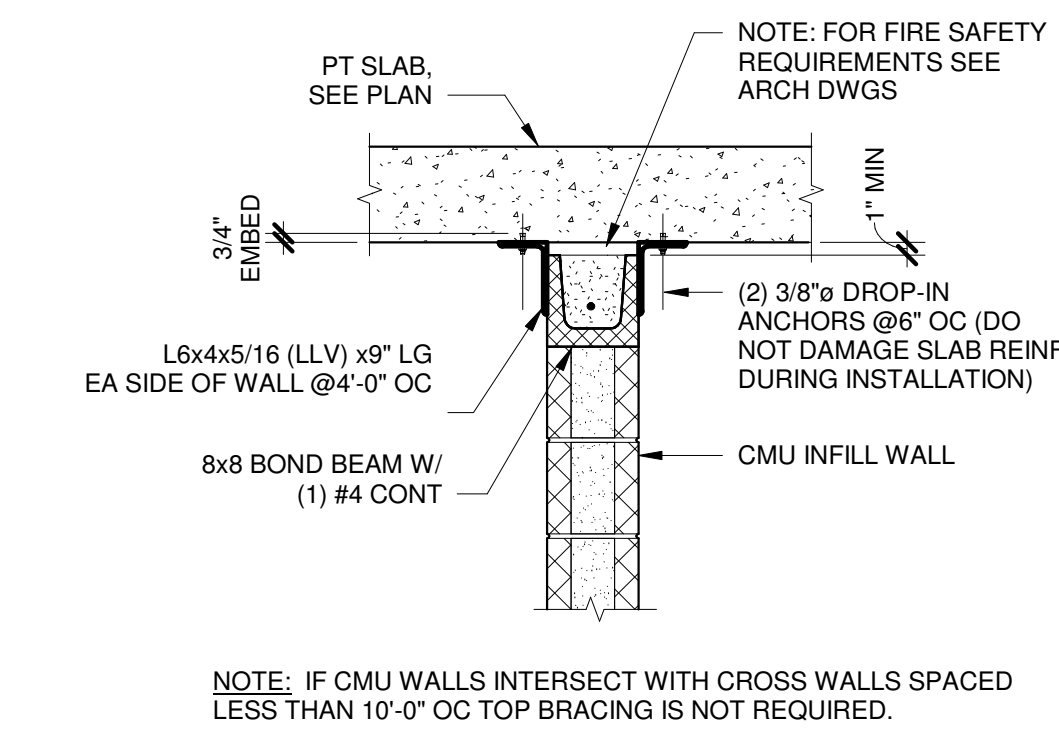

17 NON-LOAD BEARIG CMU WALL ANCHORAGE  
3/4" = 1'-0"

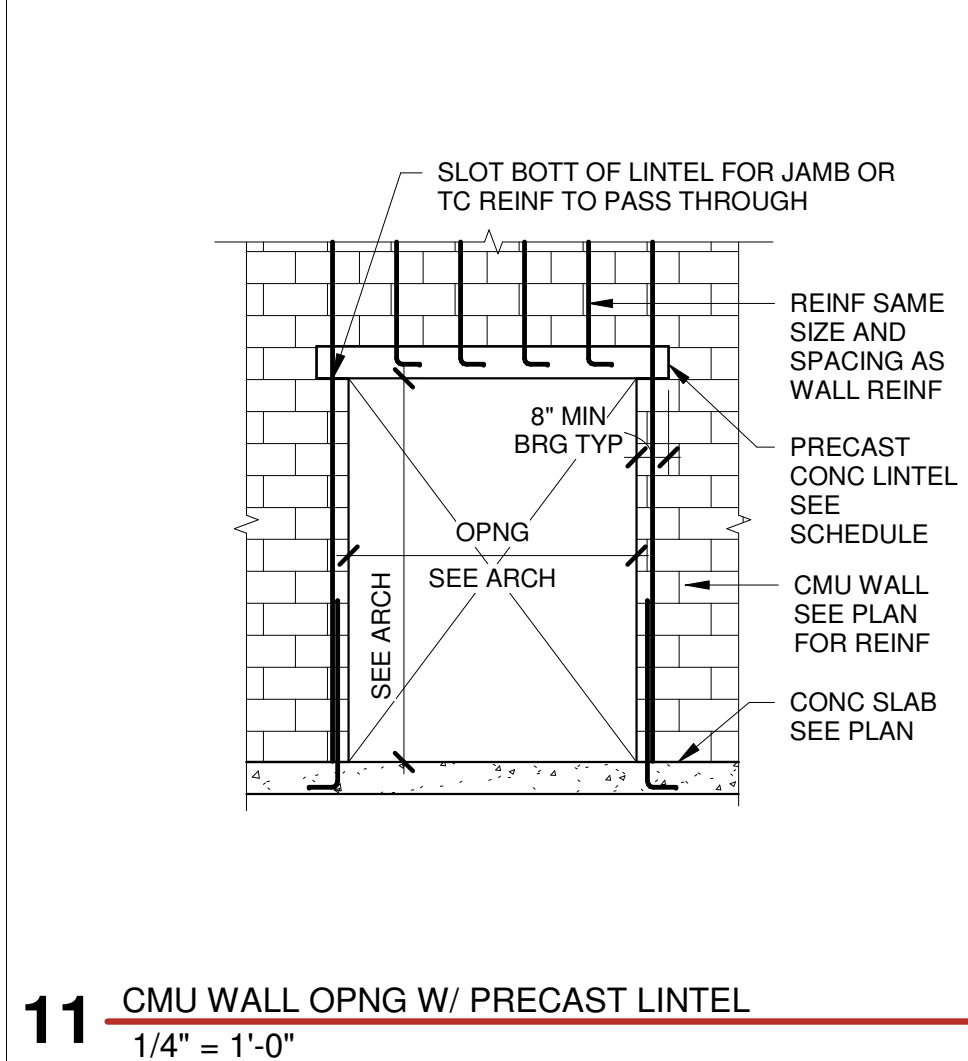

11 CMU WALL OPNG W/ PRECAST LINTEL  
1/4" = 1'-0"

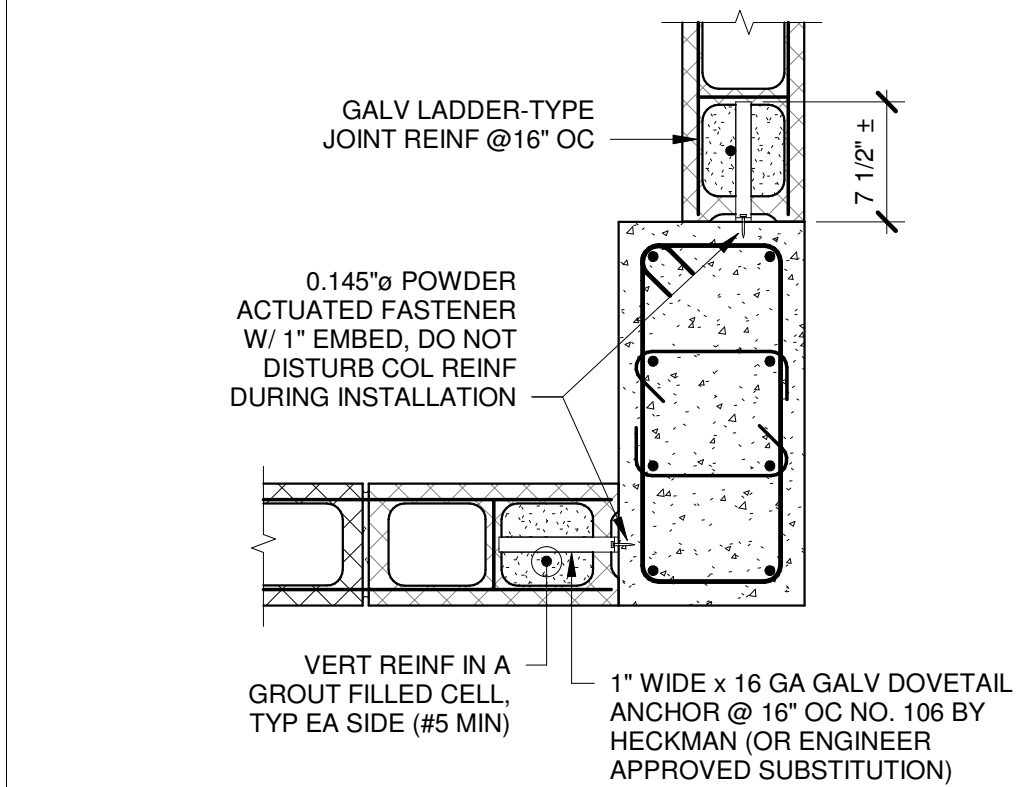

16 CMU ANCHORAGE TO CONCRETE  
1" = 1'-0"

THE  
**LUNZ**  
GROUP



George F. Young, Inc.

1408 N WESTSHORE BLVD, TAMPA, FL 33607  
PHONE (727) 822-4317 WWW.GEORGEFYOUNG.COM  
ENGINEERING CERTIFICATE OF AUTHORIZATION NUMBER 21  
CIVIL, TRANSPORTATION, SUBSURFACE & STRUCTURAL ENGINEERING  
ECOLOGY | GIS | PLANNING | SURVEYING  
ST. PETERSBURG • LAKEWOOD RANG • TAMPA • GAINSVILLE • LAKE WALES  
PUNTA GORDA

HCSO MENTAL HEALTH POD - JIA

2310 N. FALKENBURG ROAD  
TAMPA, FLORIDA 33619

TYPICAL MASONRY DETAILS

NOT FOR CONSTRUCTION		
#	ISSUED FOR	DATE
	REVIEW	08.14.2024
	PERMIT/BD	08.30.2024
	ADDENDUM #4	09.04.2024

DRAWN BY: GYF  
REVIEW BY: YA / DD

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED


58 Lake Morton Dr  
Lakeland, FL 33801  
P 888.682.1082  
F 888.687.5346  
E: ALUNZ@LUNZ.COM

lunz.com


24000700TT

S-302




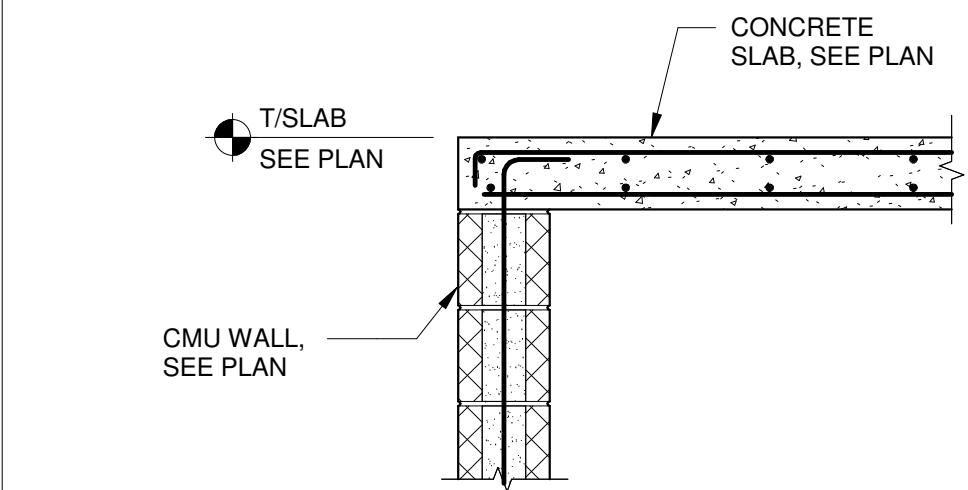


**5** CONCRETE SLAB OVER CMU WALL DETAIL  
3/4" = 1'-0"

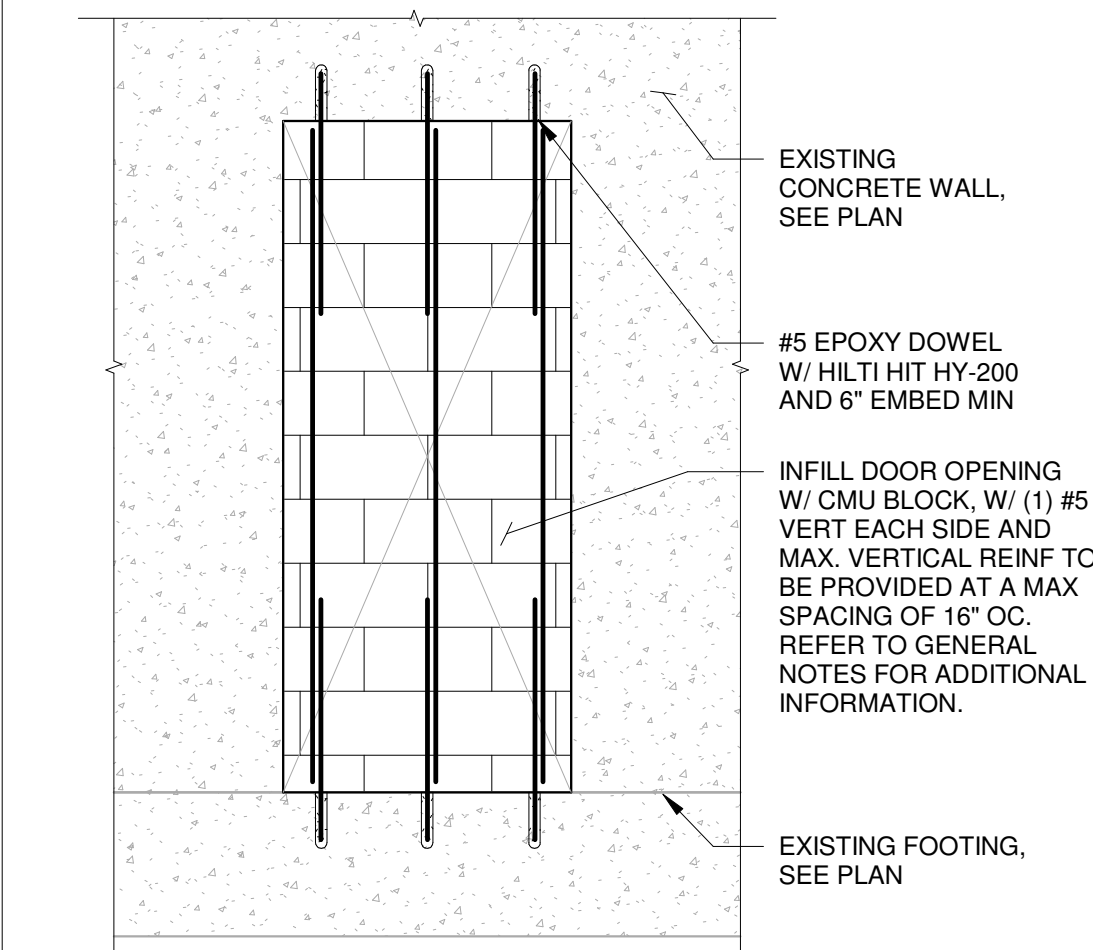


**10** CMU INFIL WALL DETAIL  
1/2" = 1'-0"

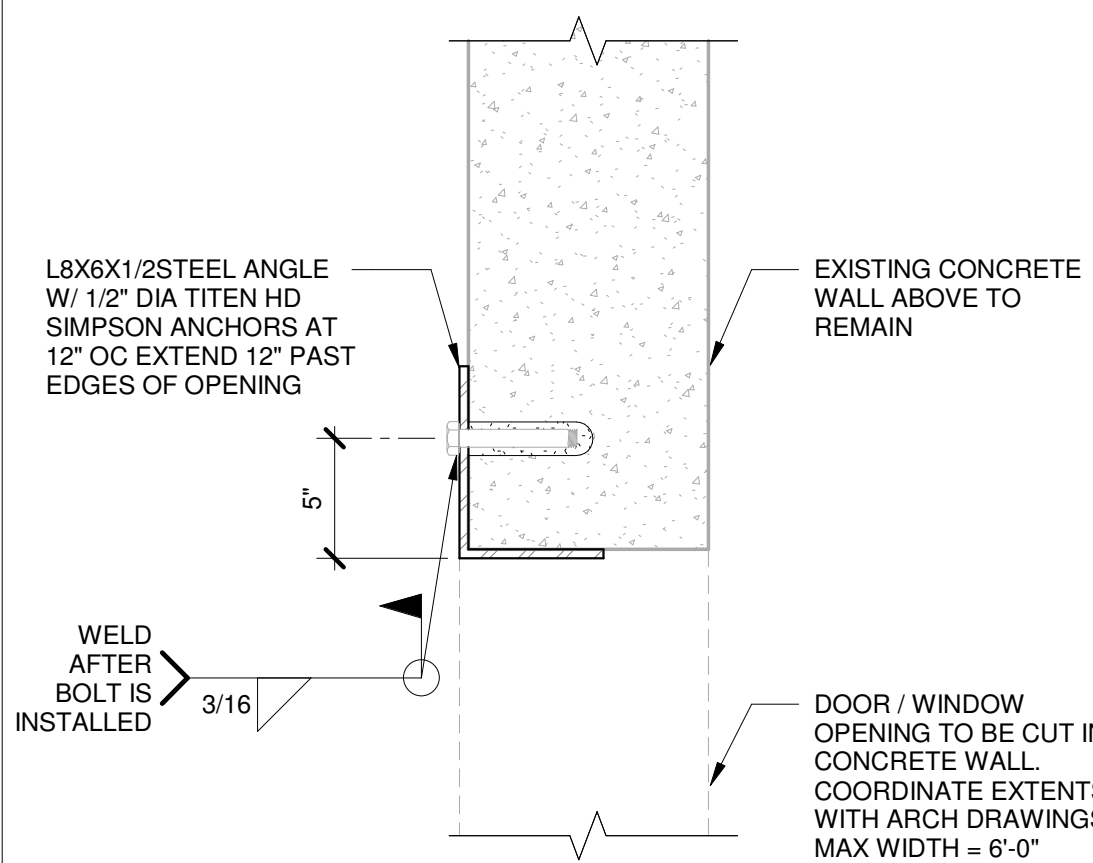


**15** SECTION AT ANGLE SUPPORT TO EXIST CONCRETE WALL  
1 1/2" = 1'-0"

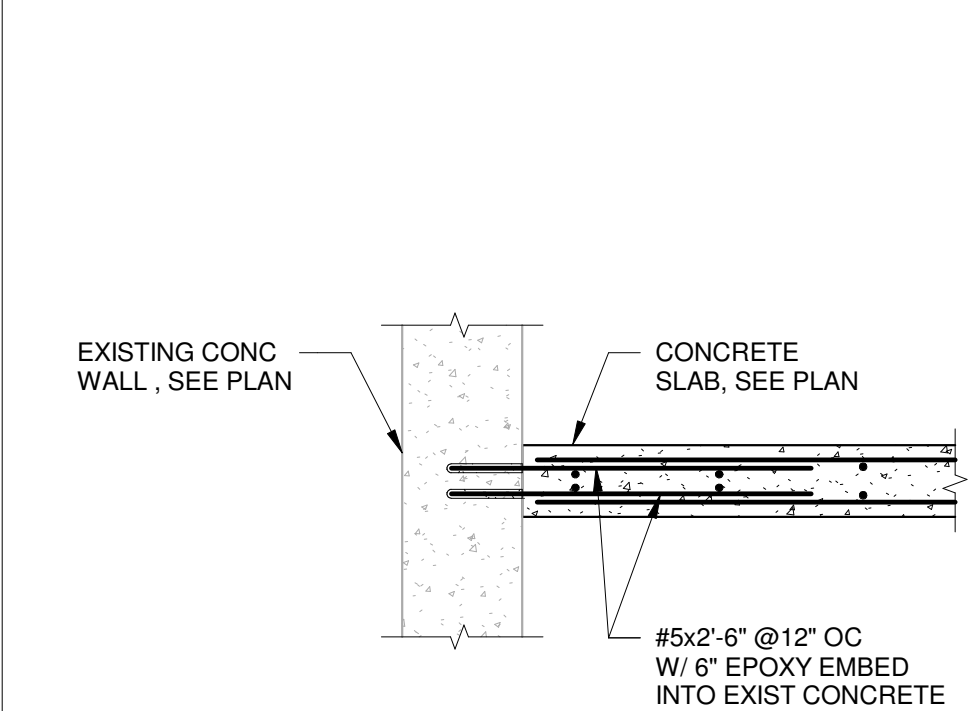


**20** CONCRETE SLAB TO EXISTING CMU WALL DETAIL  
3/4" = 1'-0"

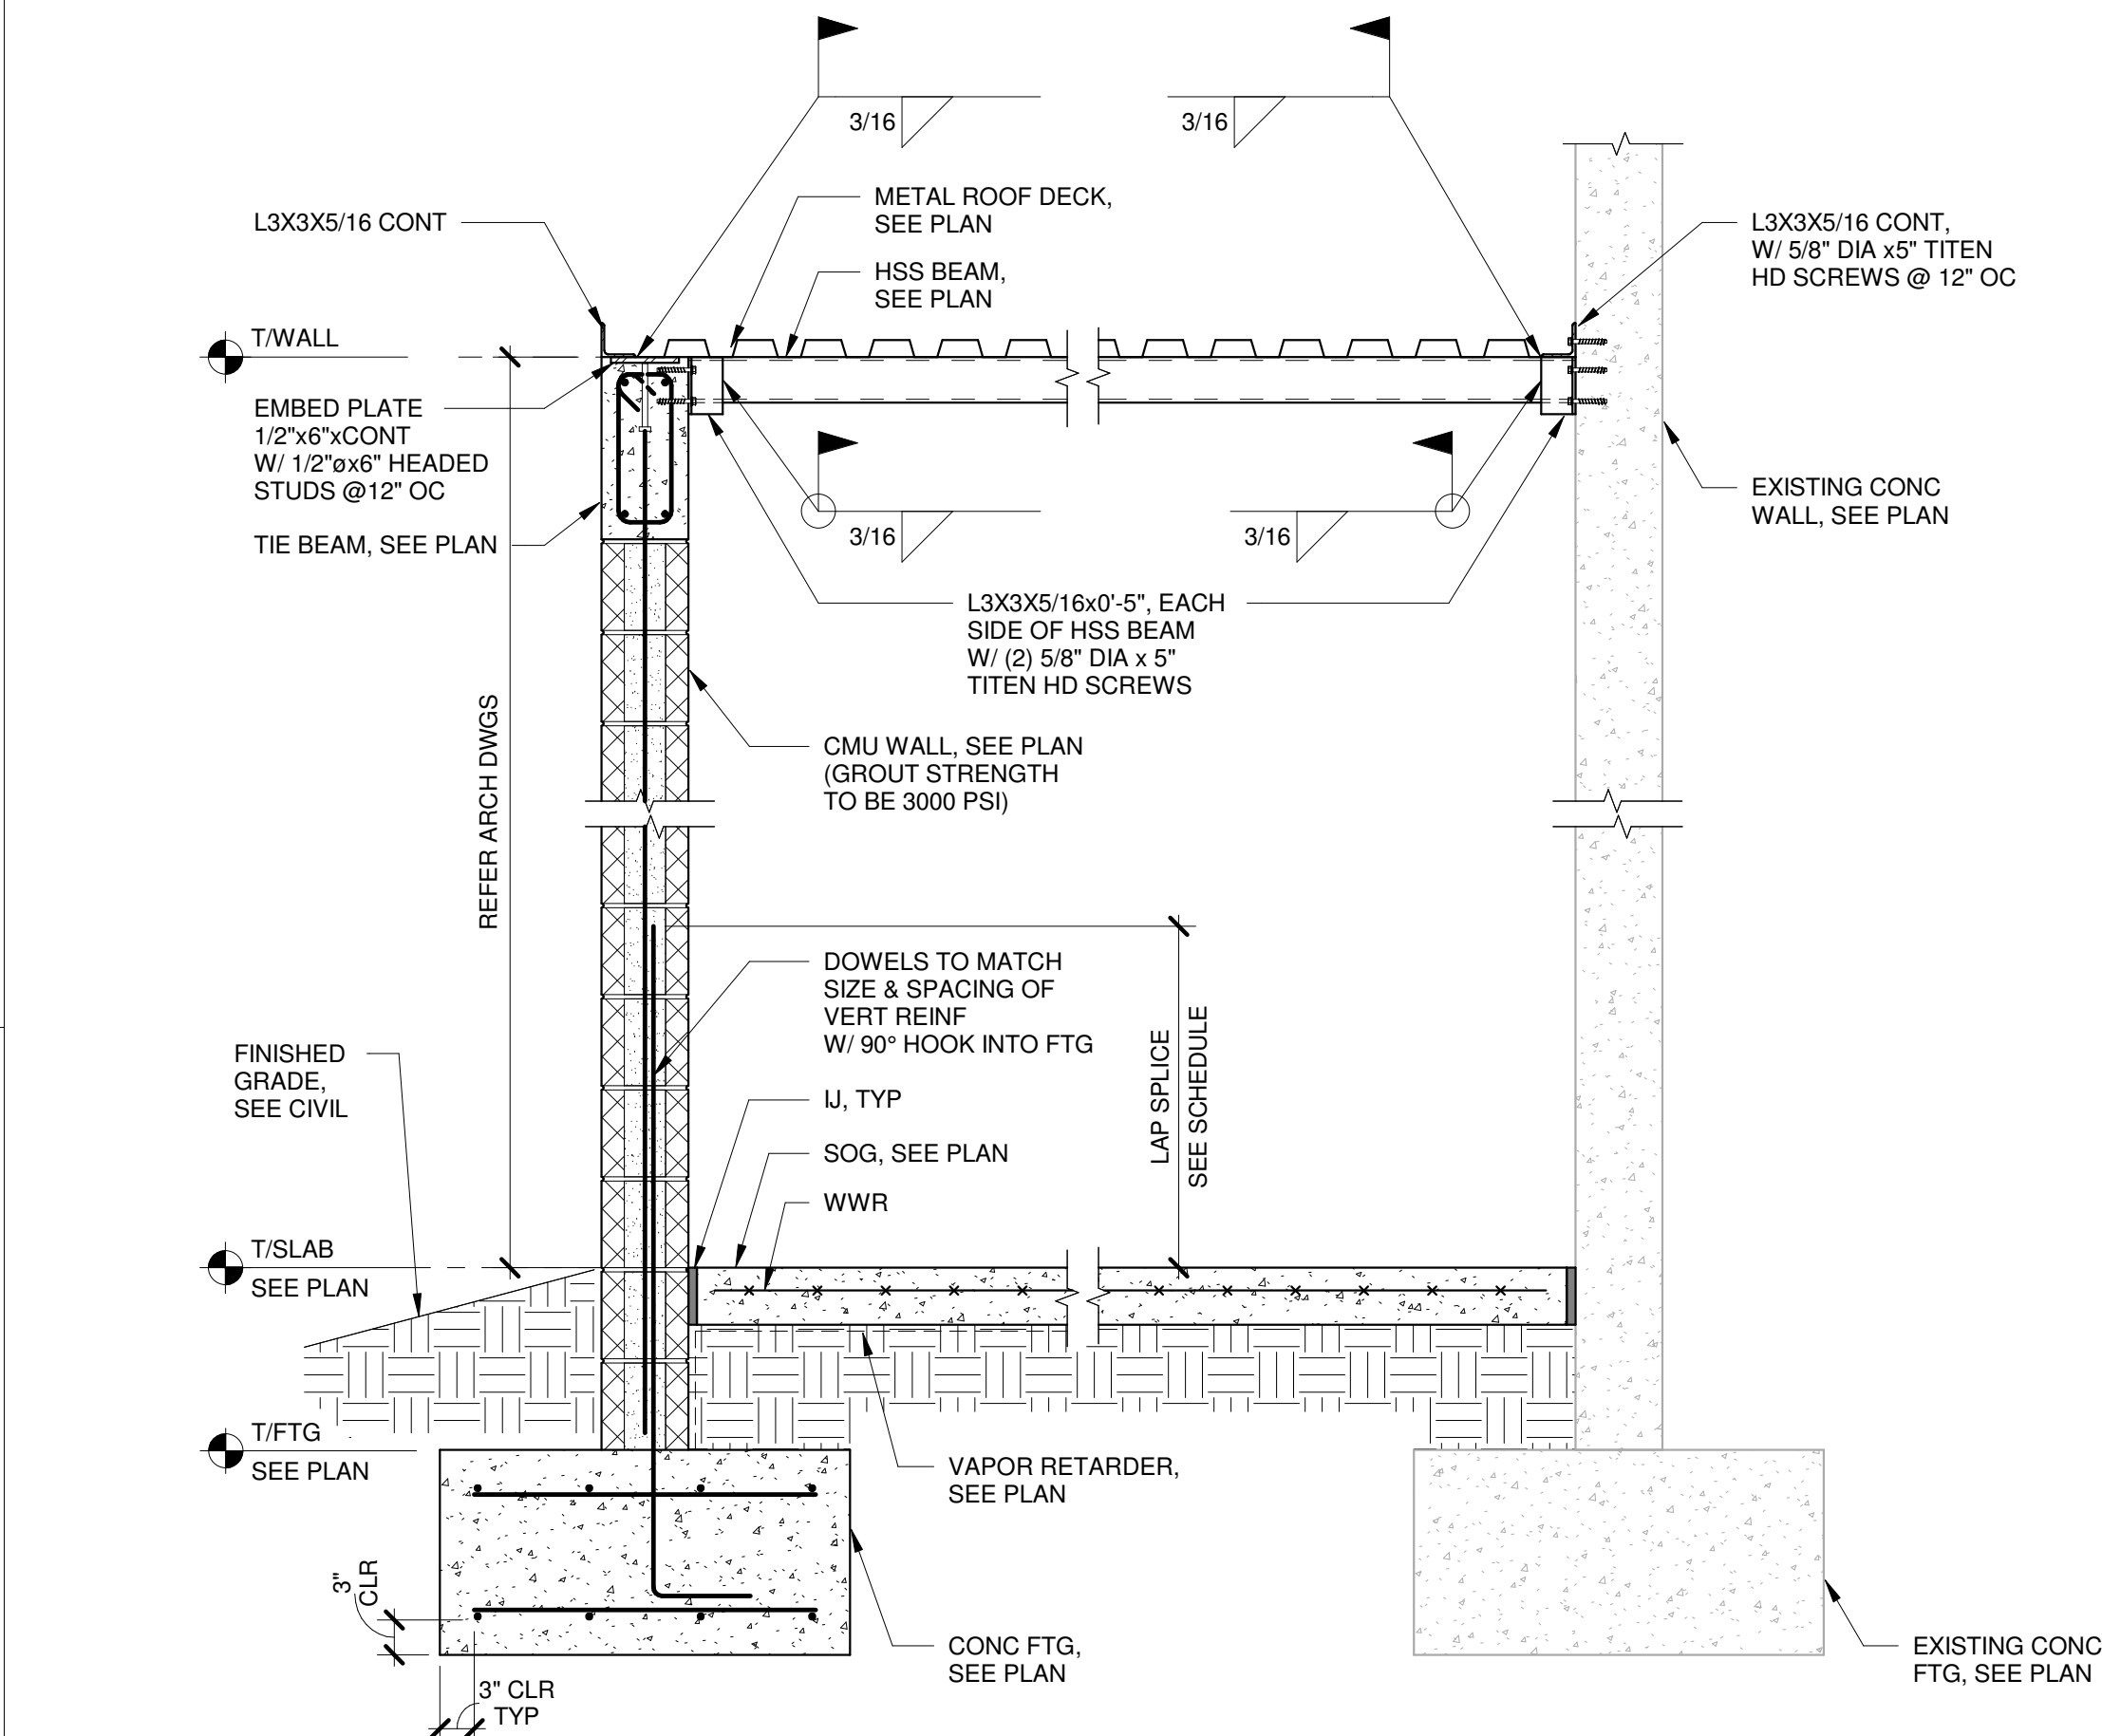


**9** SECTION AT EXERCISE YARD-2  
3/4" = 1'-0"

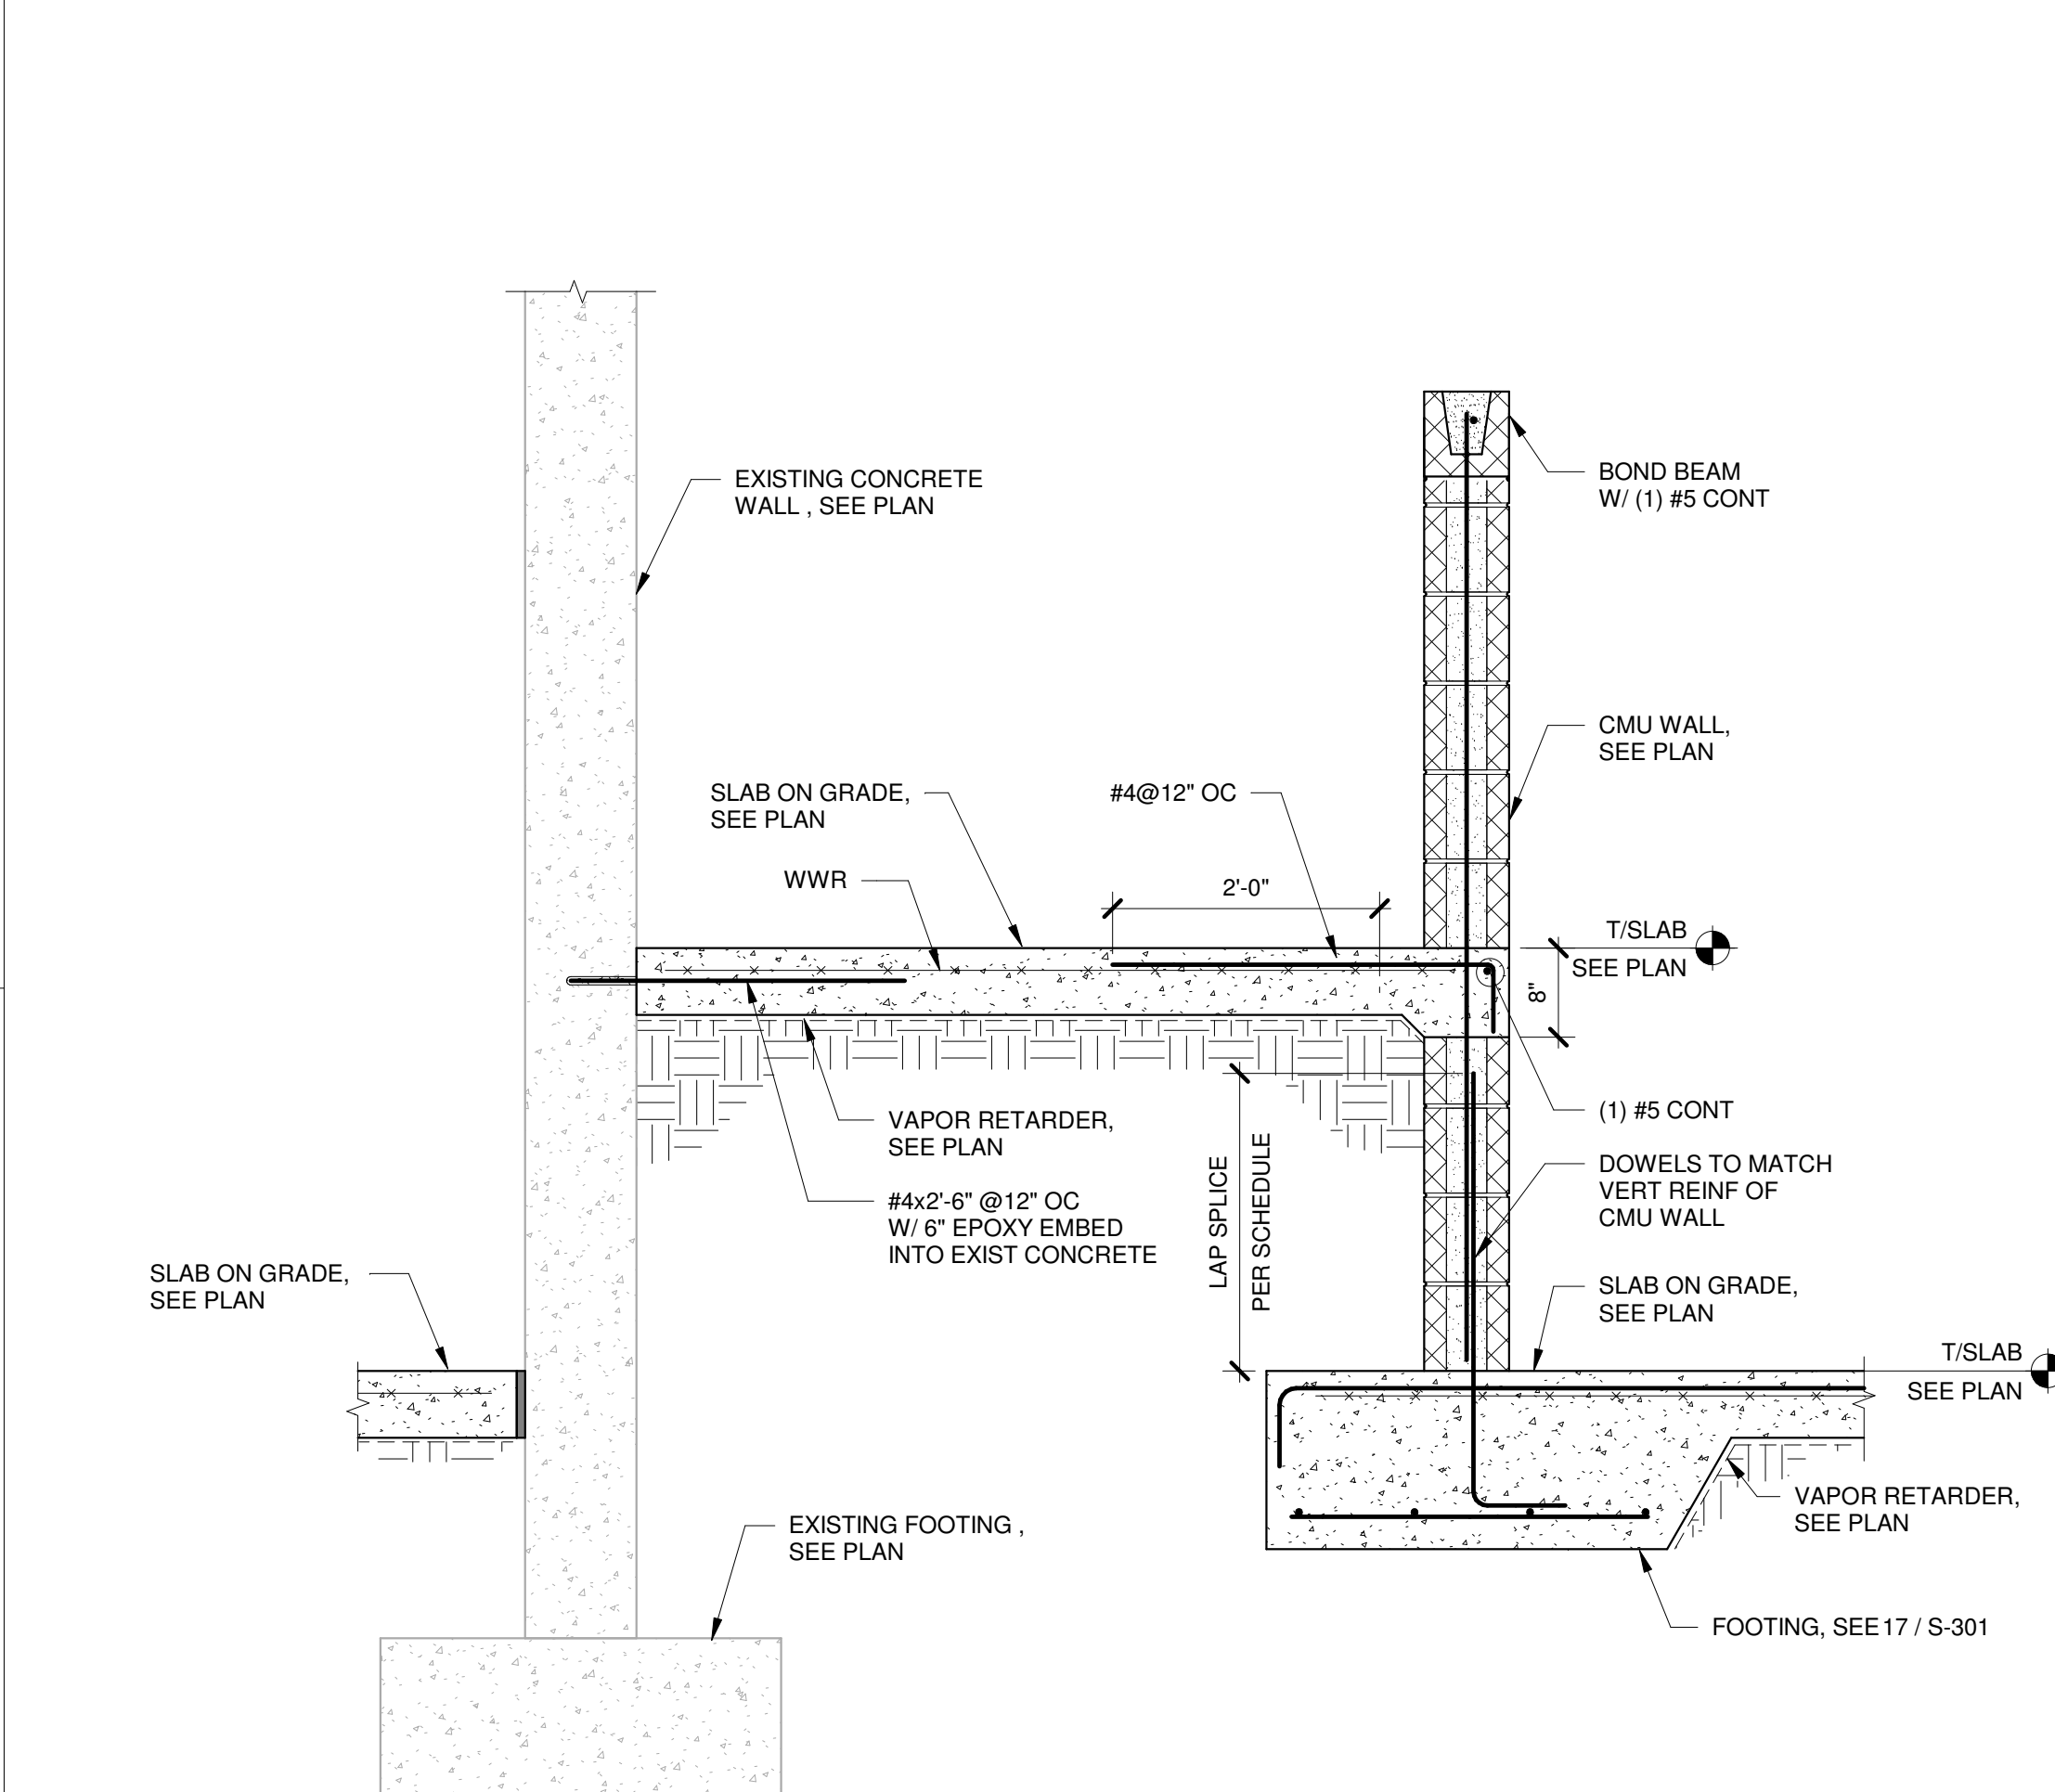

**19** SECTION AT SHERIFF'S STATION  
3/4" = 1'-0"

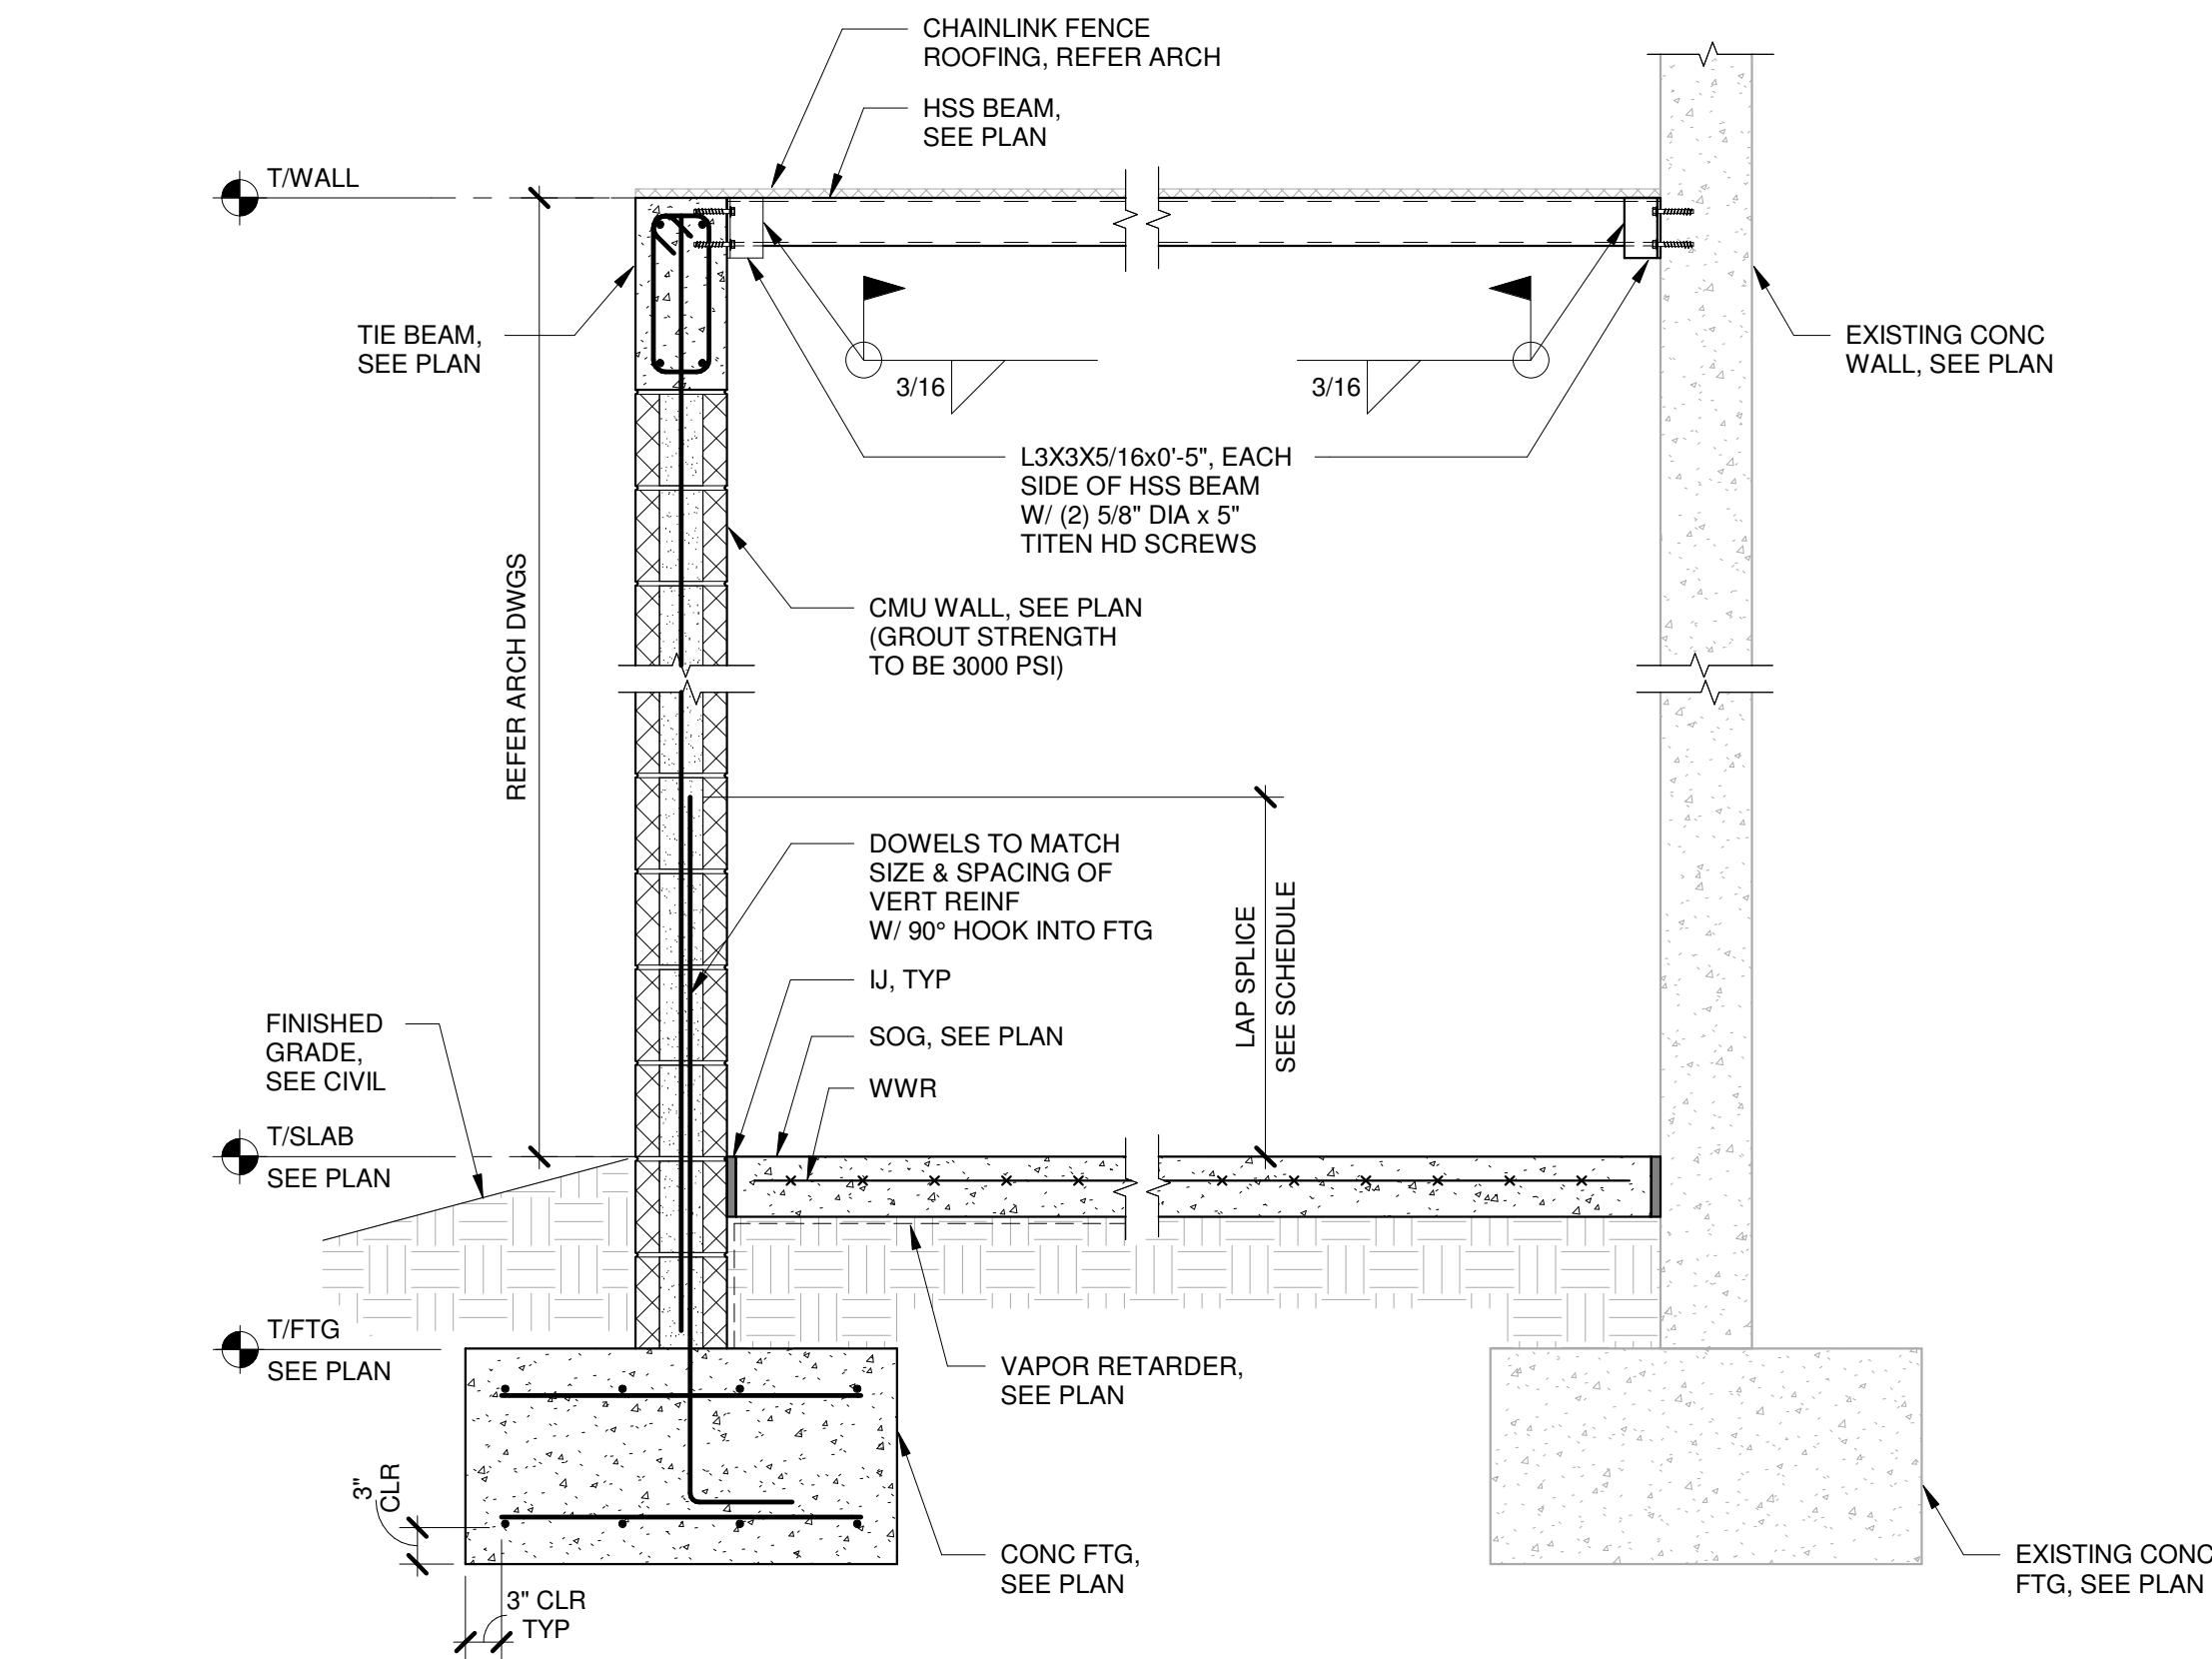

**7** SECTION AT EXERCISE YARD-1  
3/4" = 1'-0"

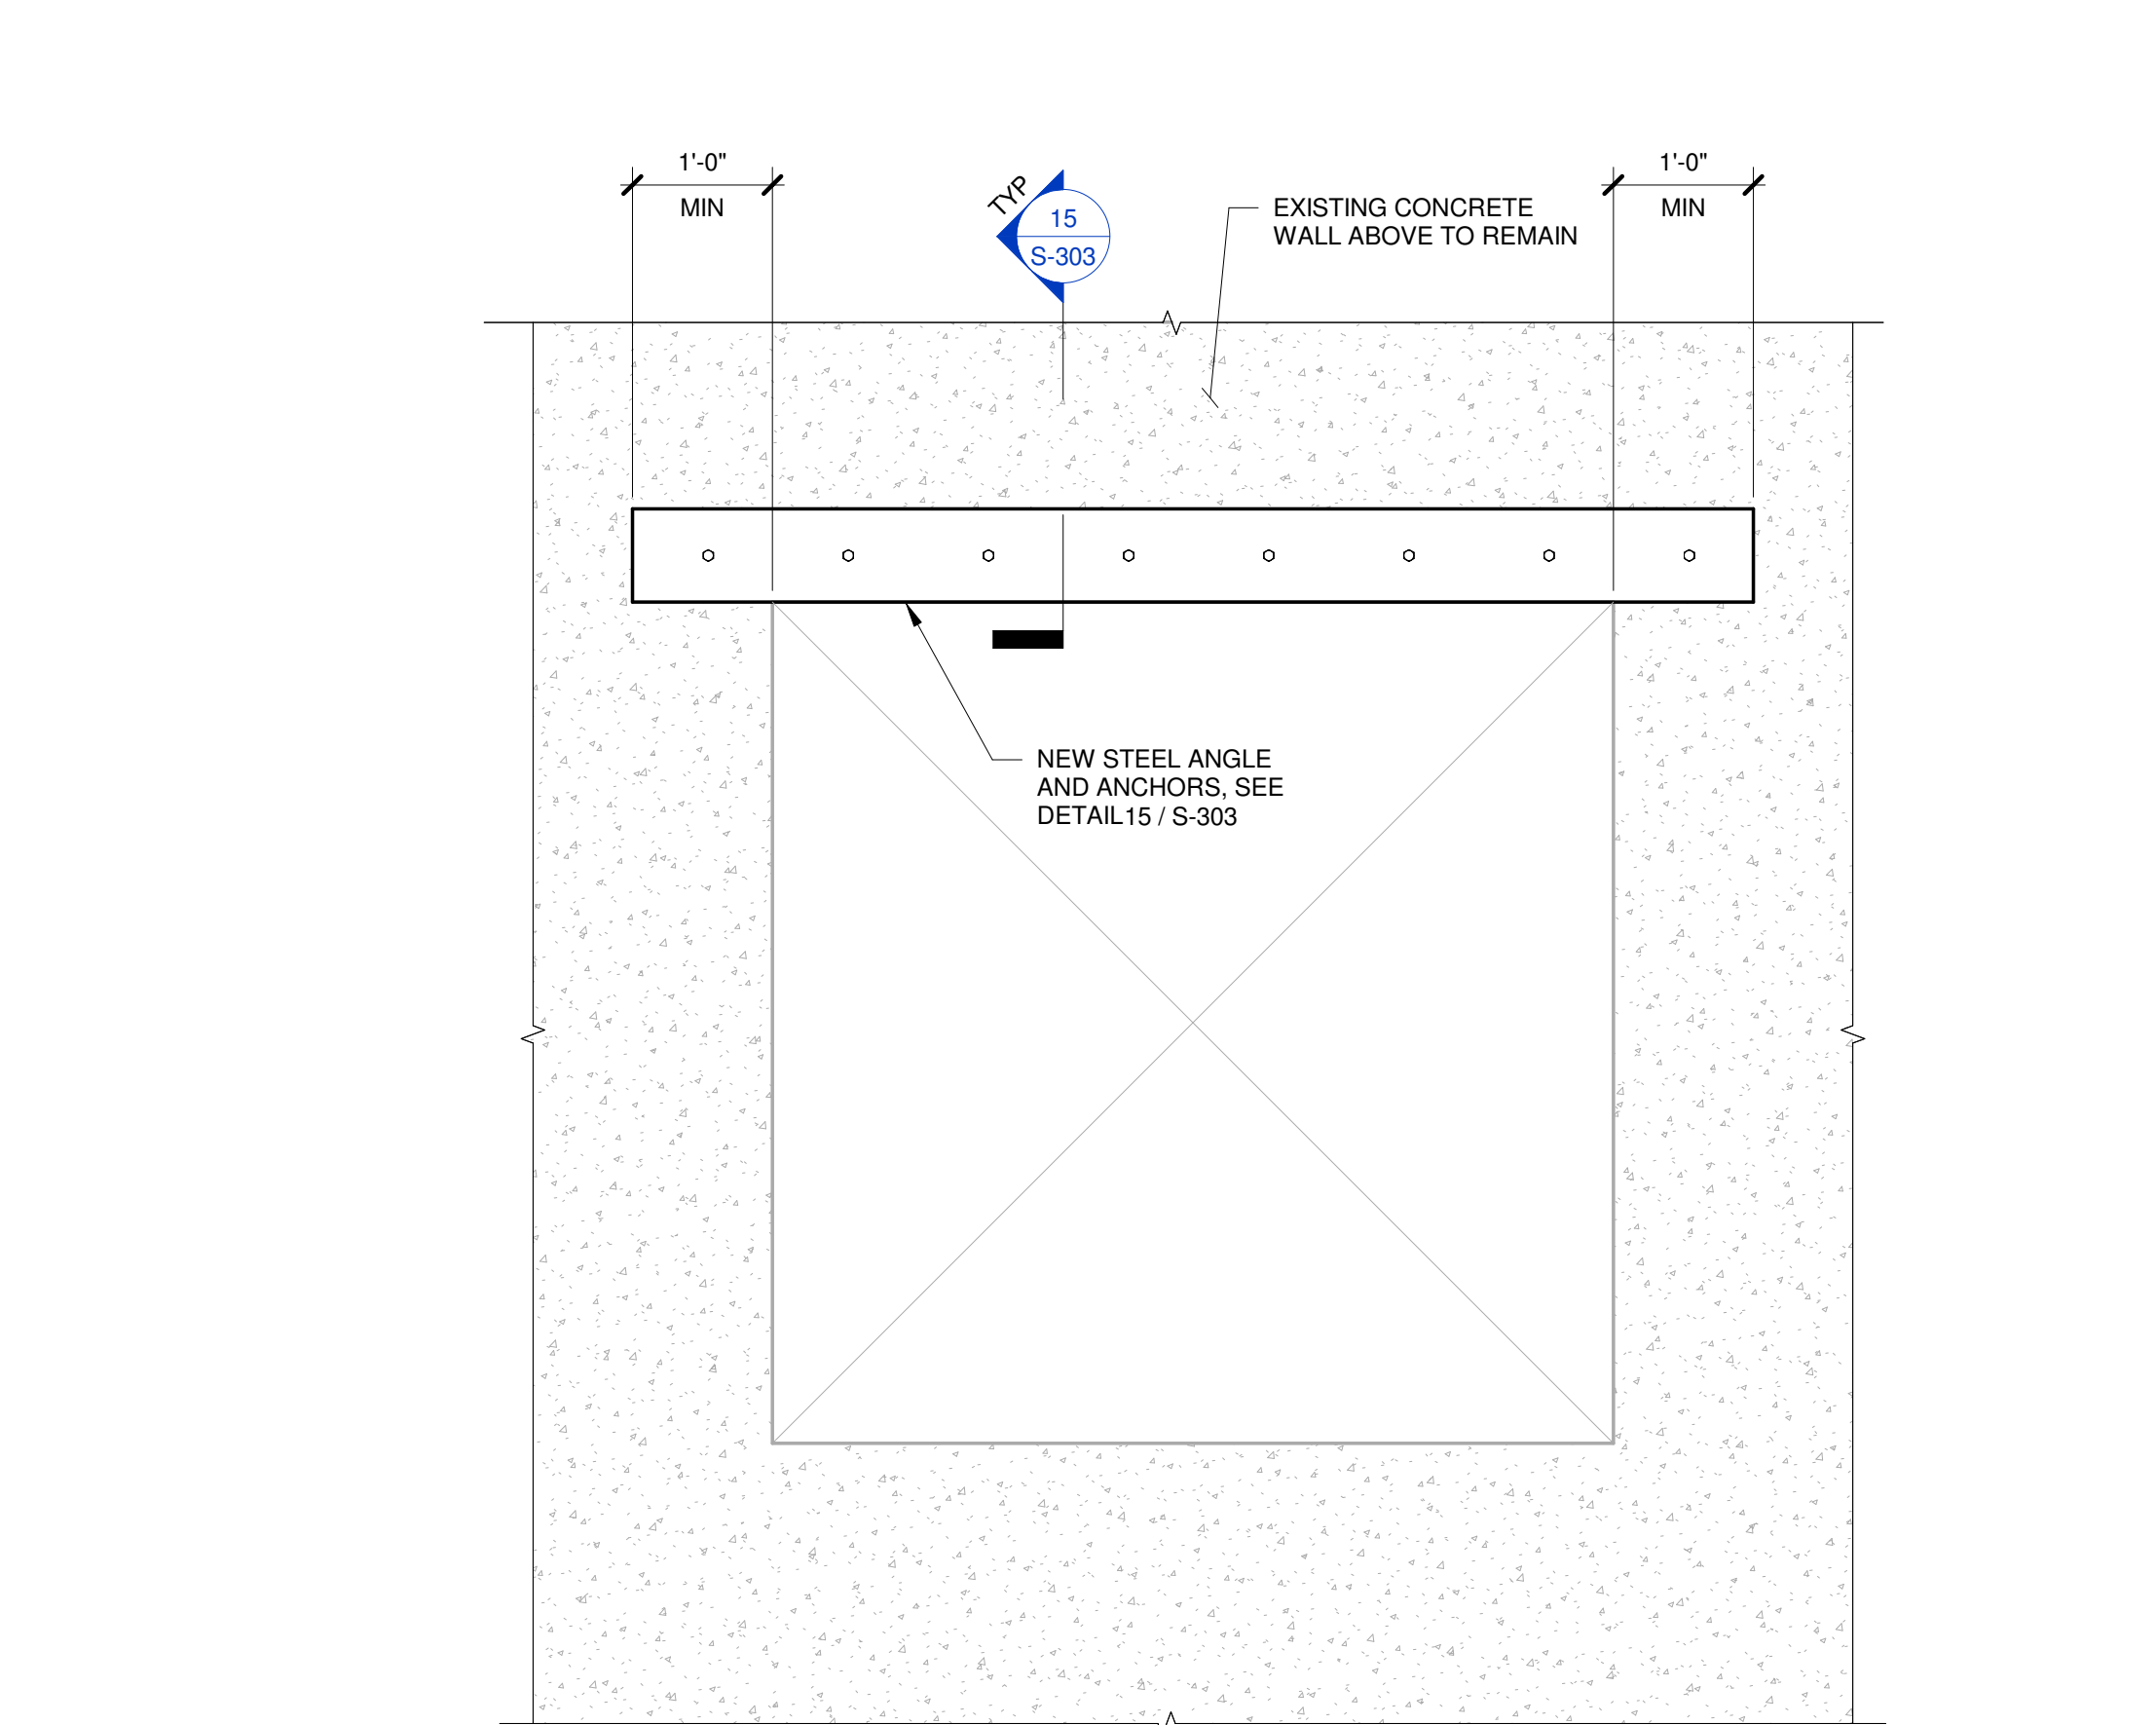

**17** NEW OPENING IN EXISTING CONCRETE WALL  
3/4" = 1'-0"

THE  
**LUNZ**  
GROUP



George F. Young, Inc.

1408 N WESTSHORE BLVD, TAMPA, FL 33607  
PHONE (727) 822-4317 WWW.GEORGEFYOUNG.COM  
ENGINEERING CERTIFICATE OF AUTHORIZATION NUMBER 21  
CIVIL, TRANSPORTATION, SUBSURFACE & STRUCTURAL ENGINEERING  
ECOLOGY | GIS | PLANNING | SURVEYING  
ST. PETERSBURG • LAKEWOOD RANCH • TAMPA • GAINESVILLE • LAKE WALES  
PUNTA GORDA

HCSO MENTAL HEALTH POD - JIA

2310 N. FALKENBURG ROAD  
TAMPA, FLORIDA 33619

SECTIONS & DETAILS

NOT FOR CONSTRUCTION		
#	ISSUED FOR	DATE
	REVIEW	08.14.2024
	PERMIT/BID	08.30.2024
	ADDENDUM #4	09.04.2024

DRAWN BY: GFY  
REVIEW BY: YA / DD

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED


58 Lake Morton Dr  
Lakeland, FL 33801  
P 888.682.1882  
F 888.687.6346  
or 888.684.778

lunz.com


24000700TT

S-303

U:\042024\230104 PM

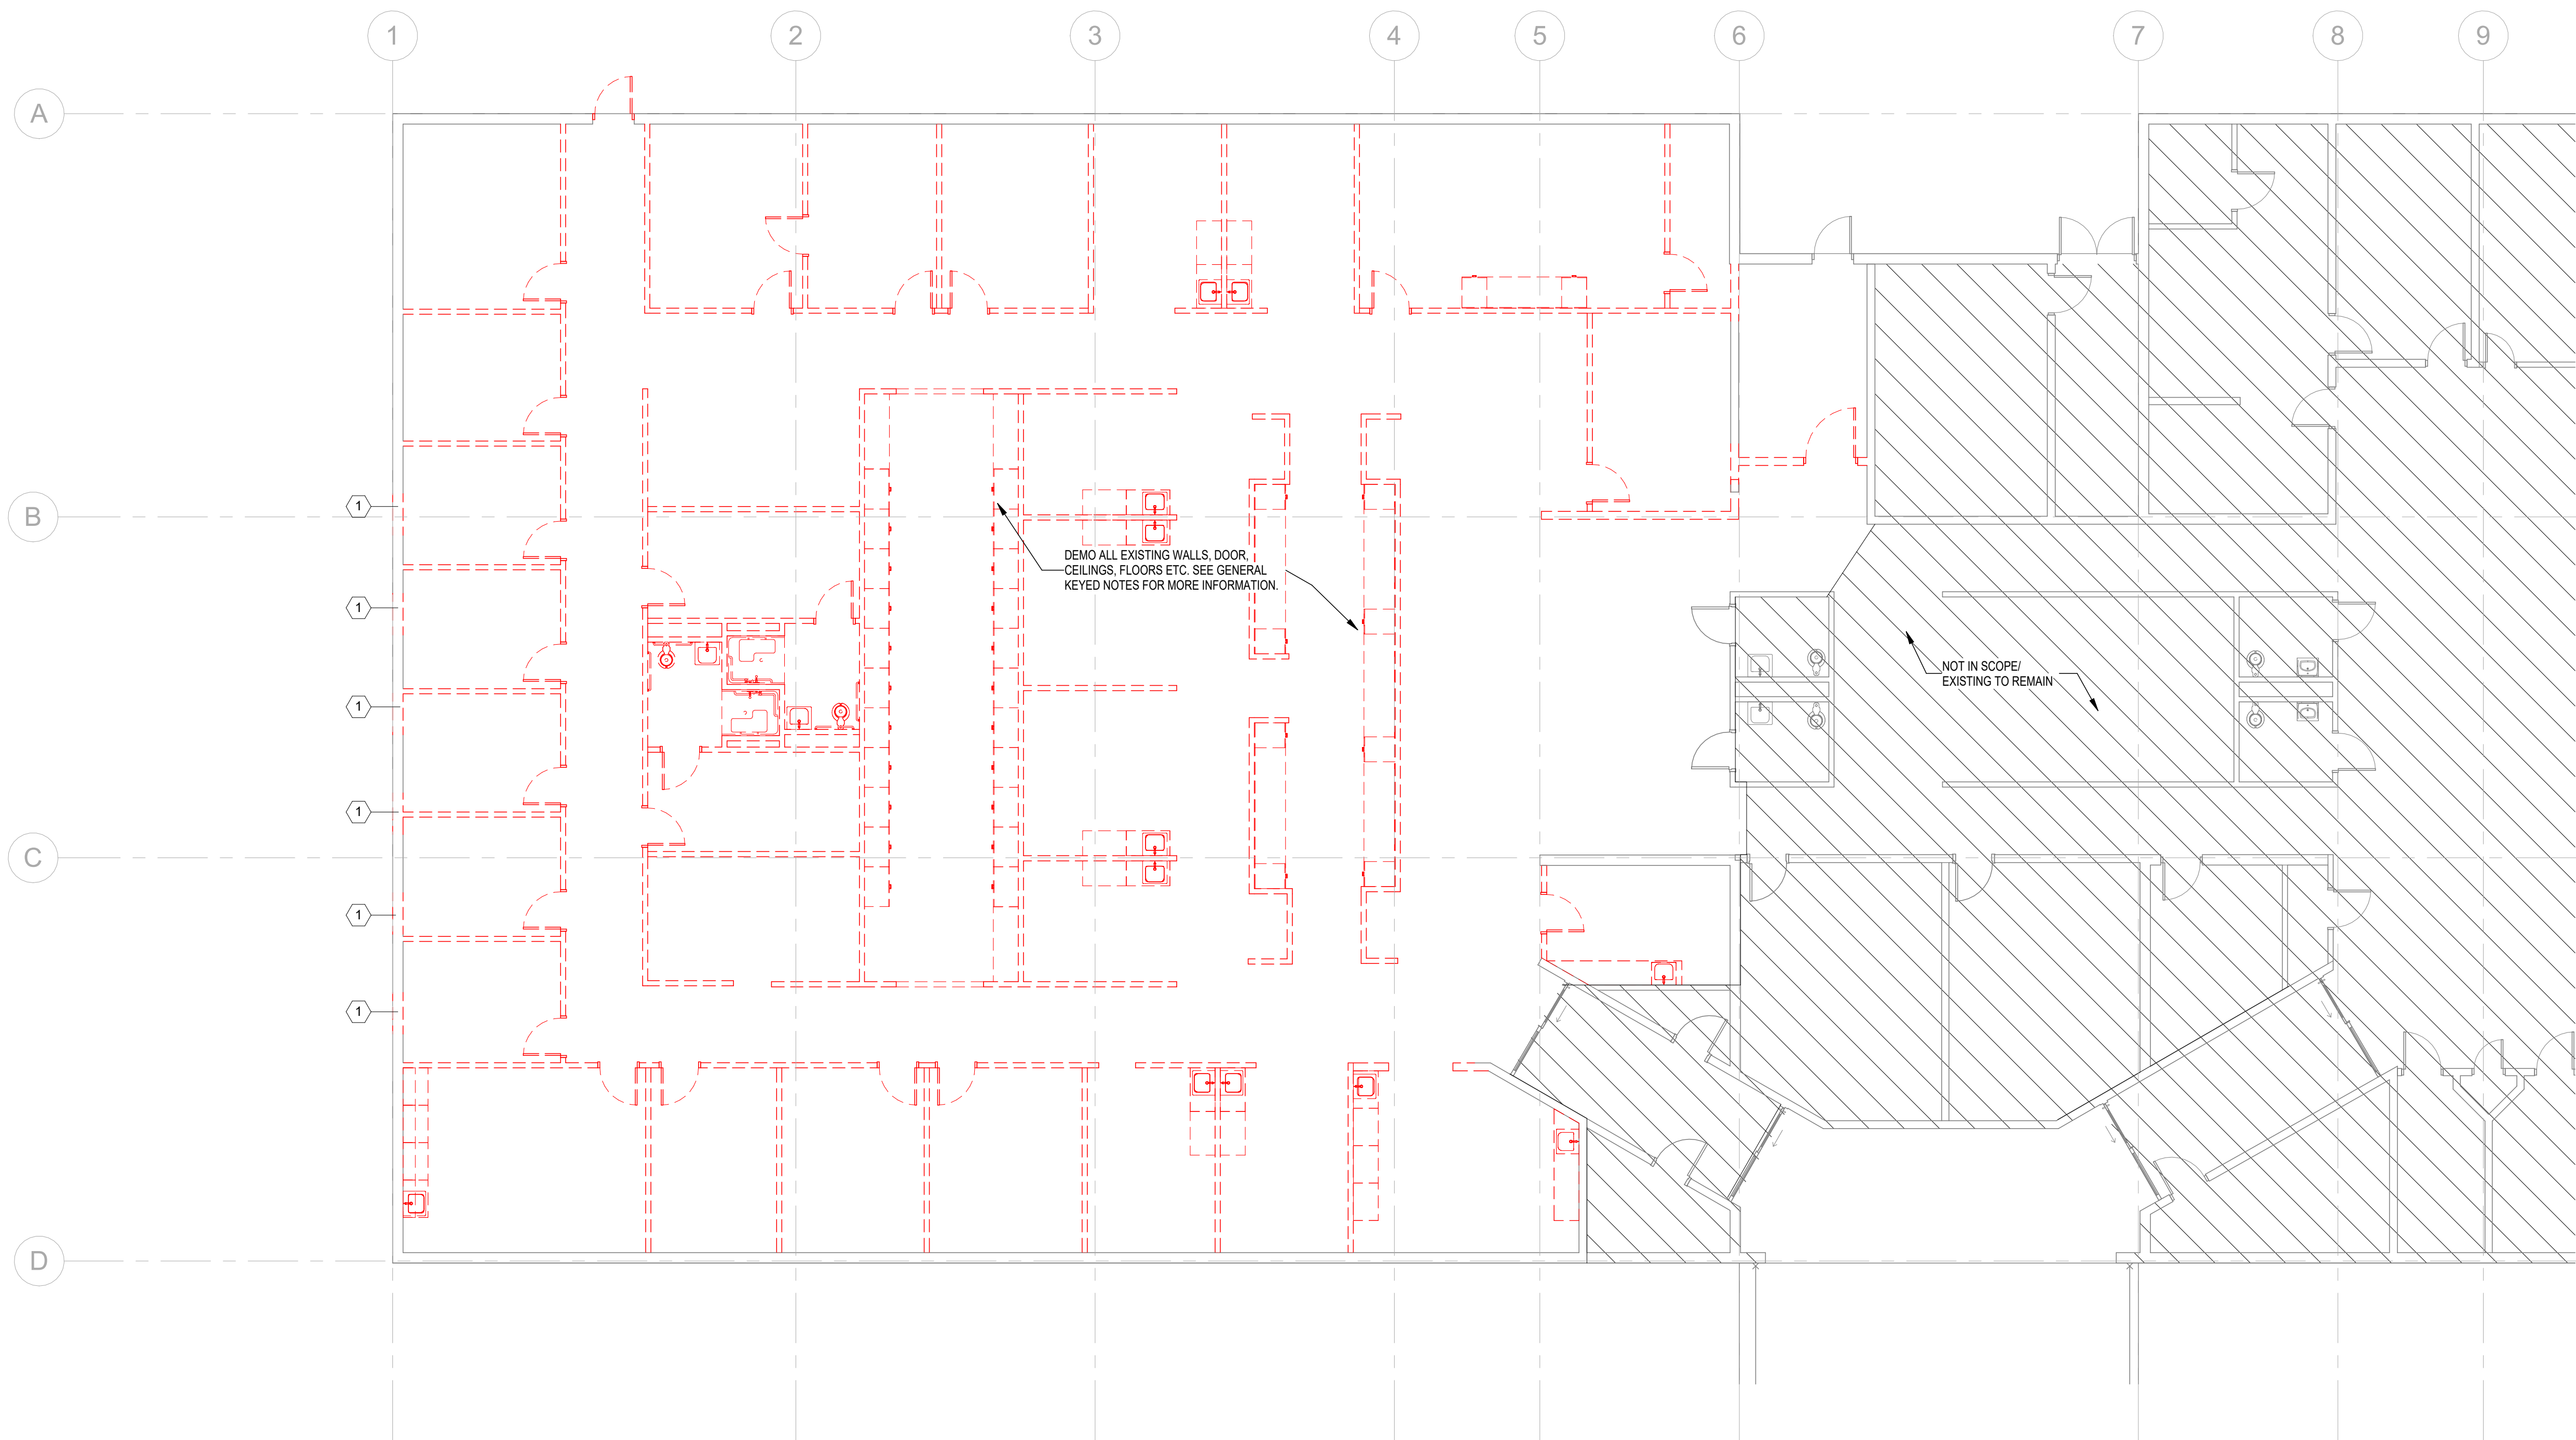

1 DEMOLITION PLAN JIA  
1/8" = 1'-0"

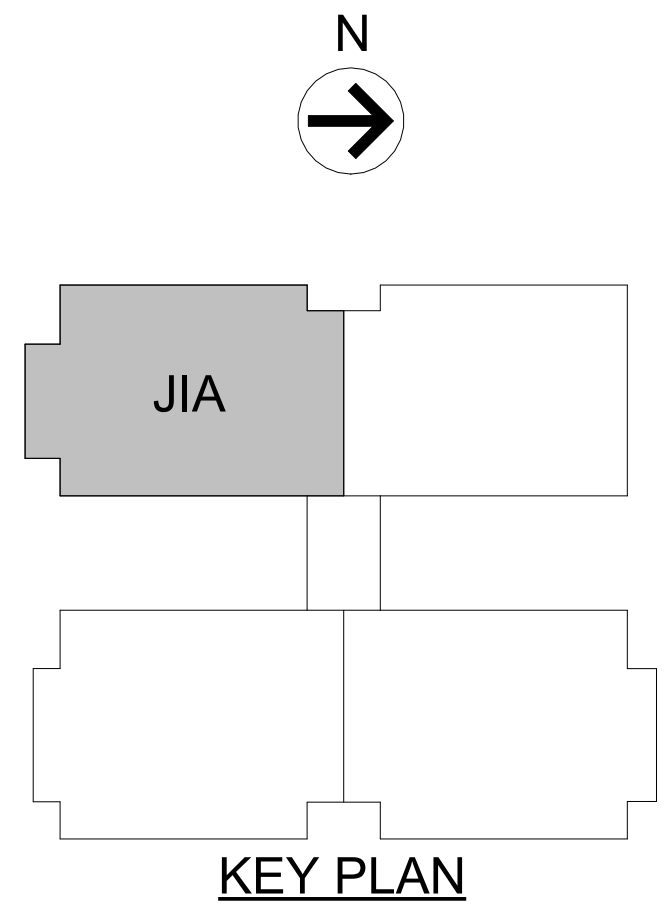

HCSO MENTAL HEALTH POD

520 N FALKENBURG ROAD  
TAMPA, FLORIDA 33619

DEMOLITION PLAN - JIA

#	ISSUED FOR	DATE
	DESIGN DEVELOPMENT	06.20.24
	75% CD (OWNER APPROVAL)	07.26.24
	ADDENDUM #4	09.04.24

DRAWN BY: --  
REVIEW BY: Project Manager  
THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P 863.682.1162  
F 863.687.6346  
LC AR04778

lunz.com


24001.01

AD-101A




- GENERAL SHEET NOTES:

1. CONTRACTOR TO VERIFY ALL DIMENSIONS, NOTIFY ARCHITECT WITH ANY DIMENSIONAL CONFLICTS.
2. FURNITURE SHOWN FOR REFERENCE ONLY. NOT INCLUDED IN SCOPE OF WORK. ALL FF&E, INCLUDING INMATE BEDS, TABLES, AND CHAIRS, TO BE OWNER FURNISHED AND CONTRACTOR INSTALLED (OFC)
3. SEE G-005 FOR WALL DESIGN DETAILS AND REQUIREMENTS.

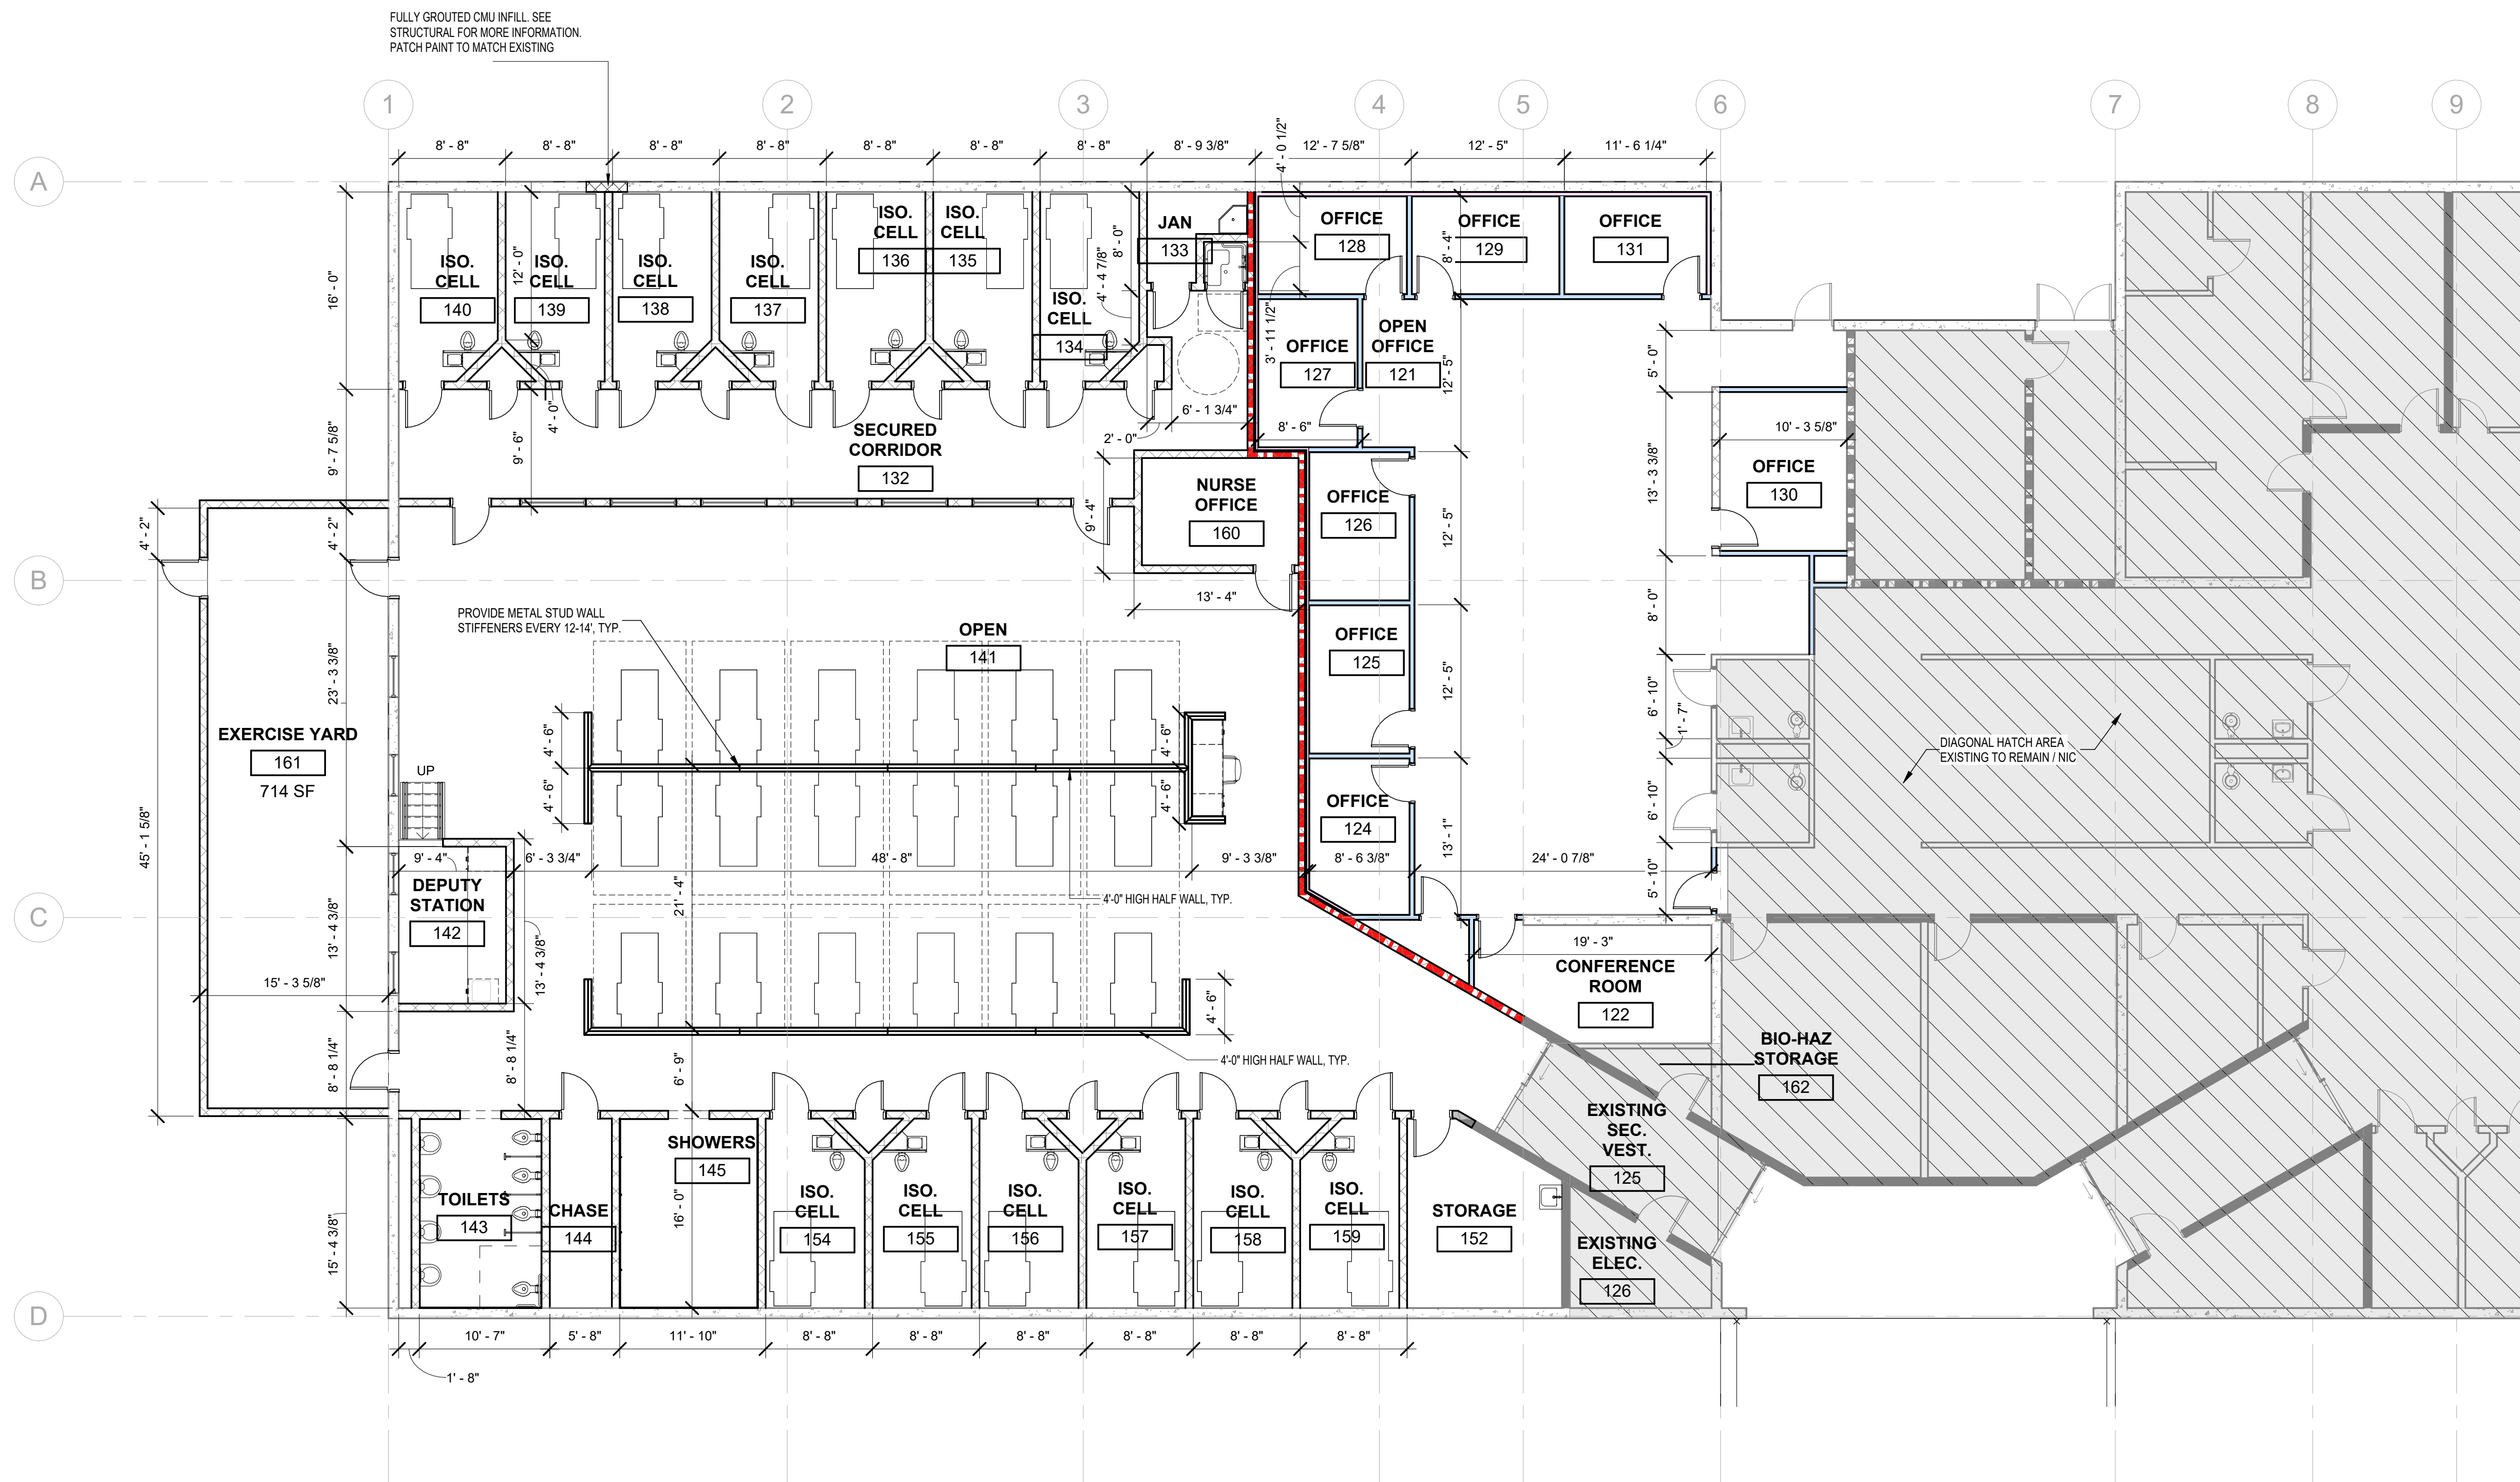

N  
→

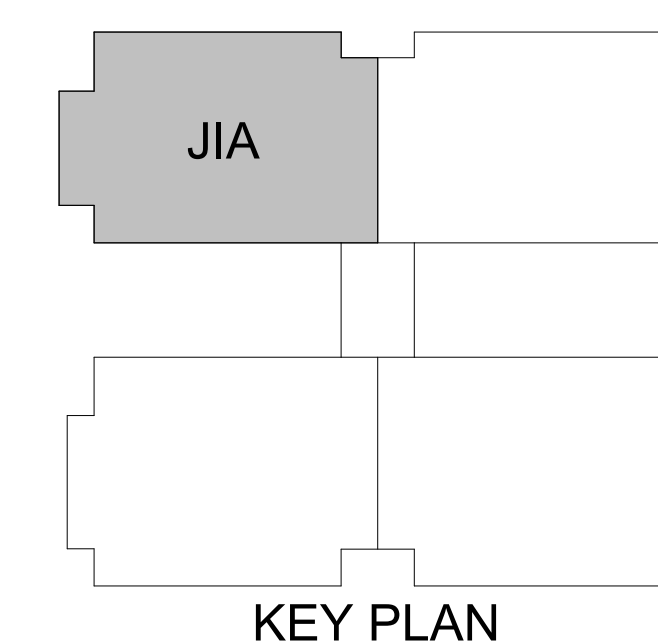

HCSO MENTAL HEALTH POD

520 N FALKENBURG ROAD  
TAMPA, FLORIDA 33619

## DIMENSION FLOOR PLAN - JIA

[illegible]

DRAWN BY: --  
REVIEW BY: Project  
Manager

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
p 863.682.1882  
f 863.687.6346  
lic. AR94778


lunz.com

24001.01

A-101A

1. CONTRACTOR TO VERIFY ALL DIMENSIONS, NOTIFY ARCHITECT WITH ANY DIMENSIONAL CONFLICTS.
2. FURNITURE SHOWN FOR REFERENCE ONLY. NOT INCLUDED IN SCOPE OF WORK. ALL FF&E, INCLUDING INMATE BEDS, TABLES, AND CHAIRS, TO BE OWNER FURNISHED AND CONTRACTOR INSTALLED (OFCI)
3. SEE G-005 FOR WALL DESIGN DETAILS AND REQUIREMENTS.

THE  
**LUNZ**  
GROUP



JIA

## KEY PLAN

1 ANNOTATED FLOOR PLAN  
1/8" = 1'-0"

HCSO MENTAL HEALTH POD

520 N FALKENBURG ROAD  
TAMPA, FLORIDA 33619

# ANNOTATED FLOOR PLAN - JIA

[illegible]

DRAWN BY: --  
REVIEW BY: Project  
Manager  
THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
p 863.682.1882  
f 863.687.6346  
lic. AR94778

lunz.com

24001.01



A-102A



- CEILING GENERAL NOTES:
1. SEE ELECTRICAL DRAWINGS FOR EXACT LOCATION OF LIGHT FIXTURES
  2. SEE MECHANICAL DRAWINGS FOR LOCATION OF DIFFUSERS / RETURNS
  3. COORDINATE LOCATION OF FIXTURES AND MECHANICAL COMPONENTS WITH MECHANICAL / ELECTRICAL DRAWINGS IN REFERENCE TO ARCHITECTURAL LAYOUT. IN THE EVENT OF CONFLICTS CONTACT ARCHITECT.
  4. CEILING GRID SHOWN FOR REFERENCE ONLY. CONTRACTOR TO COORDINATE WITH THE ALIGNMENT SO AS TO KEEP CONTINUOUS GRID LINES AS SYMMETRICAL AS POSSIBLE.
  5. CONTRACTOR TO ALIGN START PATTERN OF GRID TO MINIMIZE SMALLER SIZES OF CEILING GRID.



1 REFLECTED CEILING PLAN  
1/8" = 1'-0"

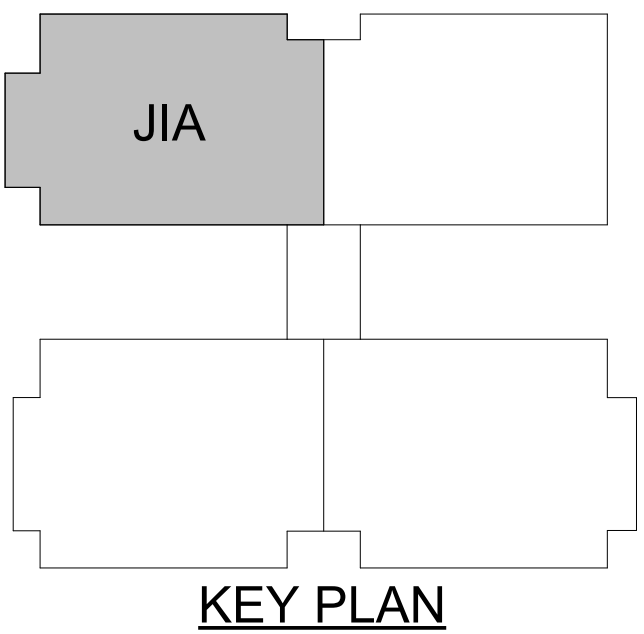

HCSO MENTAL HEALTH POD

520 N FALKENBURG ROAD  
TAMPA, FLORIDA 33619

REFLECTED CEILING PLAN - JIA

#	ISSUED FOR	DATE
1	DESIGN DEVELOPMENT	06.20.24
2	75% CD (OWNER APPROVAL)	07.26.24
3	PERMIT/BID	08.30.24
4	ADDENDUM #4	09.04.24

DRAWN BY: --  
REVIEW BY: Project Manager  
THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P 883.682.1862  
F 883.687.6346  
LIC. AR044778


lunz.com

24001.01

A-111A





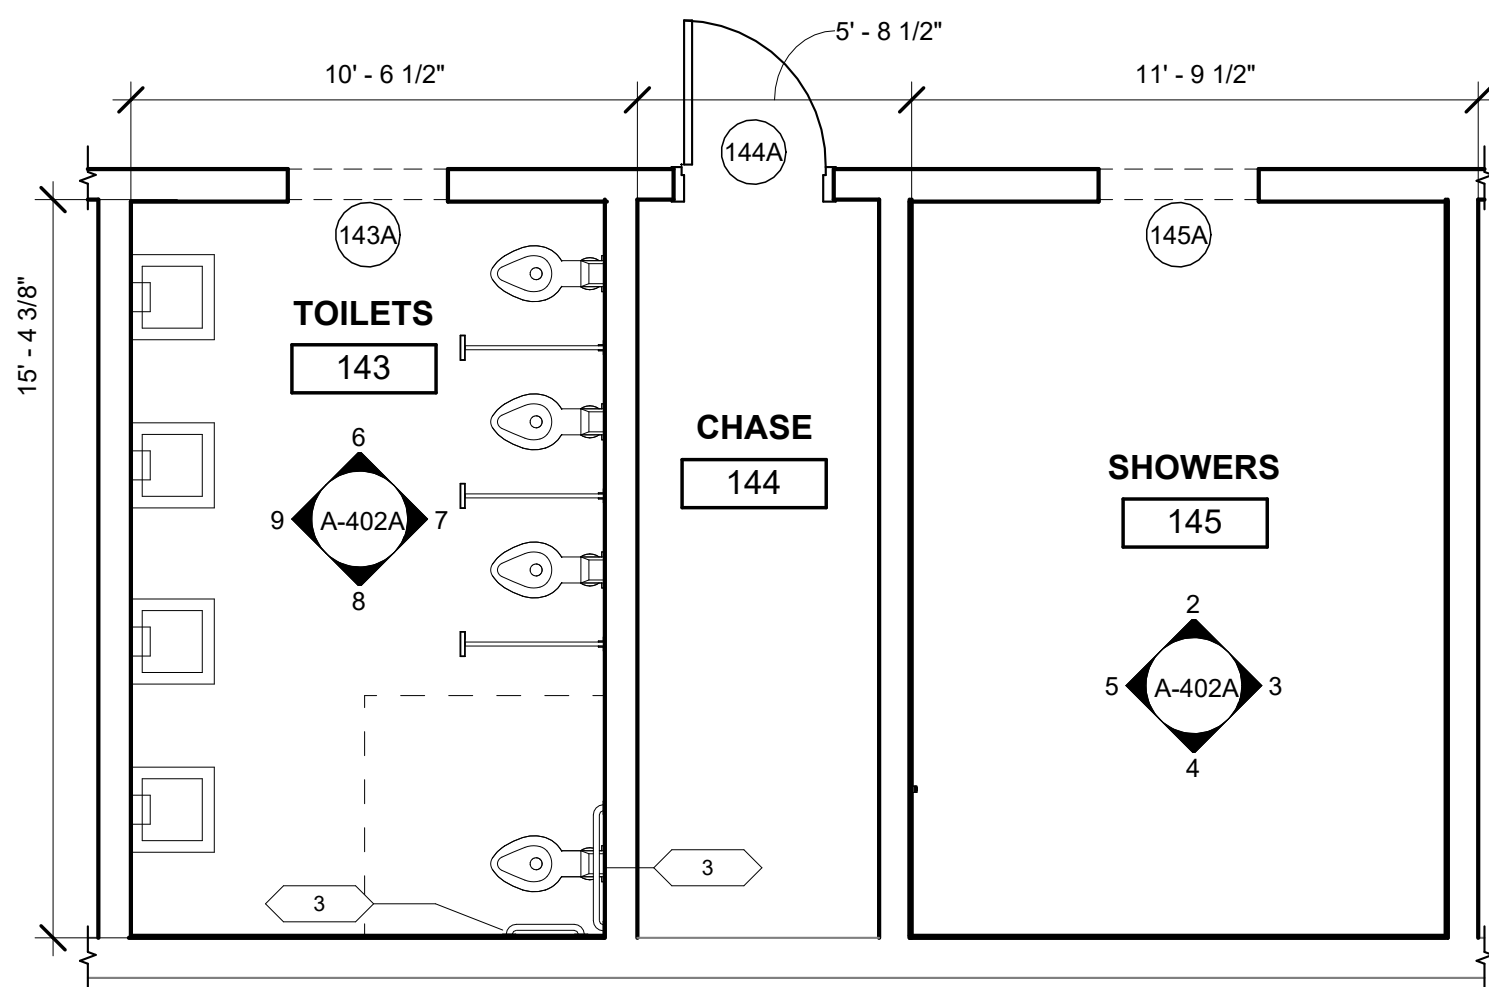


1 ENLARGED RESTROOM PLAN  
1/4" = 1'-0"

TOILET ACCESSORIES			
MARK	DESCRIPTION	MANUFACTURER	COMMENTS
1	STAINLESS STEEL PARTITION		FLOOR TO CEILING MOUNT
2	STAINLESS STEEL SECURITY MIRROR	ACORN, MODEL 1817-A	FRONT MOUNT, INTEGRAL FRAME
3	36"X42" STAINLESS STEEL GRAB BARS		SEE G-300
4	TOILET PAPER HOLDER	ACORN, MODEL 1840	


GENERAL SHEET NOTES

- CONTRACTOR SHALL PROVIDE BLOCKING FOR INSTALLATION OF ACCESSORIES AND GRAB BARS AS REQUIRED.
- ALL RESTROOM ACCESSORIES SHALL BE ADA COMPLIANT. REFER TO G-006 FOR ACCESSORY MOUNTING HEIGHTS.
- ALL EQUIPMENT SHALL BE ADA COMPLIANT. PROVIDE ACCESSORIES SUBMITTAL & CUT SHEET FOR TENANT AND AOR APPROVAL.
- ALL RESTROOM WALLS SHALL RECEIVE TILE AS NOTED IN ELEVATIONS. TILE SHALL RUN ALL THE WAY UP THE WALL.
- TILE IN ELEVATIONS IS TO BE USED FOR LOCATION PURPOSES ONLY. DESIGN OF THE TILE TO BE CHOSEN BY THE TENANT, OWNER, AND AOR.
- EQUIVALENT ACCESSORIES BY BOBRICK OR AMERICAN SPECIALTIES IS ACCEPTABLE.


THE  
**LUNZ**  
GROUP

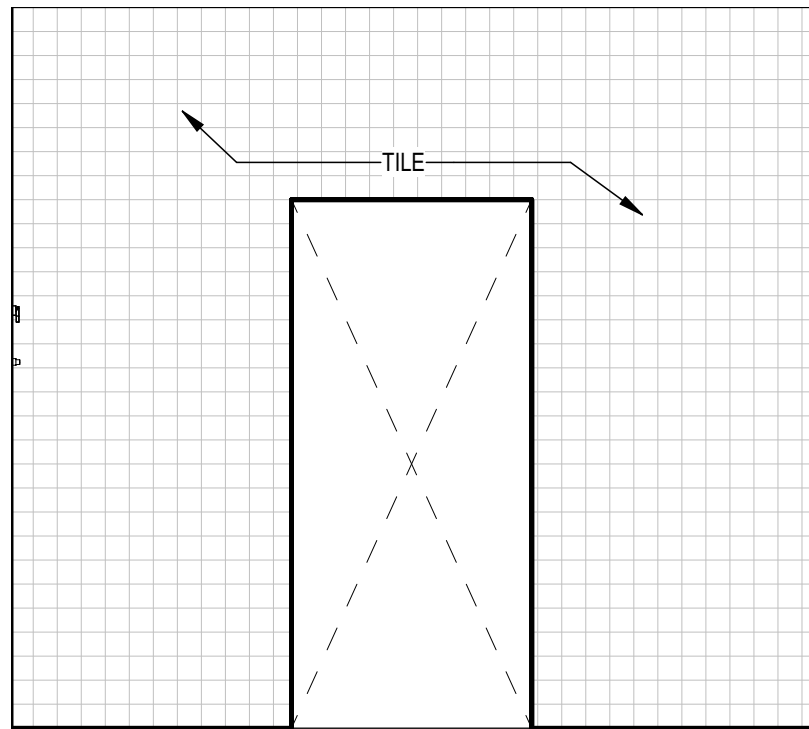


2 SHOWERS 145 ELEV 1  
3/8" = 1'-0"

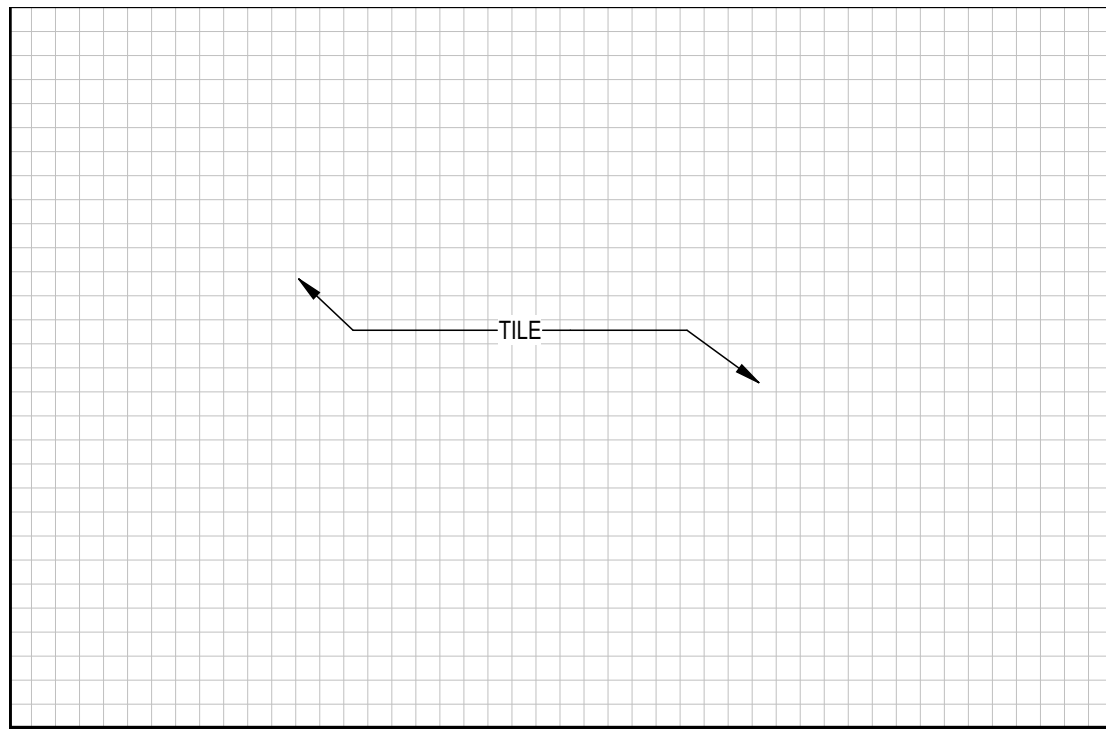


3 SHOWERS 145 ELEV 2  
3/8" = 1'-0"

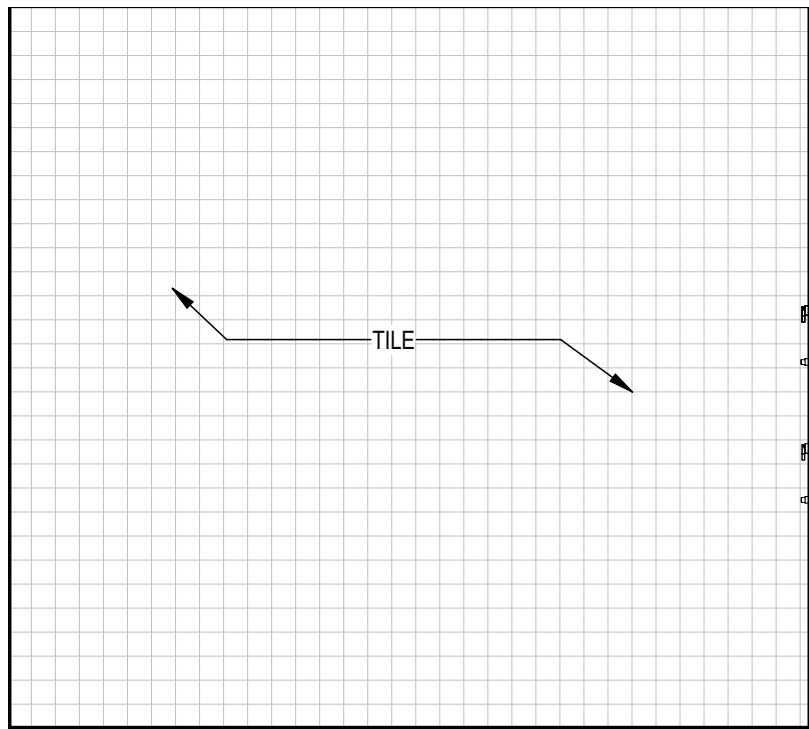


4 SHOWERS 145 ELEV 3  
3/8" = 1'-0"

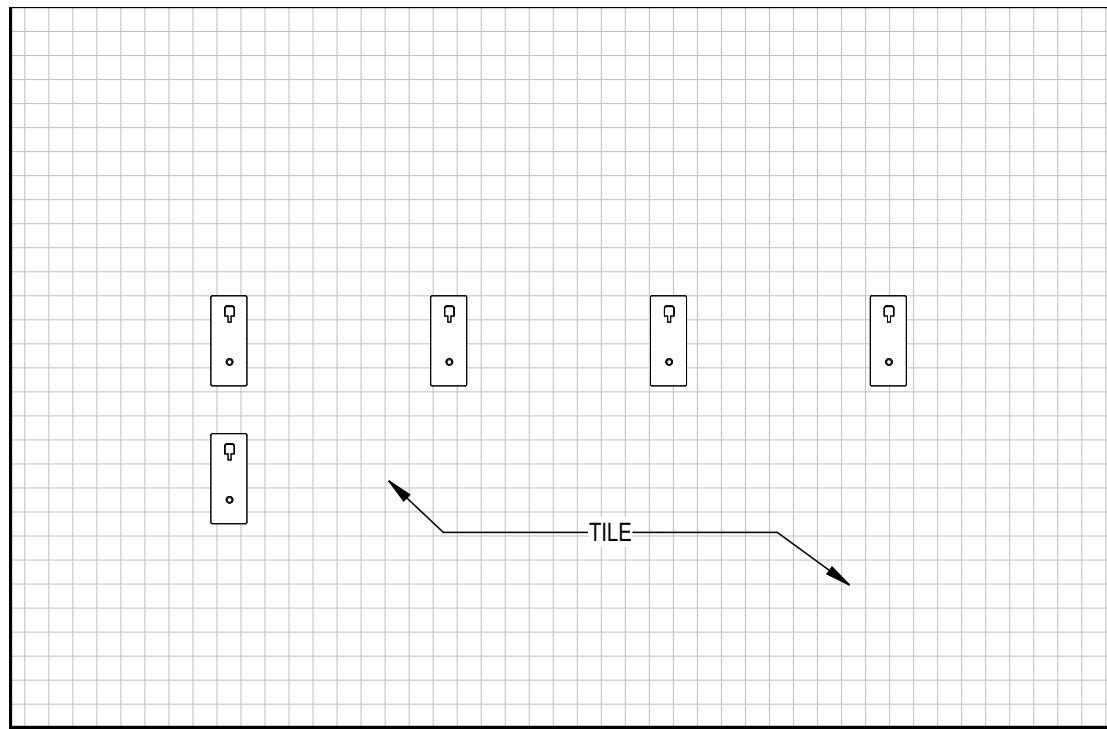


5 SHOWERS 145 ELEV 4  
3/8" = 1'-0"

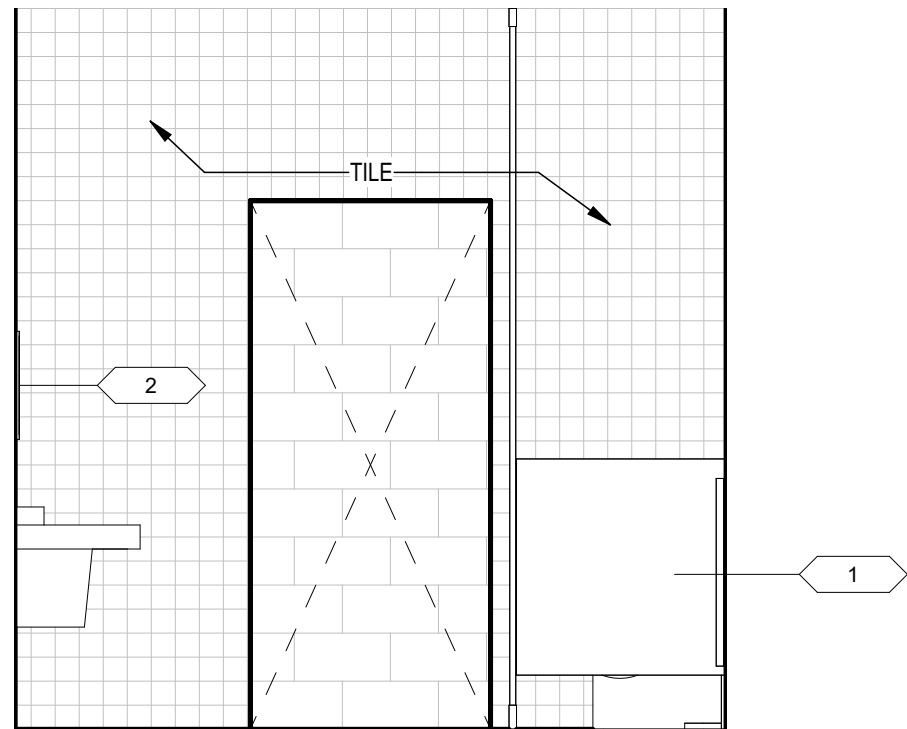


6 TOILET 149 ELEV 1  
3/8" = 1'-0"

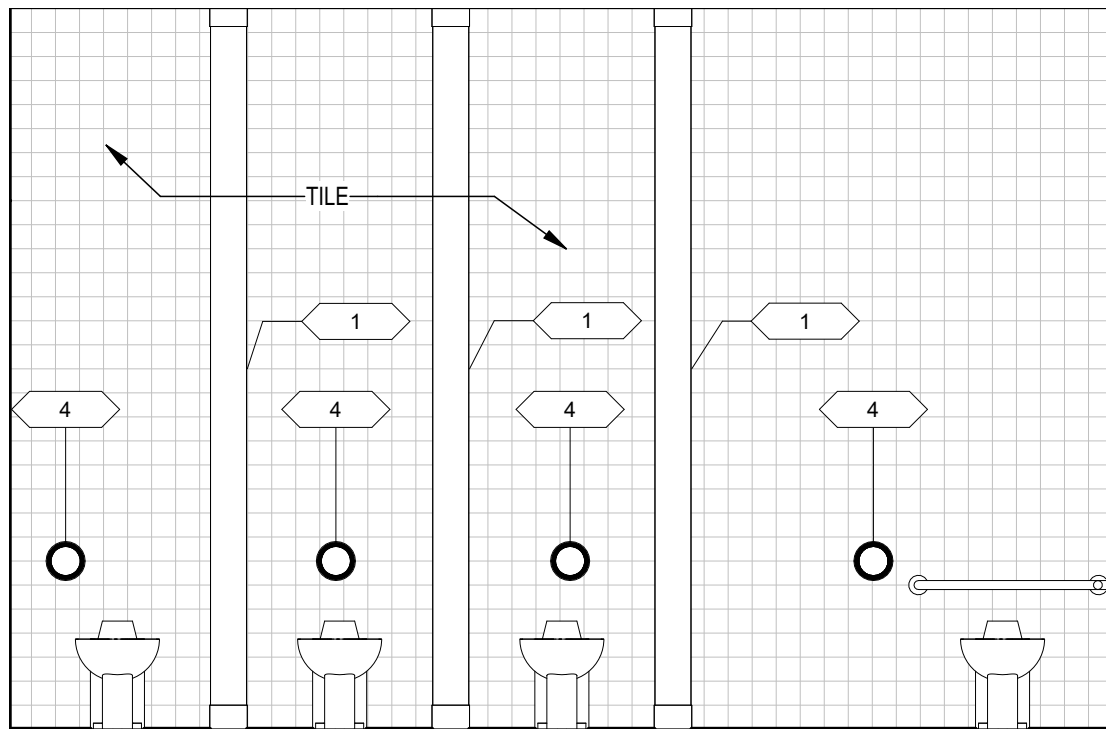



7 TOILET 149 ELEV 2  
3/8" = 1'-0"

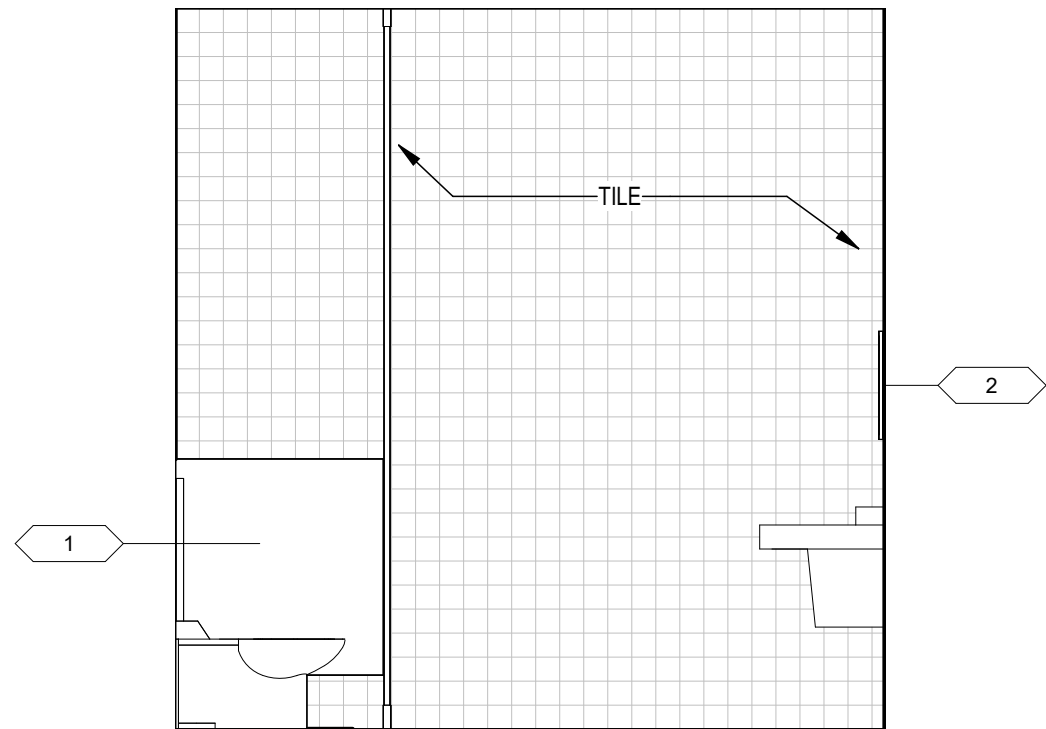

8 TOILET 149 ELEV 3  
3/8" = 1'-0"

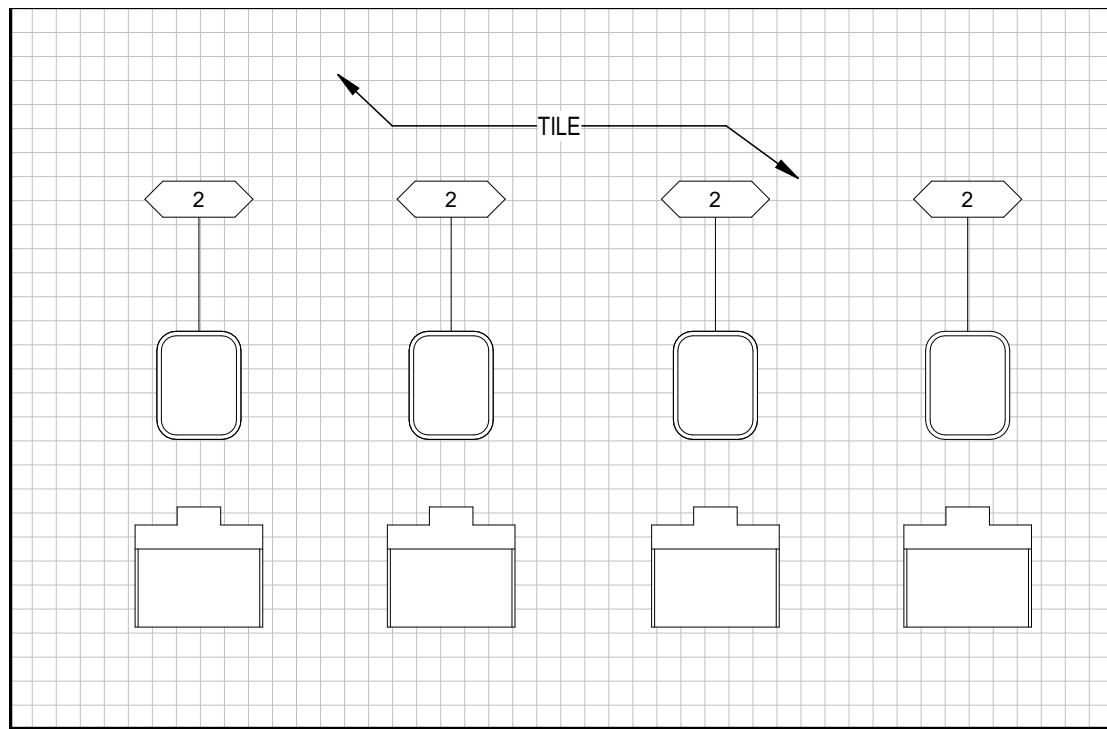

9 TOILET 149 ELEV 4  
3/8" = 1'-0"

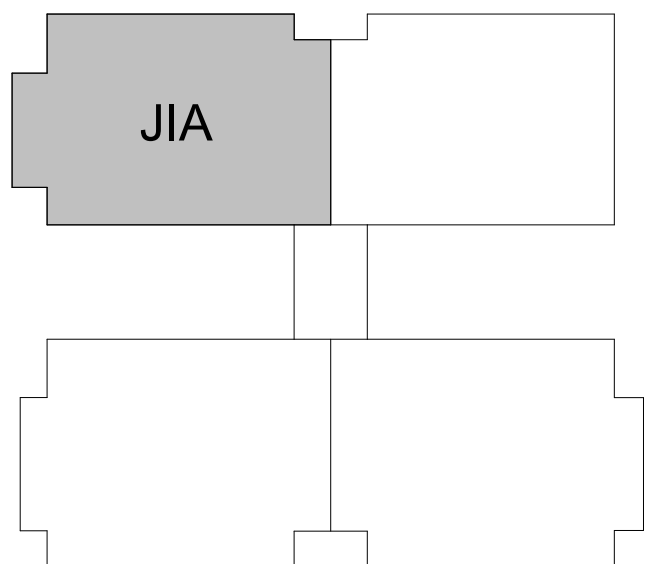

KEY PLAN

HCSO MENTAL HEALTH POD

520 N FALKENBURG ROAD  
TAMPA, FLORIDA 33619

ENLARGED RESTROOM PLANS AND ELEVATIONS - JIA

#	ISSUED FOR	DATE
	75% CD (OWNER APPROVAL)	07.25.24
	PERMIT/BID	08.30.24
	ADDENDUM #4	09.04.24


DRAWN BY: --  
REVIEW BY: Project Manager  
THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P 883.682.1862  
F 883.687.6346  
LC AR54778


lunz.com

24001.01


A-402A

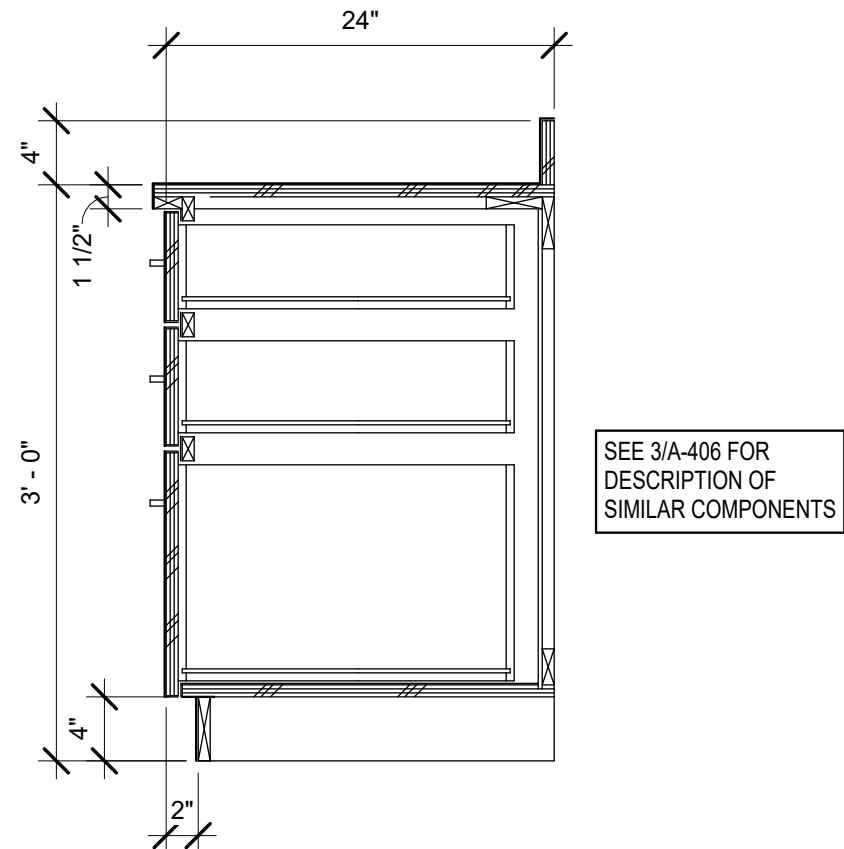


1 BASE CABINET - 2 SMALL/1 LARGE DRAWER  
1" = 1'-0"

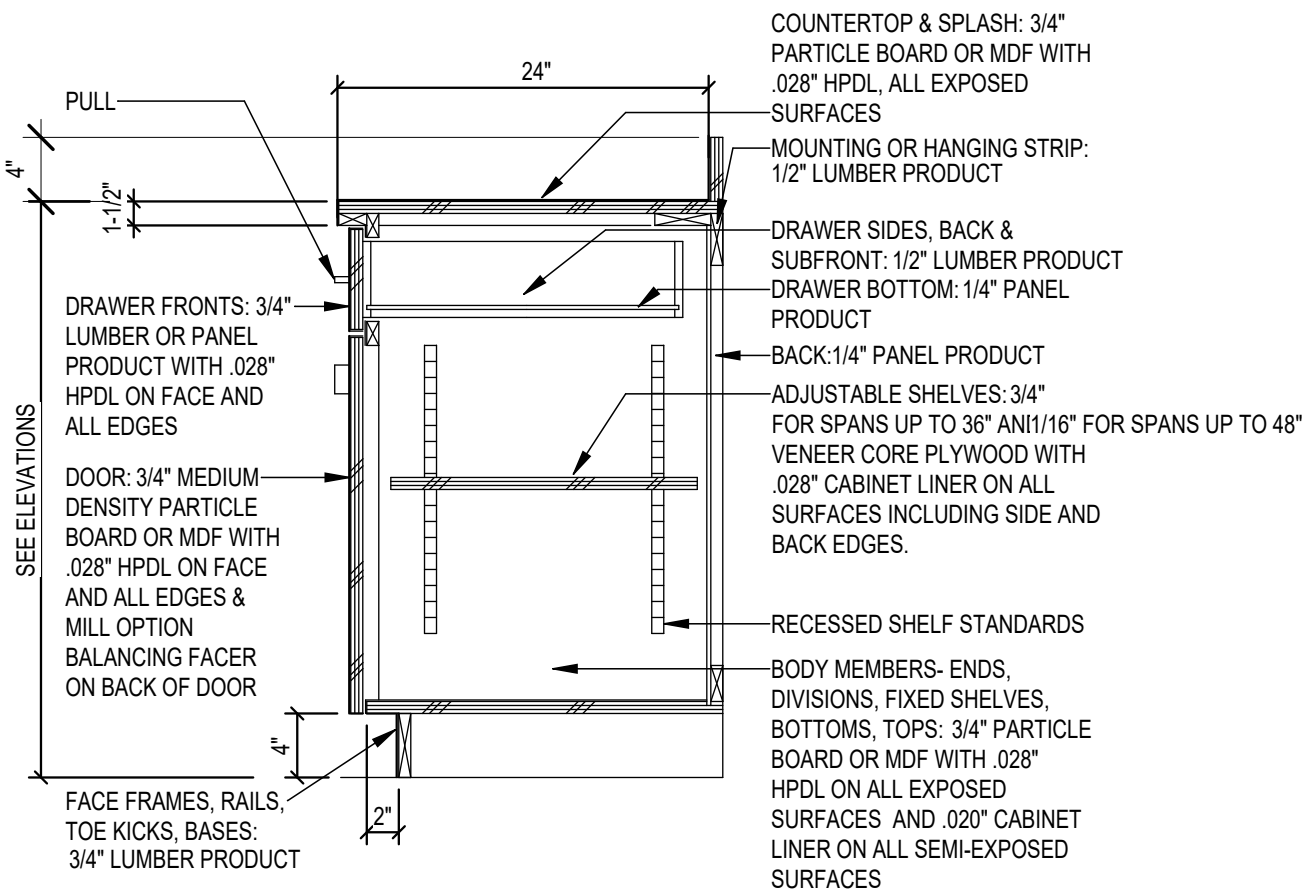


2 BASE CABINET - LAMINATE DRAWER  
1" = 1'-0"

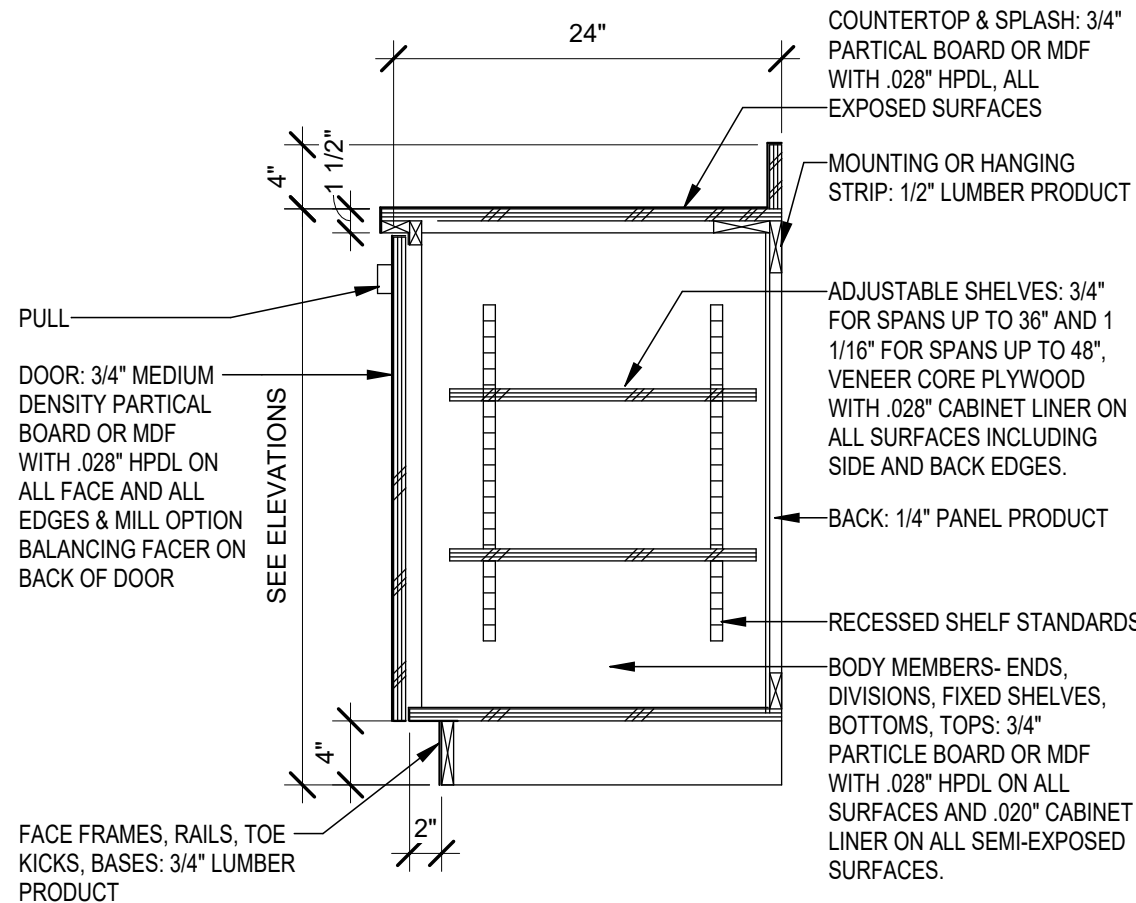


3 Base Cabinet - One Door (Laminate)  
1" = 1'-0"

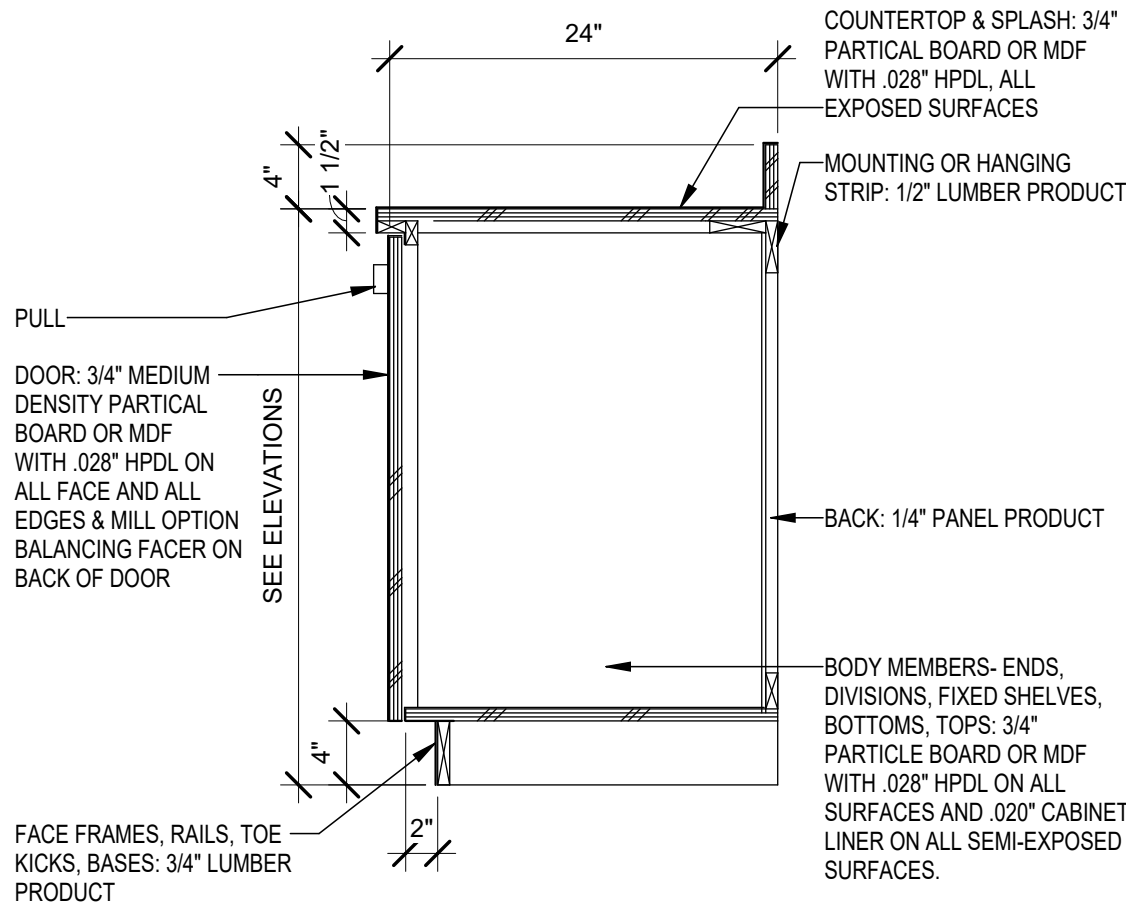



4 BASE CABINET - ONE DOOR (NO SHELVES)  
1" = 1'-0"

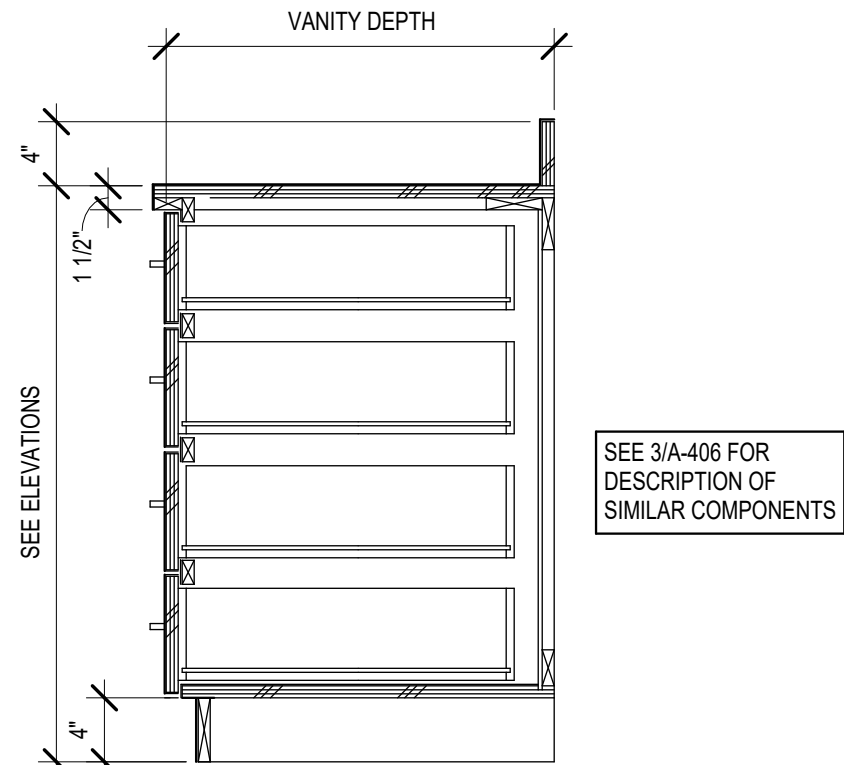

5 BASE CABINET - VANITY DRAWER  
1" = 1'-0"

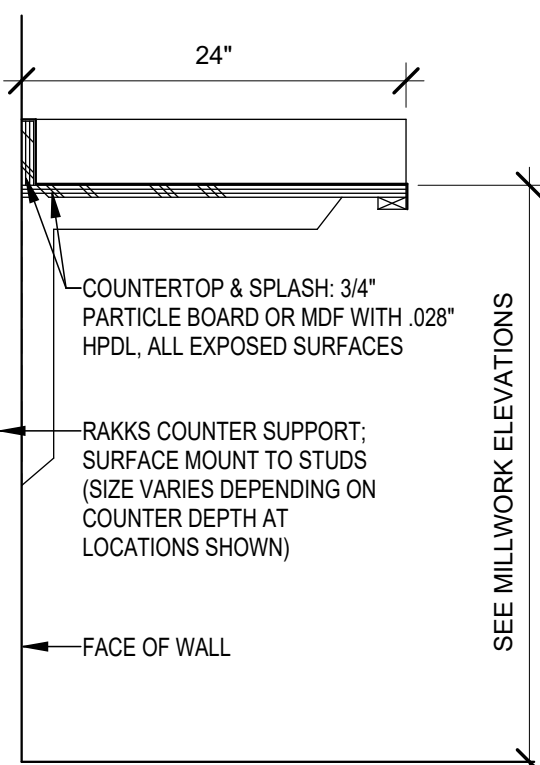

6 COUNTERTOP (LAMINATE)  
1" = 1'-0"

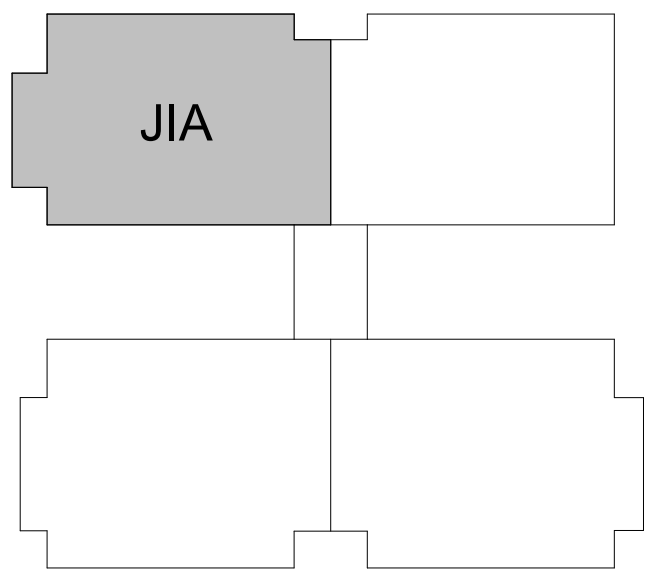

KEY PLAN

#	ISSUED FOR	DATE
	75% CD (OWNER APPROVAL)	07.26.24
	PERMIT/BID	08.30.24
	ADDENDUM #4	09.04.24

DRAWN BY: --  
REVIEW BY: Project Manager  
THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
p 888.685.1862  
f 888.687.6346  
tc: AR04778

lunz.com

24001.01

A-403A



# STUD PARTITIONS

2'-0"

2'-0"

LINE OF ROOF DECK

3 5/8" METAL STUD BRACING DIAG. AT 4'-0" O.C. MAX. ALTERNATE DIRECTION

LINE OF CEILING. SEE FINISH SCHEDULE

HEAD

SOUND ATTENUATION BATT INSULATION, THICKNESS TO MATCH STUD DEPTH

5/8" GYPSUM WALL BOARD (TYP.)

PLAN

3 5/8" METAL STUD FRAMING AT 16" O.C.

METAL RUNNER FASTENED 24" O.C. MAX.

PERIMETER APPLICATION OF CONT. BEADS OF SEALANT (2 BEADS @ GWB AND 2 BEADS @ RUNNER TYPICAL).

T.O. SLAB

BASE

4 7/8"

VARIES

NON-LOAD BEARING

A3.AA.a

WALL CAP (SEE SHEET A-401 FOR DETAILS ON OVERALL WALL HEIGHT.)

HEAD

SOUND ATTENUATION BATT INSULATION, THICKNESS TO MATCH STUD DEPTH

12" PLYWOOD (TYP.)

PLAN

3 5/8" METAL STUD FRAMING AT 16" O.C.

METAL RUNNER FASTENED 24" O.C. MAX.

PERIMETER APPLICATION OF CONT. BEADS OF SEALANT (2 BEADS @ GWB AND 2 BEADS @ RUNNER TYPICAL).

T.O. SLAB

BASE

4 7/8"

VARIES

NON-LOAD BEARING

A6.GG.g

# FURRING PARTITIONS

8" MIN.

LINE OF CEILING. SEE FINISH SCHEDULE

SOUND ATTENUATION BATT INSULATION, THICKNESS TO MATCH STUD DEPTH

5/8" GYPSUM WALL BOARD (TYP.)

3 1/2" METAL Z-FURRING CHANNEL  
CMU BLOCK WALL REFER TO FLOORPLAN FOR THICKNESS

PERIMETER APPLICATION OF CONT. BEADS OF SEALANT / Z BEADS @ CWB AND 2 BEADS @ RUNNER TYPICAL).

T.O. SLAB

AF2.A.a	3 1/8"	VARIES	NON-LOAD BEARING
---------	--------	--------	------------------

**CMU PARTITIONS**

**M8**

HEAD

PLAN

BASE

REFER TO STRUCTURAL PLANS FOR TOP OF CMU DETAIL

LINE OF CEILING. SEE FINISH SCHEDULE

HORIZONTAL JOINT REINFORCING AT BOTTOM COURSE, TOP COURSE AND 16" O.C. VERTICALLY

HOLLOW CMU UNITS FOR EACH THICKNESS AND RATING. SEE SCHEDULE BELOW

FILLED CORES WHERE SCHEDULED

EPOXY PAINT BOTH SIDES

SEE STRUCTURAL DRAWINGS FOR REINFORCING REQUIREMENTS AND LIMITING HEIGHTS

T.O. SLAB

M8	7 5/8"	VARIES	NON-LOAD BEARING
----	--------	--------	------------------

**1-M8**

HEAD

PLAN

BASE

CONCRETE TIE-BEAM. SEE STRUCTURAL DRAWINGS FOR MORE INFORMATION

HORIZONTAL JOINT REINFORCING AT BOTTOM COURSE, TOP COURSE AND 16" O.C. VERTICALLY

8" 14R FIRE RATED BLOCK. SEE SCHEDULE BELOW

FILLED CORES WHERE SCHEDULED

SEE STRUCTURAL DRAWINGS FOR REINFORCING REQUIREMENTS AND LIMITING HEIGHTS

T.O. SLAB

1-M8	7 5/8"	VARIES	NON-LOAD BEARING
------	--------	--------	------------------

**GENERAL NOTES: PARTITION SCHEDULE**

1. THIS SHEET IS TO BE USED IN CONJUNCTION WITH THE PROJECT SPECIFICATIONS.
2. PROVIDE MOLD RESISTANT GYPSUM WALL BOARD AT ALL PARTITIONS U.O.N. ALL REFERENCES TO GYPSUM BOARD, G.W.B. OR G.Y.P.B. ETC. ARE MEANT TO REFER TO MOLD RESISTANT GYPSUM BOARD, U.O.N.
3. ALL FIRE RATED PARTITIONS SHALL HAVE FIRE RATED TYPE "X" MOLD RESISTANT GYPSUM BOARD, U.O.N.
4. PROVIDE CEMENT BOARD AT TILED AREAS THAT SURROUND TUB, SHOWERS, TUB/SHOWERS
5. PROVIDE WATER RESISTANT TILE BACKING BOARD AT ALL OTHER AREAS THAT RECEIVE WATER
6. RECEIVE WALL TILE
7. PROVIDE IMPACT RESISTANT GYPSUM DRYWALL AT PARTITIONS MAKING UP THE ENT EX ENCLOSURES AND ELEVATOR HOISTWAY ENCLOSURES. WALLBOARD SHALL MEET OR EXCEED ABOVE RESISTANT CLASSIFICATION LEVEL 2 AS MEASURED BY ASTM C1629 / C1629M. ASSEMBLY SHALL BE 2 HR RATED MIN.,
7. STUDS SHALL BE 3" x 8" MIN. 20 GA. PLACED AT 16" O.C. MAX.
8. INCREASE GAUGE THICKNESS AND/OR DECREASE STUD SPACING AND/OR CROSS BRACING AS REQUIRED TO MEET DEFLECTION CRITERIA AND WHERE LIMITING HEIGHTS ARE EXCEEDED, REFERENCE SPECIFICATION FOR DESIGN PRESSURES AND ALLOWABLE DEFLECTIONS. IN ALL CASES THE UL AND SDC RATING IS TO BE MAINTAINED.
9. REFERENCE PLANS AND EGRESS PLANS FOR EXTENT OF FIRE RATED PARTITIONS.
10. RATED PARTITIONS INCLUDING BUT NOT LIMITED TO APARTMENT DEMISING PARTITIONS ARE TO BE COMPLETED PRIOR TO NON-RATED WALLS TO ENSURE CONTINUITY OF BOTH ACoustICAL AND FIRE RATINGS.
11. ALL CORNERS AT SHAFT WALL ENCLOSURES TO BE BUILT AT 90 DEGREE ANGLES ONLY.
12. ALL REQUIRED FIRE RATINGS ARE TO RUN CONTINUOUSLY AND UNINTERRUPTED BOTH HORIZONTALLY AND VERTICALLY TO UL APPROVED TERMINATION.
13. ALL WOOD USED WITHIN METAL PARTITIONS SHALL BE FIRE-RETARDANT TREATED.
14. ALL PARTITIONS DESIGNATED TO HAVE A FIRE RATING ARE TO STRICTLY ADHERE TO UL APPROVED ASSEMBLY REQUIREMENTS. IN THE CASE OF ANY DISCREPANCIES, NOTIFY ARCHITECT PRIOR TO CONSTRUCTION.
15. SEAL ALL PENETRATIONS AT FIRE RATED ASSEMBLIES USING UL APPROVED MATERIAL OR SYSTEM.
16. MAINTAIN FIRE RATING ABOVE RECESSED FIXTURES.
17. PARTITIONS TO RECEIVE TILE, GLASS, OR SUPPORT WALL HUNG EQUIPMENT SHALL HAVE A MAXIMUM DEFLECTION OF L/80.
18. PROVIDE NECESSARY CONCEALED METAL REINFORCING FOR ALL WALL-MOUNTED TENS. CM TO COORDINATE ALL LOCATIONS.
19. CM TO COORDINATE APPLICATION OF CONTINUOUS INSULATION AIR BARRIER AND VAPOR BARRIER THROUGHOUT THE BUILDING PERIMETER.
20. ALL WET-SPACE PIPING IS TO BE ATTACHED TO THE WET-SPACE SIDE OF THE PARTITION ONLY.
21. GRAB BARS, SHOWER SEATS, AND DRESSING ROOM BENCH SEATS SHALL BE INSTALLED SO THAT THEY CAN SUPPORT A SINGLE CONCENTRATED LOAD OF 250 POUNDS.
21. ALL WALL PANEL JOINTS SHALL BE STAGGERED. FROM BASE LAYER WITH FACE PANEL LAYER.
22. ALL FURRING WALL PARTITIONS AND ALL CHASE WALLS TO BE VERTICALLY BRACED AT 4'-0" O.C. MIN.

**ACOUSTIC NOTES: PARTITION SCHEDULE**

1. INSTALL ACOUSTICALLY RATED ASSEMBLIES TO MEET OR EXCEED THE MINIMUM STC RATINGS NOTED ON THE DRAWINGS AND SPECIFICATIONS (SCT 50 TYPICALLY, 25 VGAGE STUDS AT 24" O.C. OR 20 VGAGE EQUIVALENT STUDS ARE ACCEPTABLE AS ALTERNATE TO AS NOTED PROVIDED REQUIRED SPANS AND DEFLECTIONS ARE MET)
2. DO NOT LOCATE OUTLET BOSSES OPPOSITE ONE ANOTHER IN ANY PARTITION, LOCATE AT LEAST ONE STUD APART. SEAL THE OUTLET BOSS WITH PUTTY PADS AND CAULK THE PERIMETER USING ACOUSTICAL SEALANT. AT RATED PARTITIONS, LOCATE OUTLET BOSSES AT LEAST 24" APART.
3. PARTITIONS CONTAINING RECESSED ELEMENTS (E.G. TELEVISIONS) TO BE PROPERLY BLOCKED AND SEALED TO MAINTAIN REQUIRED STC RATING.

## WALL TAG LEGEND

---

PARTITION  
DIMENSION

PARTITION TYPE

FIRE RATING  
= 1/2 HOUR  
= 2 HOURS  
= 3 HOURS  
= SMOKE

---

## PARTITION TYPE

---

STUD (METAL)

BRICK

CONCRETE

DOUBLE WALL

EXTERIOR

FURRING

M. CMU

P. PLUMBING

R. STUD (WOOD)

S. SEPARATION

X. CHASE

Z. SHEAR

---

## PARTITION DIMENSION

---

7/8" FURRING CHANNEL  
= 1/2" OR 5/8" STUD

2 1/2" STUD

3 1/2" OR 3 5/8" STUD

4" CONCRETE, MASONRY, OR STUD

5 1/2" STUD

6. 6" CONCRETE, MASONRY, OR STUD

8. STUD

10. 8" CONCRETE OR MASONRY

12. 10" CONCRETE OR MASONRY

12. 12" CONCRETE OR MASONRY

---

## APPLIED FINISH

---

1 LAYER 5/8" GYP BD

2 LAYER 5/8" GYP BD

1 LAYER 5/8" GYP BD (TYPE X)

2 LAYER 5/8" GYP BD (TYPE X)

1 LAYER 5/8" MOISTURE RESISTANT BD

1 LAYER 1/2" CEMENT BD

G. 1 LAYER PLYWOOD (SEE PLANS FOR SIZE)

---

## MODIFIERS

---

PARTITION INCLUDE BATT INSULATION. MATCH THICKNESS TO STUD SIZE (1" FOR 1 1/2" STUDS, 2" FOR 2 1/2" STUDS, 3" FOR 3 5/8" STUD, 6" FOR 6" STUD.)

PARTITION INCLUDE THERMAL BATT INSULATION. MATCH THICKNESS TO STUD SIZE (1" FOR 1 1/2" STUDS, 2" FOR 2 1/2" STUDS, 3" FOR 3 5/8" STUD, 6" FOR 6" STUD.)

PARTITION INCLUDE SOUND ATTENUATION BATT INSULATION. MATCH THICKNESS TO STUD SIZE (1" FOR 1 1/2" STUDS, 2" FOR 2 1/2" STUDS, 3" FOR 3 5/8" STUD, 6" FOR 6" STUD.)

BATT TO EITHER SIDE OF PARTITION AT CEILING.

PARTITION INCLUDES ONE ADDITIONAL 5/8" THICK LAYER OF TILE BACKER BOARD (BATTLUB SIDE).

PROVIDE 25 GA STUD (TO MEET ACOUSTICAL REQUIREMENTS).

FULLY GROUTED.

PARTIAL HEIGHT WALL - REFER TO ELEVATIONS FOR ADDITIONAL INFO.

AIR SEAL PARTITION IN ACCORDANCE WITH SPEC SECTION 018115.

COORDINATE WITH EXTERIOR WALL DETAILS.

UL FIRE RATED PARTITIONS

LEGEND: WALL TYPE VIEW TITLE

WALL TYPE	WALL WIDTH	WALL REF HEIGHT	REMARKS
-A4.AA.a	STC RATING	UL FIRE DESIGN	UL MODEL #

## # WALL CONSTRUCTION COMPLIANCE

[illegible]

DRAWN BY: --  
REVIEW BY: Project  
Manager

THE LUNZ GROUP  
© COPYRIGHT ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 3380  
p 863.682.1882  
f 863.687.6346  
lic. AR94778

lunz.com

24001.01

# A-500A


Door Schedule												
Mark	Door						Frame			Fire Rating	Hardware	Comments
	Width	Height	Thickness	Elevation	Material	Finish	Frame Elevation	Frame Material	Frame Finish			
121A	3'-0"	7'-0"	1 3/4"	F	SCW	FF	F1	HM	PAINT		1	
122A	3'-0"	7'-0"	1 3/4"	F	SCW	FF	F1	HM	PAINT		2	
123A	3'-0"	7'-0"	1 3/4"	F	SCW	FF	F1	HM	PAINT		1	
124A	3'-0"	7'-0"	1 3/4"	N	SCW	FF	F1	HM	PAINT		1	
125A	3'-0"	7'-0"	1 3/4"	N	SCW	FF	F1	HM	PAINT		1	
126A	3'-0"	7'-0"	1 3/4"	N	SCW	FF	F1	HM	PAINT		1	
127A	3'-0"	7'-0"	1 3/4"	N	SCW	FF	F1	HM	PAINT		1	
128A	3'-0"	7'-0"	1 3/4"	N	SCW	FF	F1	HM	PAINT		1	
129A	3'-0"	7'-0"	1 3/4"	N	SCW	FF	F1	HM	PAINT		1	
130A	3'-0"	7'-0"	1 3/4"	N	SCW	FF	F1	HM	PAINT		1	
131A	3'-0"	7'-0"	1 3/4"	N	SCW	FF	F1	HM	PAINT		1	
132A	3'-0"	7'-0"	2"	FG	HDHM	PAINT	F3	HDHM	PAINT		3	
132B	3'-0"	7'-0"	2"	FG	HDHM	PAINT	F3	HDHM	PAINT		3	
133A	3'-0"	7'-0"	2"	EM	STEEL	MANUF	F2	HDHM	PAINT		3	
134A	3'-0"	7'-0"	2"	C	HDHM	PAINT	F3	HDHM	PAINT		3	1
134B	2'-4"	7'-0"	2"	F	HDHM	PAINT	F2	HDHM	PAINT		4	
135A	3'-0"	7'-0"	2"	C	HDHM	PAINT	F3	HDHM	PAINT		3	1
136A	3'-0"	7'-0"	2"	C	HDHM	PAINT	F3	HDHM	PAINT		3	1
136B	2'-4"	7'-0"	2"	F	HDHM	PAINT	F2	HDHM	PAINT		4	
137A	3'-0"	7'-0"	2"	C	HDHM	PAINT	F3	HDHM	PAINT		3	1
138A	3'-0"	7'-0"	2"	C	HDHM	PAINT	F3	HDHM	PAINT		3	1
138B	2'-4"	7'-0"	2"	F	HDHM	PAINT	F2	HDHM	PAINT		4	
139A	3'-0"	7'-0"	2"	C	HDHM	PAINT	F3	HDHM	PAINT		3	1
140A	3'-0"	7'-0"	2"	C	HDHM	PAINT	F3	HDHM	PAINT		3	1
140B	2'-4"	7'-0"	2"	F	HDHM	PAINT	F2	HDHM	PAINT		4	
141A	3'-0"	7'-0"	2"	FG	HDHM	PAINT	F3	HDHM	PAINT		3	
141B	3'-0"	7'-0"	2"	FG	HDHM	PAINT	F3	HDHM	PAINT		3	
143A	3'-4"	7'-4"										2
144A	3'-0"	7'-0"	2"	F	HDHM	PAINT	F2	HDHM	PAINT		4	
145A	3'-4"	7'-4"										2
152A	3'-0"	7'-0"	2"	F	HDHM	PAINT	F2	HDHM	PAINT		4	
154A	3'-0"	7'-0"	2"	C	HDHM	PAINT	F3	HDHM	PAINT		3	1
154B	2'-4"	7'-0"	2"	F	HDHM	PAINT	F2	HDHM	PAINT		4	
155A	3'-0"	7'-0"	2"	C	HDHM	PAINT	F3	HDHM	PAINT		3	1
156A	3'-0"	7'-0"	2"	C	HDHM	PAINT	F3	HDHM	PAINT		3	1
156B	2'-4"	7'-0"	2"	F	HDHM	PAINT	F2	HDHM	PAINT		4	
157A	3'-0"	7'-0"	2"	C	HDHM	PAINT	F3	HDHM	PAINT		3	1
158A	3'-0"	7'-0"	2"	C	HDHM	PAINT	F3	HDHM	PAINT		3	1
158B	2'-4"	7'-0"	2"	F	HDHM	PAINT	F2	HDHM	PAINT		4	
159A	3'-0"	7'-0"	2"	C	HDHM	PAINT	F3	HDHM	PAINT		3	1
160A	3'-0"	7'-0"	2"	FG	HDHM	PAINT	F3	HDHM	PAINT		3	
161A	3'-0"	7'-0"	2"	F	HDHM	PAINT	F3	HDHM	PAINT		3	

DOOR SCHEDULE KEY NOTES:


1. INMATE CELL DOOR TO BE HALF GLASS WITH SECURABLE, TRAY PASS THROUGH.
2. CASED OPENING

ABBREVIATIONS:


- F- FLUSH
- FG - FULL GLASS
- HG - HALF GLASS
- SL - SLIDING
- AL - ALUMINUM
- HM - HOLLOW METAL
- N - NARROW LIGHT
- P - PAINTED
- S - STAINED
- SCW - SOLID CORE WOOD
- WD - WOOD
- HDHM - HEAVY DUTY HOLLOW METAL
- C - CELL
- EM - EXPANDED METAL CAGE DOOR

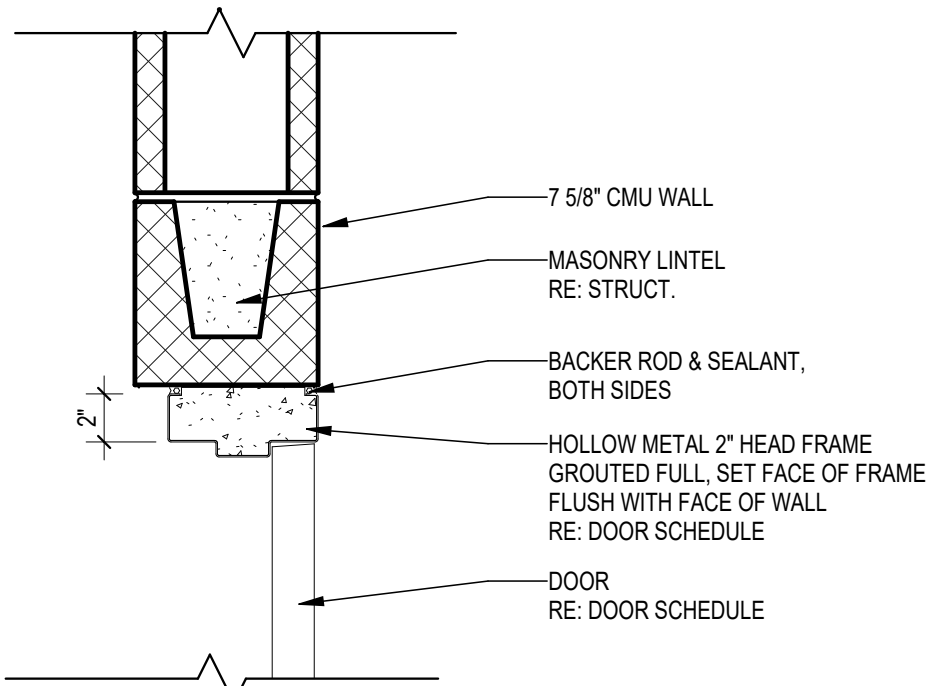

2 HOLLOW METAL HEAD @ CMU WALL  
1 1/2" = 1'-0"

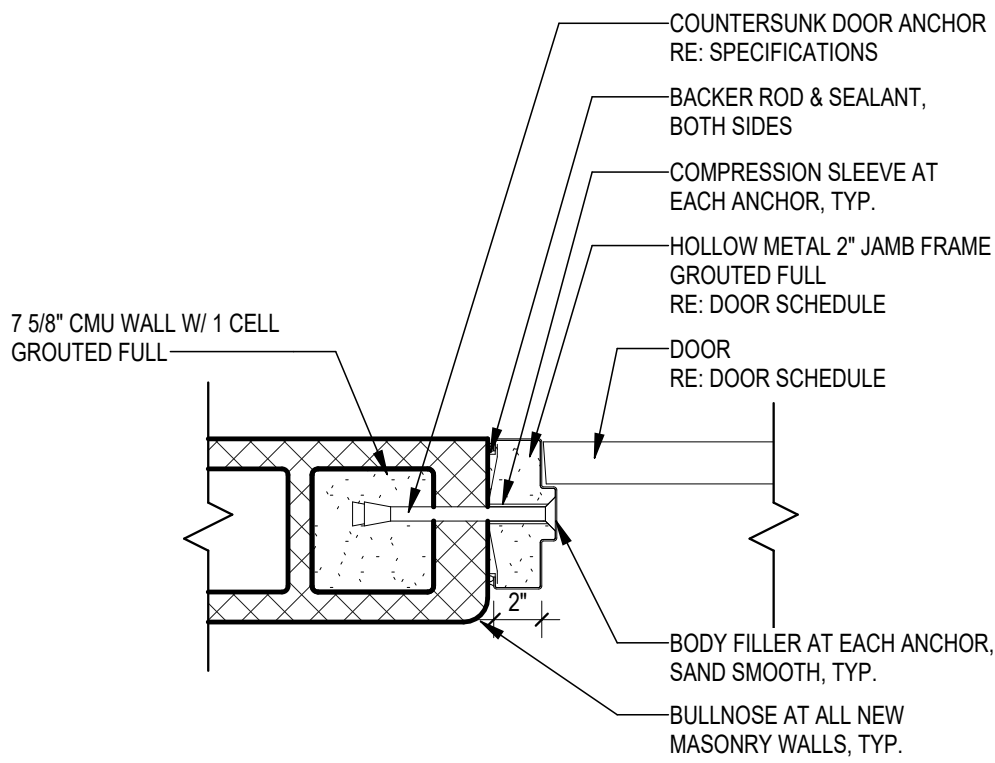


3 HOLLOW METAL JAMB @ CMU WALL  
1 1/2" = 1'-0"

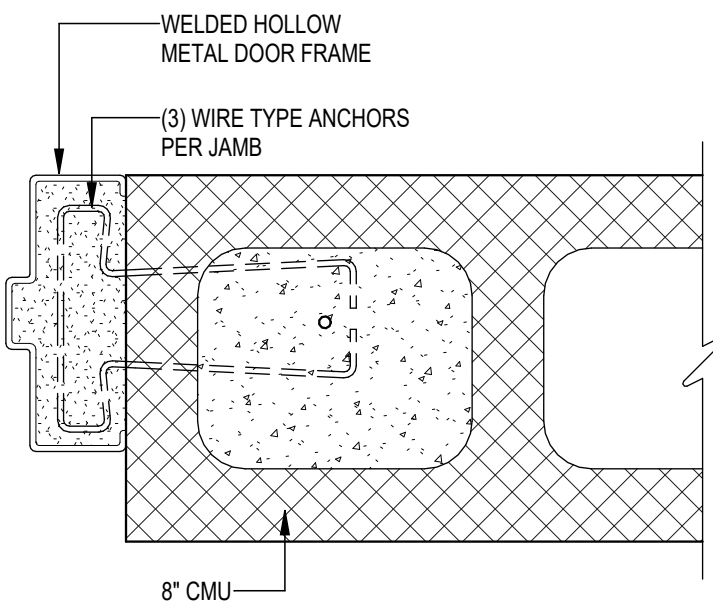


4 Jamb - Hollow Metal Door Frame in CMU  
3" = 1'-0"

INTERIOR



EXTERIOR

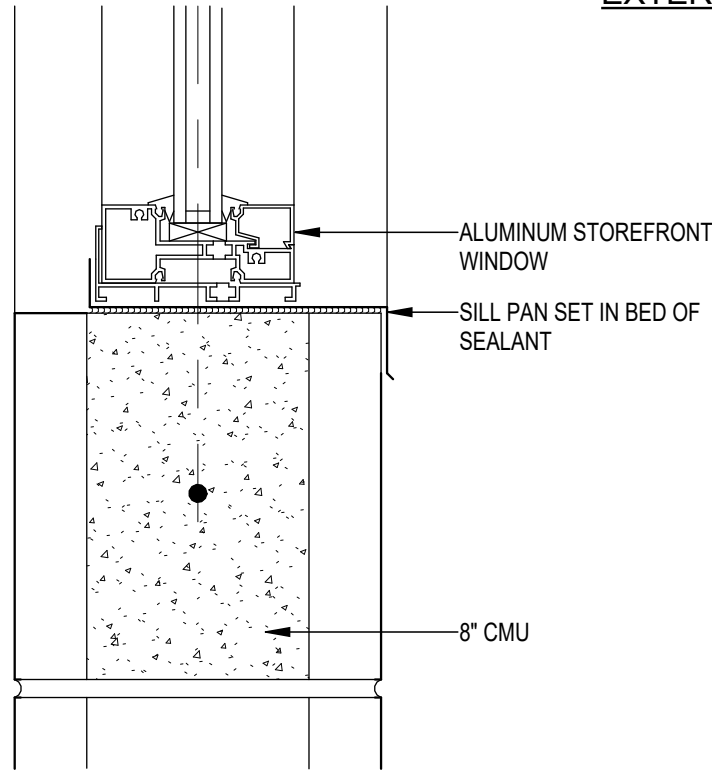

5 Sill - Exterior Storefront - CMU  
3" = 1'-0"

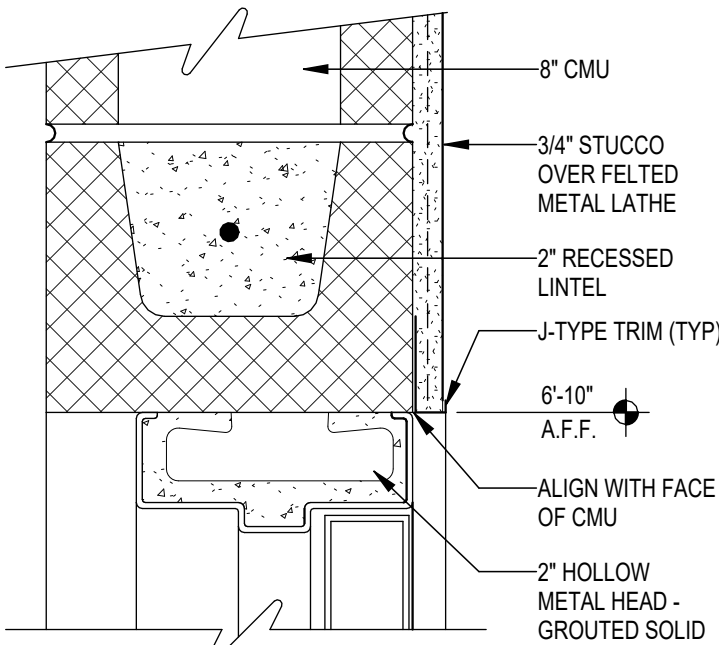

6 Head - 82" Hollow Metal Door Frame in CMU/Stucco  
3" = 1'-0"

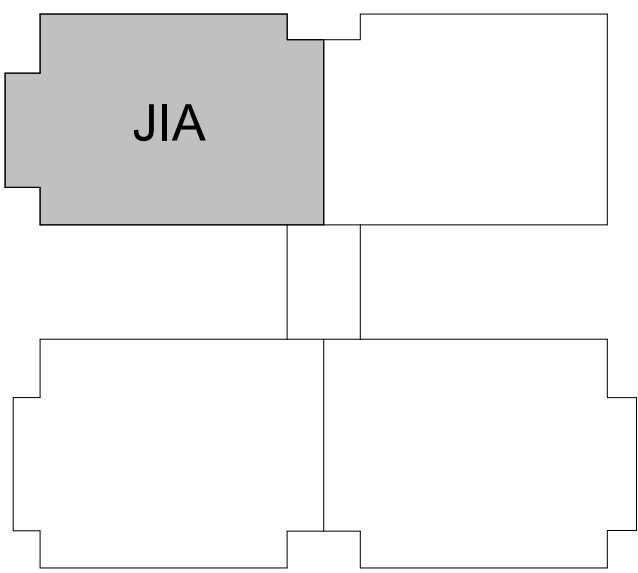

KEY PLAN

DOOR & FRAME GENERAL NOTES

1. VERIFY DOOR SIZE AND STYLE WITH DOOR MANUFACTURER
2. SIZES LISTED ARE NOMIAL. VERIFY SIZES IN FIELD. VERIFY SIZES AND INSTALLATION REQUIREMENTS WITH MANUFACTURER.
3. ALL DOORS TO HAVE LEVER HANDLES AND COMPLY WITH ADA.
4. PROVIDE ADA COMPLIANT THRESHOLDS AS REQUIRED.

GENERAL WINDOW NOTES

1. SIZES LISTED ARE NOMINAL. VERIFY ALL OPENING SIZES IN FIELD. VERIFY SIZES AND INSTALLATION REQUIREMENTS WITH MANUFACTURER.
2. ALL INTERIOR GLAZING SHALL BE CLEAR, SINGLE PANE GLASS 1/4" NOMINAL.

NOTE:

1. CONTRACTOR TO PROVIDE FULL HARDWARE SCHEDULE FOR REVIEW AND COORDINATE WITH OWNER TO PROVIDE A MASTER KEY.
2. PROVIDE KICK PLATES TO ALL EGRESS ENTRY/EXIT DOORS, AS APPLICABLE.

HCSO MENTAL HEALTH POD

520 N FALKENBURG ROAD  
TAMPA, FLORIDA 33619

SCHEDULES, DOOR & WINDOW ELEVATIONS - JIA

#	ISSUED FOR	DATE
	75% CD (OWNER APPROVAL)	07.26.24
	PERMIT/BID	08.30.24
	ADDENDUM #4	09.04.24

DRAWN BY: --  
REVIEW BY: Project Manager  
THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
p 883.682.1862  
f 883.687.6346  
tc: AR04778

lunz.com




24001.01


A-601A




ROOM SCHEDULE						
NUMBER	NAME	CEILING FINISH	WALL FINISH	BASE FINISH	FLOOR FINISH	COMMENTS
121	OPEN OFFICE	ACT	PAIN	RB	LVT	
122	CONFERENCE ROOM	ACT	PAIN	RB	VCT	VCT & BASE TO BE OF/CI
124	OFFICE	ACT	PAIN	RB	VCT	VCT & BASE TO BE OF/CI
125	OFFICE	ACT	PAIN	RB	VCT	VCT & BASE TO BE OF/CI
127	OFFICE	ACT	PAIN	RB	VCT	VCT & BASE TO BE OF/CI
128	OFFICE	ACT	PAIN	RB	VCT	VCT & BASE TO BE OF/CI
129	OFFICE	ACT	PAIN	RB	VCT	VCT & BASE TO BE OF/CI
130	OFFICE	ACT	PAIN	RB	VCT	VCT & BASE TO BE OF/CI
131	OFFICE	ACT	PAIN	RB	VCT	VCT & BASE TO BE OF/CI
132	SECURED CORRIDOR	SEALED CONCRETE	PAIN	RB	VCT	VCT & BASE TO BE OF/CI
133	JAN	SEALED CONCRETE	PAIN	-	SEALED CONCRETE	
134	ISO. CELL	SEALED CONCRETE	PAIN	-	SEALED CONCRETE	
135	ISO. CELL	SEALED CONCRETE	PAIN	-	SEALED CONCRETE	
136	ISO. CELL	SEALED CONCRETE	PAIN	-	SEALED CONCRETE	
137	ISO. CELL	SEALED CONCRETE	PAIN	-	SEALED CONCRETE	
138	ISO. CELL	SEALED CONCRETE	PAIN	-	SEALED CONCRETE	
139	ISO. CELL	SEALED CONCRETE	PAIN	-	SEALED CONCRETE	
140	ISO. CELL	SEALED CONCRETE	PAIN	-	SEALED CONCRETE	
141	OPEN	OPEN	PAIN	RB	VCT	VCT & BASE TO BE OF/CI
142	DEPUTY STATION	OPEN	PAIN	RB	VCT	VCT & BASE TO BE OF/CI
143	TOILETS	SEALED CONCRETE	PAIN	TILE	TILE	
144	CHASE	OPEN	PAIN	-	SEALED CONCRETE	
145	SHOWERS	SEALED CONCRETE	TILE	TILE	TILE	
152	STORAGE	OPEN	PAIN	RB	VCT	VCT & BASE TO BE OF/CI
154	ISO. CELL	SEALED CONCRETE	PAIN	-	SEALED CONCRETE	
155	ISO. CELL	SEALED CONCRETE	PAIN	-	SEALED CONCRETE	
156	ISO. CELL	SEALED CONCRETE	PAIN	-	SEALED CONCRETE	
157	ISO. CELL	SEALED CONCRETE	PAIN	-	SEALED CONCRETE	
158	ISO. CELL	SEALED CONCRETE	PAIN	-	SEALED CONCRETE	
159	ISO. CELL	SEALED CONCRETE	PAIN	-	SEALED CONCRETE	
160	NURSE OFFICE	ACT	PAIN	RB	VCT	VCT & BASE TO BE OF/CI
161	EXERCISE YARD	OPEN	PAIN	-	SEALED CONCRETE	

INTERIOR FINISH KEY ABBREVIATIONS	
ACT	- ACOUSTICAL CEILING TILE
CT	- CERAMIC TILE
PC	- POLISHED CONCRETE
SC	- SEALED CONCRETE
CPT	- CARPET
CT	- CERAMIC TILE
GYP	- GYPSUM WALL BOARD
LVT	- VINYL TILE
P	- PAINT
RB	- RUBBER BASE
TB	- TILE BASE
NOTE: SEE SHEET G-006 (GENERAL NOTES & ABBREVIATION) FOR ANY ADDITIONAL ABBREVIATIONS	

FLOORING FINISH KEY	
	SEALED CONCRETE
	CERAMIC TILE
	LVT (OF/CI)

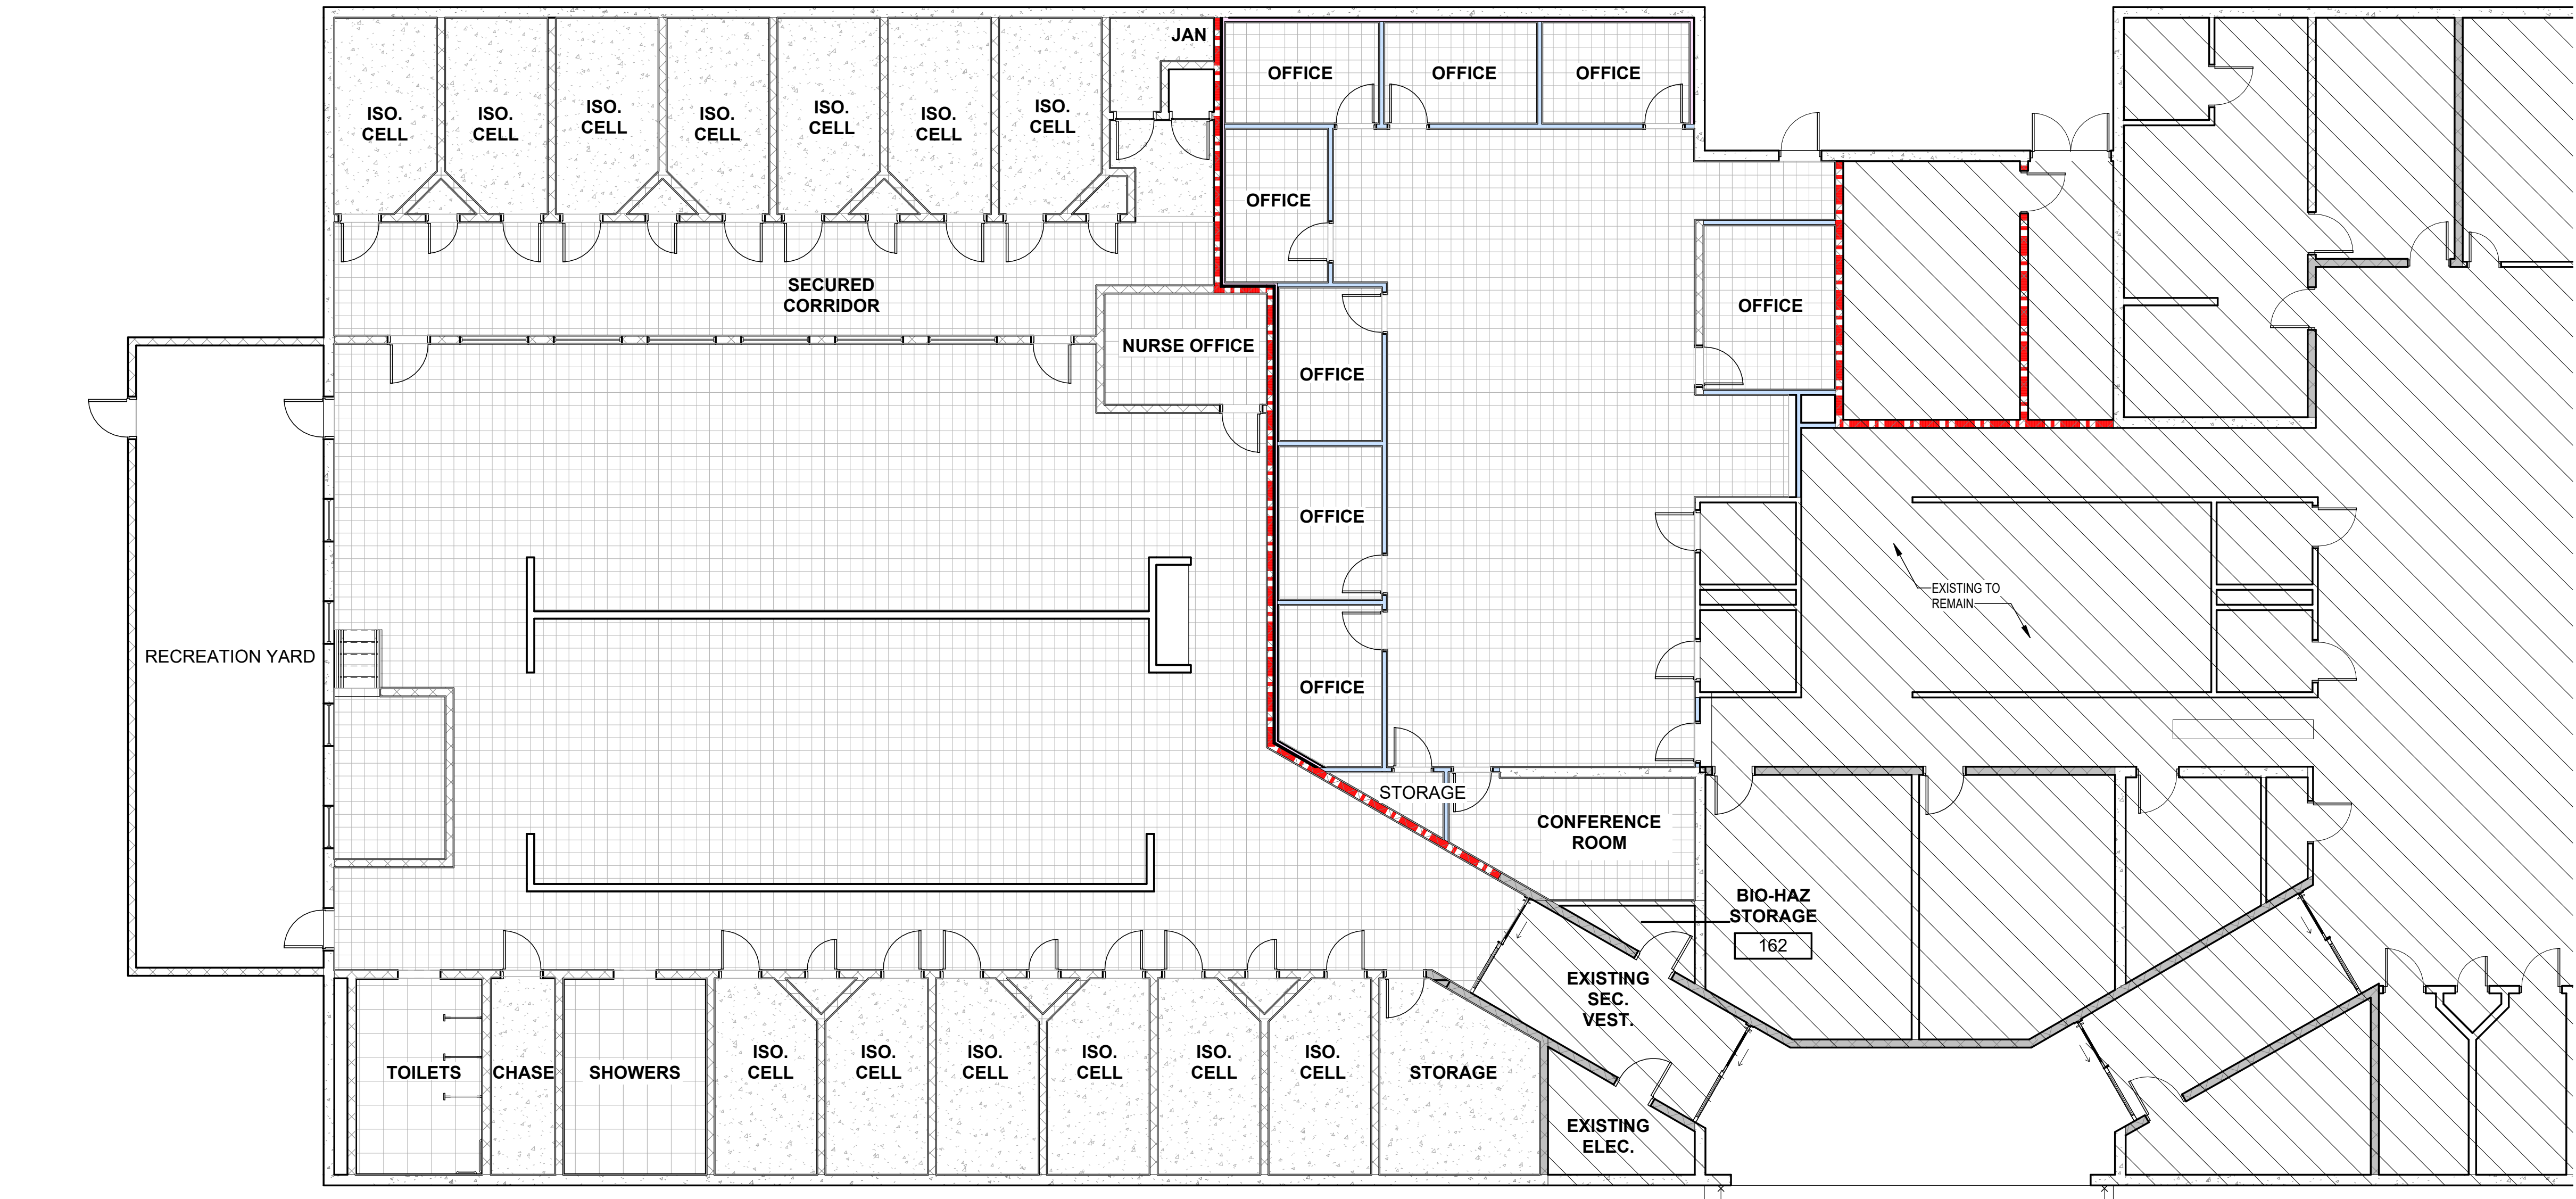

1 FLOOR FINISH PLAN  
1/8" = 1'-0"

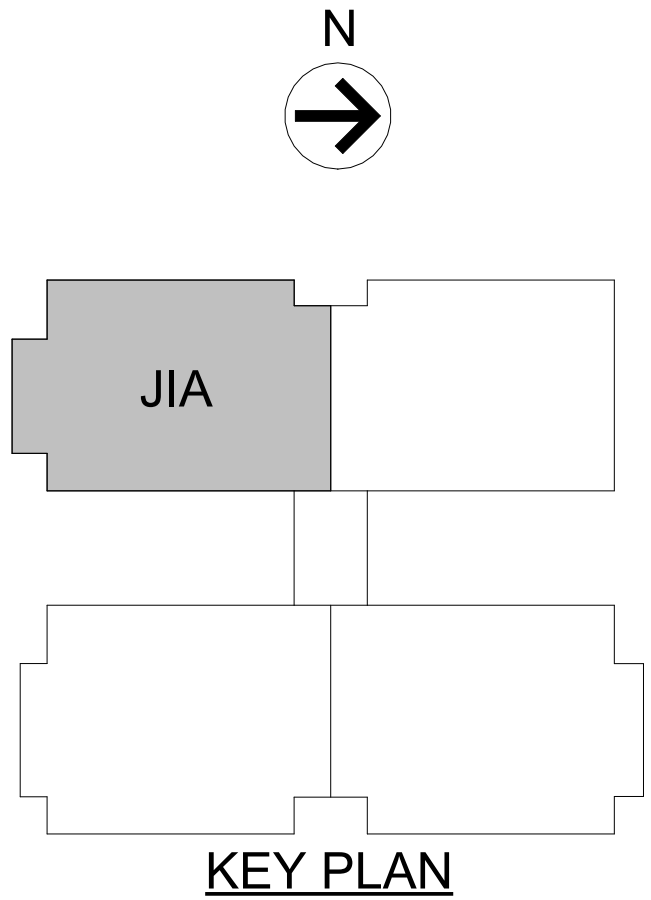

HCSO MENTAL HEALTH POD

520 N FALKENBURG ROAD  
TAMPA, FLORIDA 33619

ROOM FINISH PLAN & SCHEDULE - JIA

#	ISSUED FOR	DATE
	75% CD (OWNER APPROVAL)	07.25.24
	PERMIT/BID	08.30.24
	ADDENDUM #4	09.04.24

DRAWN BY: --  
REVIEW BY: Project Manager  
THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P 888.685.1862  
F 888.687.6346  
lic. AR04778

lunz.com

24001.01

A-602A



## HVAC SYMBOLS

	SQUARE DUCT SIZE TAG (WIDTH x HEIGHT)
	OVAl DUCT SIZE TAG (WIDTH / HEIGHT)
	ROUND DUCT SIZE TAG (DIAMETER)
	EXISTING DUCT TAG
	DUCT BEING DEMOLISHED
	SUPPLY AIR
	OUTSIDE AIR
	RETURN AIR
	TRANSFER AIR
	EXHAUST AIR
	RECTANGULAR SUPPLY/OUTSIDE AIR DUCT RISE
	ROUND SUPPLY/OUTSIDE AIR DUCT RISE
	RECTANGULAR RETURN/TRANSFER AIR DUCT RISE
	ROUND RETURN/TRANSFER AIR DUCT RISE
	RECTANGULAR EXHAUST/RELIEF AIR DUCT RISE
	ROUND EXHAUST/RELIEF AIR DUCT RISE

## GRILLES, REGISTERS &amp; DIFFUSERS TAG

SUPPLY DIFFUSER		CD-XX XXX CFM	TYPE (SEE SCHEDULE) CFM
RETURN GRILLE		RG-XX XXX CFM	TYPE (SEE SCHEDULE) CFM
EXHAUST GRILLE		EG-XX XXX CFM	TYPE (SEE SCHEDULE) CFM
SUPPLY GRILLE		SG-XX XXX CFM	TYPE (SEE SCHEDULE) CFM

## MECHANICAL EQUIPMENT TAGS

AIR HANDLING UNIT EQUIPMENT		AHU-XX	
EXISTING EQUIPMENT TO REMAIN		(E)AHU-XX	
CARBON DIOXIDE SENSOR		TH	SYMBOL EQUIPMENT ID
CARBON MONOXIDE SENSOR		TS	TEMPERATURE & HUMIDITY SENSOR
NITROGEN DIOXIDE SENSOR		T	TEMPERATURE SENSOR
HUMIDITY SENSOR		MS	MANUAL SWITCH
HUMIDISTAT		S	SENSOR
PANEL NAME			
BMS CONTROL PANEL		HVAC-CP-X	

## DAMPERS

COMB. FIRE/SMOKE DAMPER		F	MANUAL BALANCING DAMPER
SMOKE DAMPER		S	MOTORIZED DAMPER
FIRE DAMPER		FS	BACKDRAFT DAMPER

## \* NOTE \*

ALL OF GENERAL NOTES ON THIS SHEET ARE TO BE APPLIED TO ALL OTHER DRAWINGS IN THIS SET. THE SYMBOLS AND ABBREVIATIONS SHOWN ON THIS SHEET MAY OR MAY NOT BE USED IN THIS SET OF DRAWINGS.

## GENERAL MECHANICAL SYMBOLS

	REVISION NUMBER - SHOWN ON PLANS
	NEW CONNECTION TO EXISTING
	LIMIT OF DEMOLITION
	NUMBER OF DETAIL ON SHEET
	NUMBER OF SHEET WHERE DETAIL APPEARS
	KEYNOTE
	CONTINUATION SYMBOL
	ROOM NAME AND NUMBER
	ITEM TO BE DEMOLISHED
	AREA NOT IN CONTRACT
	PIPE SIZE TAG (DIAMETER)
	ABOVE GROUND PIPING
	PIPE SLOPE TAG
	BELOW GROUND PIPING
	PIPE INVERT ELEVATION TAG
	EXISTING PIPE TAG
	PIPING BEING DEMOLISHED

## ABBREVIATIONS

ABV	ABOVE	MBH	ONE THOUSAND BTU PER HOUR
AC	AIR CONDITIONING	MCF	ONE THOUSAND CUBIC FEET
ADD	ADDENDUM	MD	MOTORIZED DAMPER
AFF	ABOVE FINISHED FLOOR	MECH	MECHANICAL
ALT	ALTERNATE	MFR	MANUFACTURER
AP	ACCESS PANEL	MIN	MINIMUM
ARCH	ARCHITECT/ARCHITECTURAL	MISC	MISCELLANEOUS
BFF	BELOW FINISHED FLOOR	MTR	MOTOR
BTU	BRITISH THERMAL UNITS	NC	NOISE CRITERIA
BTUH	BRITISH THERMAL UNITS PER HOUR	NC	NORMALLY CLOSED
CAP	CAPACITY	NIC	NOT IN CONTRACT
CFM	CUBIC FEET PER MINUTE	NO	NORMALLY OPEN
CLG	CEILING	NTS	NOT TO SCALE
D	DEGREE	NUM	NUMBER
DB	DRY BULB	OA	OUTSIDE AIR
DIA	DIAMETER	PD	PRESSURE DROP
DN	DOWN	PLBG	PLUMBING
EAT	ENTERING AIR TEMP	PRESS	PRESSURE
ELEC	ELECTRICAL	PRV	PRESSURE REDUCING VALVE
EQUIP	EQUIPMENT	PSI	POUNDS PER SQUARE INCH
EWC	ELECTRIC WATER COOLER	PSIG	POUNDS PER SQUARE INCH (GAUGE)
EWT	ENTERING WATER TEMP	PWR	POWER
EA	EXHAUST AIR	RD	DUCT RISER
EXIST	EXISTING	RA	RETURN AIR
F	DEGREES FAHRENHEIT	REC	RECESSED
FL	FEET PER MINUTE	RED	REDUCER
FFM	FOOT/FEET	REL	RELATIVE HUMIDITY
FT	FOOT/FEET	RLA	RELIEF AIR
GAL	GALLON	RM	ROOM
GC	GENERAL CONTRACTOR	RPM	REVOLUTIONS PER MINUTE
GPM	GALLONS PER MINUTE	SF	SQUARE FOOT
HP	HORSEPOWER	SP	SUPPLY AIR
HTG	HEATING	SF	SQUARE FOOT
HTR	HEATER	SD	SMOKE DAMPER
IN	INCH	SM	SURFACE MOUNT
INV	INVERT	SP	STATIC PRESSURE
LB	POUND	T	THERMOSTAT
LB/HR	POUNDS PER HOUR	TD	TEMPERATURE DROP
LAT	LEAVING AIR TEMPERATURE	TEMP	TEMPERATURE
LP	LOW PRESSURE	TYP	TYPICAL
LVR	LOUVER	UG	UNDERGROUND
LWT	LEAVING WATER TEMP	VENT	VENTILATION
MA	MIXED AIR	WB	WET BULB
MAX	MAXIMUM		

## EQUIPMENT ABBREVIATIONS

AC	AIR CONDITIONING UNIT	EF	EXHAUST FAN
AHU	AIR HANDLING UNIT	EDH	ELECTRIC DUCT HEATER
CH	CHILLER	FCU	FAN COIL UNIT
CT	COOLING TOWER	GRV	GRAVITY ROOF VENTILATOR
CHWP	CHILLED WATER PUMP	PV	POWER ROOF VENTILATOR
CWP	CONDENSER WATER PUMP	RF	RETURN FAN
DC	DUCT MOUNTED COIL	RTU	ROOFTOP UNIT

## PIPING SYMBOLS

	CHWR	CHILLED WATER RETURN
	CHWS	CHILLED WATER SUPPLY
	CD	CONDENSATE DRAINAGE
		PIPE DROP
		PIPE RISE
		PIPE TEE
		CAP
		PLUG
		REDUCING 45 DEGREE TEE
		45 DEGREE TEE
		2" BALANCING VALVE
		2" SHUT OFF 1/4 TURN BALL VALVE
		2" CHECK VALVE
		2" M-CTRL MOTORIZED CONTROL VALVE
		2" 3-WAY CNTRL VALVE
		2" BUTTERFLY VALVE

## MECHANICAL NOTES

- CONTRACTOR IS RESPONSIBLE FOR VERIFICATION OF FIELD CONDITIONS PRIOR TO BEGINNING WORK AND ORDERING EQUIPMENT, AND FOR COORDINATING NEW EQUIPMENT DIMENSIONS AND MEANS AND METHODS FOR INSTALLATION WITH FIELD CONDITIONS.
- CONTRACTOR IS RESPONSIBLE TO COORDINATE WITH SUBMITTED EQUIPMENT TO ENSURE ALL INLET/OUTLET CONNECTIONS COORDINATE WITH FIELD INSTALLED DUCTWORK AND MAKE ANY NECESSARY DUCT MODIFICATIONS TO ENSURE PROPER OPERATION OF MECHANICAL EQUIPMENT.
- SUBMITTALS SHALL MEET SCHEDULED DESIGN CHARACTERISTICS, INCLUDING BUT NOT LIMITED TO CFMS, EAT(DBWB), ESP, CAPACITIES, VOLTAGES/PHASES, MCA/MOCP, SONES, ETC.
- ALL DUCT CONSTRUCTION, INSTALLATION, AND SUPPORTS ARE TO COMPLY WITH LATEST EDITION OF SMACNA'S HVAC DUCT CONSTRUCTION STANDARDS METAL AND FLEXIBLE DUCT. ALL DUCTWORK SHALL BE 2" PRESSURE CLASS UNLESS OTHERWISE NOTED.
- ROUND DUCTS AND FITTINGS SHALL BE SPIRAL SEAM CONSTRUCTION, MANUFACTURED FROM G60 GALVANIZED STEEL ACCORDING TO ASTM A653/A924 AND AS SPECIFIED. RECTANGULAR DUCTWORK SHALL BE MANUFACTURED FROM G60 GALVANIZED SHEET METAL STEEL ACCORDING TO ASTM A653/A653M AND AS SPECIFIED.
- ALL WALL-MOUNTED THERMOSTATS AND/OR TEMPERATURE SENSORS SHALL BE INSTALLED AT AN ELEVATION OF 48" ABOVE FINISHED FLOOR TO THE TOP UNLESS OTHERWISE NOTED ON DRAWINGS. LOCATION OF WALL-MOUNTED THERMOSTATS SHALL BE COORDINATED WITH OTHER TRADES FOR A NEAT APPEARANCE. FINAL LOCATION OF THERMOSTATS SHALL BE SUBJECT TO THE APPROVAL OF THE ENGINEER OR REPRESENTATIVE IN THE FIELD.
- ALL SUPPLY AIR DIFFUSERS SHALL BE 4-WAY THROW UNLESS NOTED OTHERWISE. CONTRACTOR SHALL PAINT INSIDE EACH RETURN GRILLE'S PLENUM AND DUCT CONNECTION FLAT BLACK TO CONCEAL CONNECTION, COORDINATE AIR DEVICE LOCATIONS WITH LIGHTING FIXTURES AND FIRE SPRINKLER HEADS. PRIOR TO INSTALLATION, THE CONTRACTOR IS TO REFER TO THE ARCHITECTURAL REFLECTED CEILING PLAN FOR ACTUAL FINAL LOCATIONS OF AIR DEVICES.
- CONTRACTOR SHALL COORDINATE DIFFUSER/GRILLE LOCATIONS WITH STRUCTURE IN EXPOSED SITUATIONS IN ORDER TO ENSURE AIR IS NOT DIRECTLY SUPPLIED OR RETURNED OVER STRUCTURE OR OTHER TRADE COMPONENTS SUCH AS FIRE SPRINKLER PIPING, PLUMBING PIPING, ETC., CAUSING DUST ACCUMULATION. DUCTWORK ALONG WITH DIFFUSER/GRILLE LOCATIONS SHALL BE INSTALLED SYMMETRICALLY WITH ANY ADJACENT DUCTWORK/GRILLES. CENTER DIFFUSERS/GRILLES BETWEEN STRUCTURAL MEMBERS WHERE DUCTWORK AND STRUCTURAL MEMBERS ARE EXPOSED. CONTRACTOR SHALL BE RESPONSIBLE FOR FINAL INSTALLATION APPEARANCE AND SHALL MAKE APPROPRIATE CHANGES WHERE DIRECTED BY ARCHITECT/ENGINEER AT THEIR OWN EXPENSE WHERE ITEMS ARE NOT INSTALLED PER ABOVE STANDARDS.
- CONTRACTOR SHALL PROVIDE A COPY OF THE TEST AND BALANCE REPORT BY AN AABC OR NEBB CERTIFIED AGENCY. THIS REPORT MUST BE REVIEWED AND APPROVED BY THE ENGINEER PRIOR TO THE FINAL INSPECTION. THE CONTRACTOR MUST ALSO PROVIDE ALL REPORTS REQUIRED BY THE SPECIFICATION. OUTDOOR TEMPERATURE (DB); OUTSIDE AIR (DBWB & CFM); SUPPLY AIR AT UNIT DISCHARGE (DBWB & CFM); RETURN AIR (MIXED) (DBWB & CFM); LEAVING COIL (DBWB); DIFFUSER/GRILLE (DBWB); EQUIPMENT (EWT/LWT); EQUIPMENT (EAT/LAT); EQUIPMENT (GPM); EQUIPMENT (PRESSURES). OUTSIDE AIR CFM SHALL BE MEASURED DIRECTLY AND NOT CALCULATED FROM THE DIFFERENCE BETWEEN SUPPLY AIR CFM AND RETURN AIR CFM.
- CONTRACTOR SHALL MAKE NECESSARY ADJUSTMENTS DURING TEST AND BALANCE AS REQUIRED TO ENSURE EQUIPMENT IS OPERATING WITHIN 10% OF THE SPECIFIED CRITERIA. THIS INCLUDES, BUT IS NOT LIMITED TO, ADJUSTING BELTS, SHEAVES, PULLEYS, AND IMPELLERS.
- ALL AIR HANDLING UNITS SHALL BE MECHANICALLY ATTACHED TO OTHER AIR DISTRIBUTION SYSTEM COMPONENTS. AIR HANDLING UNITS LOCATED OUTSIDE THE CONDITIONED SPACE SHALL BE SEALED USING APPROVED CLOSURE SYSTEMS CONFORMING TO THE APPROVED CLOSURE AND MECHANICAL APPLICATION REQUIREMENTS OF FLORIDA BUILDING CODE.
- ALL DUCTWORK MUST BE INSTALLED 6" AWAY FROM ANY FIRE RATED WALL TO FACILITATE INSPECTION.
- THE GENERAL CONTRACTOR IS RESPONSIBLE FOR ALL TRADES INSTALLATION SCHEDULES. FIXTURE WORK SUCH AS DUCTWORK AND PLUMBING SHALL BE INSTALLED PRIOR TO ANY TRADE WORK THAT CAN BE EASILY RELOCATED OR OFFSET SUCH AS ELECTRICAL CONDUITS, SMALL WATER LINES, ETC. IDEALLY DUCTWORK SHALL BE INSTALLED FIRST.
- PROVIDE A FIRE DAMPER AT EVERY DUCT PENETRATION OF A FIRE-RATED WALL OR CEILING, WHETHER SHOWN ON DRAWINGS OR NOT. ALL FIRE DAMPERS SHALL BE DYNAMIC TYPE WITH BLADES OUTSIDE AIRSTREAM, UNLESS NOTED OTHERWISE.
- PROVIDE FIRE, SMOKE, AND COMBINATION FIRE/SMOKE DAMPERS AT EVERY LOCATION WHERE REQUIRED BY SECTION 607.5 OF THE FBC-MECHANICAL, WHETHER SHOWN ON DRAWINGS OR NOT. PROVIDE PROPER DAMPER ACTUATION IN ACCORDANCE WITH SECTION 607.3.3 OF THE FBC-MECHANICAL. PROVIDE ACCESS AND IDENTIFICATION IN ACCORDANCE WITH SECTION 607.4 OF THE FBC-MECHANICAL.
- PENETRATIONS FOR PIPES, CONDUITS OR OTHER PURPOSES THROUGH ASSEMBLIES (FLOORS, ROOF, WALLS, PARTITIONS, ETC.) WITH A REQUIRED FIRE RESISTANCE RATING SHALL BE SEALED TO THE PENETRATING MEMBER IN AN APPROVED MANNER WHICH MAINTAINS THE REQUIRED FIRE RESISTANCE RATING OF THE ASSEMBLY.
  - WHERE HOLES FOR PENETRATIONS ARE FORMED CIRCULAR OR CORE-BORED, THE PENETRATION SHALL BE PROTECTED WITH FIRE-SEAL BRAND SMOKE AND FIRE STOP FITTINGS BY O-Z GEDNEY, LINK-SEAL BRAND BY THUNDER LINE, OR EQUAL APPROVED BY ENGINEER.
  - WHERE HOLES FOR PENETRATIONS ARE IRREGULAR (NON-CIRCULAR) IN SHAPE, THE PENETRATION SHALL BE PROTECTED WITH DOW CORNING 3-6548, SILICONE RTV FOAM, 3M FIRE BARRIER PENETRATION SEAL SYSTEM, OR EQUAL APPROVED BY THE ENGINEER.
- PROVIDE CEILING RADIATION DAMPERS AT PENETRATIONS TO CEILING MEMBRANE OF A FIRE-RESISTANCE-RATED FLOOR/CEILING OR ROOF/CEILING ASSEMBLY IN ACCORDANCE WITH SECTION 607.6.2 OF THE FBC-MECHANICAL.
- INTENT OF MECHANICAL NOTES ON DRAWINGS IS TO CLARIFY THE SCOPE OF WORK AND ALERT CONTRACTOR OF EXISTING CONDITIONS. CONTRACTOR IS TO VISIT THE SITE AND VERIFY ALL CLEARANCES BEFORE FABRICATION OF DUCTWORK, AND PROVIDE ADDITIONAL OFFSET AND/OR CHANGES IN DUCT SIZES TO MEET FIELD CONDITIONS, AND TO COORDINATE WITH ELECTRICAL, PLUMBING, AND FIRE PROTECTION SUBCONTRACTORS, BEFORE ANY CONSTRUCTION WORK.
- FLEXIBLE AND RIGID ROUND DUCT TAKE-OFFS FOR DIFFUSERS SHALL BE THE SAME SIZE AS DIFFUSER NECK. MAXIMUM FLEXIBLE DUCT LENGTH SHALL BE 5'-0".
- INSTALL DUCTWORK AS HIGH AS POSSIBLE, TIGHT TO BOTTOM OF STRUCTURE, UNLESS NOTED OTHERWISE. COORDINATE DUCT ELEVATIONS WITH RAIN LEADERS, WATER PIPING, SANITARY DRAINS, AND MAJOR ELECTRICAL CONDUITS.

## MECHANICAL NOTES

- CONTRACTOR SHALL PROVIDE ALL SUPPLEMENTARY STEEL, STRUCTURES, INSERTS, SLEEVES, AND HANGING DEVICES REQUIRED TO INSTALL AND ADEQUATELY SUPPORT MECHANICAL EQUIPMENT AND COMPONENTS IN A MANNER WHICH WILL NOT OVERLOAD BUILDING STRUCTURE. CONTRACTOR SHALL COORDINATE WITH GENERAL CONTRACTOR AND ALL BUILDING TRADES TO AVOID CONFLICTS AND TO MAINTAIN EQUIPMENT ACCESS AND SERVICEABILITY.
- PROVIDE A TRAP IN ALL CONDENSATE PIPING LOCATED AT THE AIR HANDLING EQUIPMENT. INSULATE ALL CONDENSATE LINES WITH 1/2" CLOSED CELL FOAM INSULATION. ALL PIPING EXPOSED TO EXTERNAL ELEMENTS SHALL BE JACKETED WITH UV STABILIZED PVC OR ALUMINUM SHEETING.
- IT IS THE RESPONSIBILITY OF THE MECHANICAL INSTALLER TO PATCH AND REPAIR ANY DUCT OPENINGS WHICH RESULT FROM THE RELOCATION OR ELIMINATION OF ANY EXISTING AIR DEVICES. THE PATCH IS TO BE OF A SIMILAR MATERIAL TO THE REPAIRED DUCT AND TO BE SEALED IN ACCORDANCE WITH SMACNA STANDARDS.
- AIR HANDLING EQUIPMENT WARRANTIES SHALL BE EQUAL TO OR EXCEED WARRANTY OF SCHEDULED EQUIPMENT, UNLESS NOTED OTHERWISE.
- PROVIDE ADDITIONAL DUCTWORK AND PIPING SUPPORTS ON BOTH SIDES AND WITHIN 18" OF EACH FIRE RATED WALL. DUCTWORK OR PIPING SHALL NOT BE SUPPORTED FROM ANY FIRE RATED WALL.
- ALL RECTANGULAR DUCTWORK SHALL BE PROVIDED WITH RADIUSED ELBOWS UNLESS NOTED OTHERWISE ON DRAWINGS. FOR MITERED ELBOWS, PROVIDE SINGLE WALL TURNING VANES IN ALL RECTANGULAR DUCT ELBOWS WITH ANGLES FROM 45 DEGREES TO 90 DEGREES, EXCEPT FOR TRANSFER AIR ELBOWS. TURNING VANES SHALL BE PROVIDED ACCORDING TO SMACNA HVAC DUCT CONSTRUCTION STANDARDS METAL AND FLEXIBLE.
- DUCT DIMENSIONS SHOWN ON DRAWINGS ARE CLEAR INSIDE DIMENSIONS (FREE AREA).
- ALL HVAC EQUIPMENT SHALL BE INSTALLED PER MANUFACTURER'S RECOMMENDATIONS UNLESS INDICATED OTHERWISE.
- CONTRACTOR SHALL THOROUGHLY CLEAN AND ENSURE PROPER OPERATION OF ANY EXISTING HVAC EQUIPMENT AND COMPLETE SYSTEMS. ANY CHANGE TO THE SYSTEM SHALL RESULT IN EQUIPMENT MODIFICATIONS (AS REQUIRED) INCLUDING BUT NOT LIMITED TO REPLACING MOTORS, VFDs, PULLEYS, SHEAVES, BELTS, ETC. CONTRACTOR SHALL REPLACE ALL EQUIPMENT FILTERS AT COMPLETION OF CONSTRUCTION.
- CONTRACTOR SHALL PROVIDE A PERMANENT/PROFESSIONAL LABEL FOR EACH PIECE OF EQUIPMENT, ASSOCIATED THERMOSTAT(S) AND/OR SENSOR(S).
- DUCTWORK, DIFFUSERS, REGISTERS, GRILLES, AND OTHER MECHANICAL SYSTEM COMPONENTS SHALL NOT BE SUPPORTED BY THE CEILING OR CEILING SUSPENSION SYSTEM.
- LOW PRESSURE SUPPLY AND RETURN DUCTWORK SHALL BE EXTERNALLY INSULATED SHEET METAL CONSTRUCTION IN ACCORDANCE WITH LATEST SMACNA STANDARDS UNLESS OTHERWISE NOTED. DUCT INSULATION TO BE 2" THICK FOIL BACK WRAP, K=0.25 BTU-IN/SF-HR-F, 1.50LB/CF. INSTALLED R-VALUE = 6 MINIMUM. AS MANUFACTURED BY JOHNS MANVILLE OR EQUAL. JOINTS TO BE STAPLED AND TAPED WITH PRESSURE SENSITIVE TAPE (PER FMC 603) AS MANUFACTURED BY COMPAC INDUSTRIES MODEL # 120 (FLAME SPREAD = 5, SMOKE DEVELOPED = 10) OTHER ACCEPTABLE MANUFACTURERS ARE OWENS CORNING AND KNAUF. FACING SHALL BE FSK ALUMINUM FOIL. CONSTRUCTION SHALL COMPLY WITH RECOMMENDATIONS AND DETAILS IN SMACNA DUCT CONSTRUCTION STANDARDS, LATEST REVISION, AND MANUFACTURER'S RECOMMENDATIONS. SUPPORT DUCTS WITH 1x2x1/2 GAGE MINIMUM CHANNELS AND STRAP OR 12-GAGE WIRE FROM BUILDING CONSTRUCTION. SUSPEND FROM JOISTS WITH BEAM CLAMPS. PROVIDE HOT DIPPED STEEL FASTENERS, ANCHORS, RODS, STRAPS, TRIM AND ANGLES FOR SUPPORT OF DUCTWORK. DUCT SIZES ON CONSTRUCTION DOCUMENTS ARE INTERNAL FREE-AREA DIMENSIONS.
- EXPOSED DUCTWORK SHALL BE DOUBLE WALL INSULATED DUCTWORK WITH R-8 INSULATION. SPIRAL DUCTWORK SHALL BE INSTALLED IN ACCORDANCE WITH LATEST SMACNA STANDARDS UNLESS OTHERWISE NOTED. ALL EXPOSED DUCT SHALL CONTAIN DIFFUSERS/GRILLES EQUAL TO SCHEDULED MAKE AND MODEL. PAINT GRIP AND PAINT PER ARCHITECT.
- ALL MEDIUM PRESSURE SUPPLY DUCTWORK SHALL BE EXTERNALLY INSULATED SHEET METAL CONSTRUCTION IN ACCORDANCE WITH LATEST SMACNA STANDARDS. DUCT INSULATION TO BE 2" THICK FOIL BACK WRAP, K=0.25 BTU-IN/SF-HR-F, 1.50 LB/CF. INSTALLED R-VALUE = 6 MINIMUM, AS MANUFACTURED BY SCHULLER. JOINTS TO BE STAPLED AND TAPED WITH PRESSURE SENSITIVE TAPE AS MANUFACTURED BY COMPAC INDUSTRIES MODEL #120 (FLAME SPREAD = 5, SMOKE DEVELOPED = 10) OTHER ACCEPTABLE MANUFACTURERS ARE OWENS CORNING AND KNAUF.
- ALL EXHAUST DUCT WORK SHALL BE NON-INSULATED SHEET METAL, UNLESS NOTED OTHERWISE.
- ALL FLEXIBLE DUCTS SHALL BE LISTED AND LABELED TO UL 181 AND SHALL BE CLASS 0 OR CLASS 1. FLEXIBLE DUCTS SHALL HAVE A MINIMUM RATED AIR VELOCITY OF 4000 FPM, A MINIMUM POSITIVE PRESSURE RATING OF 4 IN. WG, AND A MINIMUM NEGATIVE PRESSURE RATING OF 1 IN. WG. ALL FLEXIBLE DUCTS SHALL MEET 2020 FLORIDA BUILDING CODE MECHANICAL SECTION 603.6.
- ALL DOOR UNDERCUTS FOR THE PURPOSE OF BALANCING RETURN AIR SHALL BE MINIMUM 1", PER FBC-MECHANICAL SECTION 601.6.
- ALL CONTROL WIRING SHALL BE INCLUDED AS PART OF MECHANICAL WORK; REFER TO ELECTRICAL SPECIFICATIONS FOR CONDUIT AND WIRING REQUIREMENTS. COORDINATE WITH ELECTRICAL CONTRACTOR TO ENSURE THAT REQUIRED INTERFACE DEVICES ARE PROVIDED WITH ELECTRICAL COMPONENTS (I.E. FAN SPEED RHEOSTATS, AUXILIARY CONTACTS, INTERLOCKS, ETC.).
- ALL EQUIPMENT DISCONNECTS, WHETHER INTERNALLY MOUNTED OR EXTERNALLY MOUNTED, SHALL BE FURNISHED AND INSTALLED BY MECHANICAL CONTRACTOR, WIRED BY ELECTRICAL CONTRACTOR. IF EXTERNALLY MOUNTED, PROVIDE DISCONNECTING MEANS AT SAME ELEVATION AS EQUIPMENT. REFER TO ELECTRICAL SPECIFICATIONS FOR REQUIREMENTS.
- MECHANICAL CONTRACTOR SHALL COORDINATE ELECTRICAL CHARACTERISTICS AND REQUIREMENTS OF ALL MECHANICAL EQUIPMENT WITH ELECTRICAL CONTRACTOR BEFORE BIDDING/ORDERING AND INSTALLATION.
- WHERE MOTOR SPEED CONTROL IS REQUIRED, THE CONTRACTOR IS RESPONSIBLE FOR PROVIDING THE APPROPRIATE METHOD OF SPEED CONTROL. TYPICALLY, SINGLE PHASE MOTORS REQUIRE VFD'S, CONTROLLERS, AND THREE PHASE MOTORS REQUIRE VFD'S.

## GENERAL NOTES

- THESE DRAWINGS ARE DIAGRAMMATIC IN NATURE AND INDICATIVE OF WORK TO BE PROVIDED (FURNISHED AND INSTALLED) UNDER THIS CONTRACT. DRAWINGS SHOULD NOT BE SCALED.
- THE CONTRACTOR IS RESPONSIBLE TO EXAMINE THE EXISTING CONDITIONS UNDER WHICH THEY SHALL OPERATE AND VERIFY THE EXTENT OF WORK REQUIRED TO COMPLETE THE WORK UNDER THIS CONTRACT.
- PRIOR TO ORDERING AND FABRICATING ANY EQUIPMENT, IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO EXAMINE THE PHYSICAL CONDITIONS AT THE PROJECT SITE AND VERIFY SPACE AND SUFFICIENT CLEARANCES ARE AVAILABLE FOR INSTALLING EQUIPMENT, DUCTWORK, PIPING, AND APPURTENANCES, AND TO DETERMINE ANY NECESSARY MODIFICATIONS.
- PERFORM ALL WORK IN COMPLIANCE WITH ALL APPLICABLE FEDERAL, STATE, AND LOCAL CODES, REGULATIONS, AND STANDARDS ADOPTED BY THE AUTHORITY HAVING JURISDICTION. IF CONFLICTS EXIST BETWEEN THESE ENGINEERING DOCUMENTS AND CODES, THE MOST STRINGENT REQUIREMENTS SHALL GOVERN.
- ALL CONSTRUCTION WORK SHALL ALSO MEET THE FOLLOWING CODE REQUIREMENTS:
  - FLORIDA BUILDING CODE (FBC) 2023
  - FLORIDA EXISTING BUILDING CODE 2023
  - FLORIDA BUILDING CODE - MECHANICAL 2023
  - FLORIDA BUILDING CODE - PLUMBING 2023
  - FLORIDA BUILDING CODE - ENERGY CONSERVATION 2023
  - FLORIDA FIRE PREVENTION CODE 2023
  - NFPA 1-2021, THE UNIFORM FIRE CODE
  - NFPA 101-2021, THE LIFE SAFETY CODE
  - NFPA 51B-2019, STANDARD FOR FIRE PREVENTION DURING WELDING, CUTTING AND OTHER HOT WORK
  - NFPA 13-2019, STANDARD FOR THE INSTALLATION OF SPRINKLER SYSTEMS
  - NFPA 70-2020, NATIONAL ELECTRICAL CODE
  - NFPA 90A-2021, STANDARD FOR THE INSTALLATION OF AIR CONDITIONING AND VENTING SYSTEMS.
  - NFPA 241-2019, STANDARD FOR SAFEGUARDING CONSTRUCTION, ALTERATION AND DEMOLITION OPERATIONS.
- CONTRACTOR SHALL COORDINATE AND SEQUENCE DEMOLITION, CLEANING, AND CONSTRUCTION WORK.
- CONTRACTOR SHALL NOTE ANY SPECIAL REQUIREMENTS FOR INSTALLATION OF WORK UNDER THIS CONTRACT. DISMANTLE AND REASSEMBLE EQUIPMENT AS NECESSARY FOR ENTRY INTO THE BUILDING AND THE LOCATION OF INSTALLATION.
- THE CONTRACTOR SHALL MAINTAIN A COMPLETE PROJECT SCHEDULE AND SHALL UPDATE THIS SCHEDULE AS CHANGES SHALL BE NOTED AND AN UPDATED SCHEDULE SHALL BE PROVIDED TO THE OWNER.
- ALL PERMITS, FEES, TAXES, ETC SHALL BE PAID BY CONTRACTOR AS PART OF THE TOTAL PROJECT COST.
- MAINTAIN THE INTEGRITY OF ALL FIRE AND SMOKE RATED WALLS, PARTITIONS, CEILINGS, AND FLOORS. SEAL ALL PENETRATIONS THROUGH RATED ASSEMBLIES WITH FIRESTOP MATERIAL IN ACCORDANCE WITH U.L. REQUIREMENTS TO MAINTAIN THE ASSEMBLY RATING.
- CONTRACTOR SHALL FURNISH U.L. APPROVED DRAWINGS FOR EACH TYPE OF FIRE AND SMOKE RATED ASSEMBLY PENETRATION BY DUCTS, PIPES, OR CONDUITS, AND SHALL DISPLAY THESE DRAWINGS ON THE JOB SITE AT ALL TIMES DURING CONSTRUCTION.
- CONTRACTOR SHALL REFER TO ALL DETAILS FOR PROPER GUIDANCE.
- THE CONTRACTOR SHALL SUBMIT SHOP DRAWINGS AND EQUIPMENT SUBMITTALS FOR ALL PRODUCTS USED ON PROJECT.
- THE ENGINEER'S APPROVAL OF SUBMITTAL DATA SHALL NOT RELIEVE THE CONTRACTOR OF RESPONSIBILITY FOR DEVIATIONS FROM THE REQUIREMENTS OF CONTRACT DOCUMENTS UNLESS THE CONTRACTOR HAS RECEIVED WRITTEN APPROVAL FROM THE ENGINEER TO THE SPECIFIC DEVIATION. THE ENGINEER'S APPROVAL OF SUBMITTAL DATA SHALL NOT RELIEVE THE CONTRACTOR OF RESPONSIBILITY FOR ERRORS OR OMISSIONS IN HIS OR HER SUBMITTAL DATA.
- THE CONTRACTOR IS REQUIRED TO SUBMIT THREE COMPLETE O&M MANUALS IN THREE RING BINDERS AT SUBSTANTIAL COMPLETION. MANUALS SHALL INCLUDE INSTALLATION AND MAINTENANCE DATA ON ALL NEW EQUIPMENT AND MATERIALS, CERTIFIED TECHNICAL PRODUCT DATA, EQUIPMENT SHOP DRAWINGS, SPARE PARTS DATA, ETC. PROVIDE AN INDEX AND ASSOCIATED DIVIDERS.
- CLOSE OUT DOCUMENTS: THE CONTRACTOR IS TO MAINTAIN ONE SET OF CONSTRUCTION DRAWINGS ON SITE AND KEEP CURRENT WITH MARK UP AS-BUILT CONDITIONS DURING CONSTRUCTION OF THE PROJECT. THIS SET IS TO INCLUDE ALL CONTRACT CHANGES, MODIFICATIONS AND CLARIFICATIONS. THIS SET ALONG WITH ALL SHOP DRAWINGS SHALL BE TURNED OVER TO THE ARCHITECT/ENGINEER AFTER CONSTRUCTION COMPLETION.
- IT IS THE RESPONSIBILITY OF ALL BIDDERS TO THOROUGHLY REVIEW AND UNDERSTAND ALL CONSTRUCTION DOCUMENTS. THIS INCLUDES BUT IS NOT LIMITED TO ALL DRAWINGS, SPECIFICATION SECTIONS, ETC. THE DRAWINGS ARE SCHEMATIC IN NATURE. THEREFORE BEFORE STARTING ANY WORK, THE CONTRACTOR SHALL REVIEW ALL OTHER CONSTRUCTION DOCUMENTS, VERIFY FIELD CONDITIONS AND SHALL MAKE ANY REQUIRED MINOR ADJUSTMENTS WITHOUT EXTRA COST TO THE OWNER. ANY MAJOR DISCREPANCIES FOUND SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT/ENGINEER. THE BASE BID SHALL REFLECT THE TOTAL COST OF NEW EQUIPMENT INSTALLATION. THIS INCLUDES LABOR, EQUIPMENT AND MATERIALS. NO CHANGE ORDERS SHALL BE ISSUED WITHOUT WRITTEN CONSENT AND APPROVAL FROM ENGINEER AND ARCHITECT.

## MECHANICAL SHEET LIST

Sheet Number	Sheet Name
M001A	MECHANICAL NOTES, LEGENDS & ABBREVIATIONS - JIA
MD101A	PARTIAL FLOOR PLAN - MECHANICAL DEMOLITION - JIA
MH101A	PARTIAL FLOOR PLAN - MECHANICAL DUCTWORK - JIA
M401A	MECHANICAL SECTION VIEWS
M501A	MECHANICAL DETAILS - JIA
M601A	MECHANICAL SCHEDULES - JIA

DRAWN BY: PBL  
REVIEW BY: NPS

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P 883.682.1081  
F 883.687.6346  
E: AL0047@L

lunz.com




## GENERAL NOTES


- A. EXISTING EQUIPMENT, DUCTWORK, PIPING, DIFFUSERS, GRILLES, AND ASSOCIATED COMPONENTS SHOWN ON DRAWINGS ARE APPROXIMATE LOCATIONS AND ARE PROVIDED FOR REFERENCE USE ONLY. FIELD VERIFY AND COORDINATE WITH EXACT LOCATIONS, ELEVATIONS, SIZES, AND CONDITIONS OF EXISTING COMPONENTS.
- B. ALL EXISTING EQUIPMENT TO BE REUSED SHALL BE PRESSURE TESTED, THOROUGHLY CLEANED, AND SANITIZED TO AVOID POSSIBLE CONTAMINATION.
- C. PATCH ALL HOLES THROUGH WALLS, FLOORS, AND ROOFS TO MATCH EXISTING CONSTRUCTION.

## KEYNOTES


- 1 DEMOLISH RETURN DUCTWORK BACK TO MEZZANINE MECHANICAL ROOM WALL PENETRATION. REFER TO ENLARGED PLAN ON THIS SHEET FOR CONTINUATION.
- 2 DEMOLISH SUPPLY DUCTWORK BACK TO MEZZANINE MECHANICAL ROOM WALL PENETRATION. REFER TO ENLARGED PLAN ON THIS SHEET FOR CONTINUATION.
- 3 ALL EXISTING MECHANICAL SYSTEMS SHALL BE DEMOLISHED IN AREA INDICATED INCLUDING BUT NOT LIMITED TO ALL DUCTWORK, PIPING, CEILING DIFFUSERS AND GRILLES, HANGERS AND SUPPORTS, ACCESSORIES, ETC.
- 4 EXISTING EXHAUST DUCTWORK AND ASSOCIATED COMPONENTS SERVING AREA INDICATED SHALL BE DEMOLISHED BACK TO ASSOCIATED EXHAUST FAN ON ROOF. EXISTING ROOF EXHAUST FAN SHALL BE ABANDONED IN PLACE.
- 5 DEMOLISH EXISTING RETURN GRILLE AND RETURN DUCTWORK BACK TO EXISTING MAIN.
- 6 EXISTING THERMOSTATS SHALL REMAIN. (TYP. OF 4)

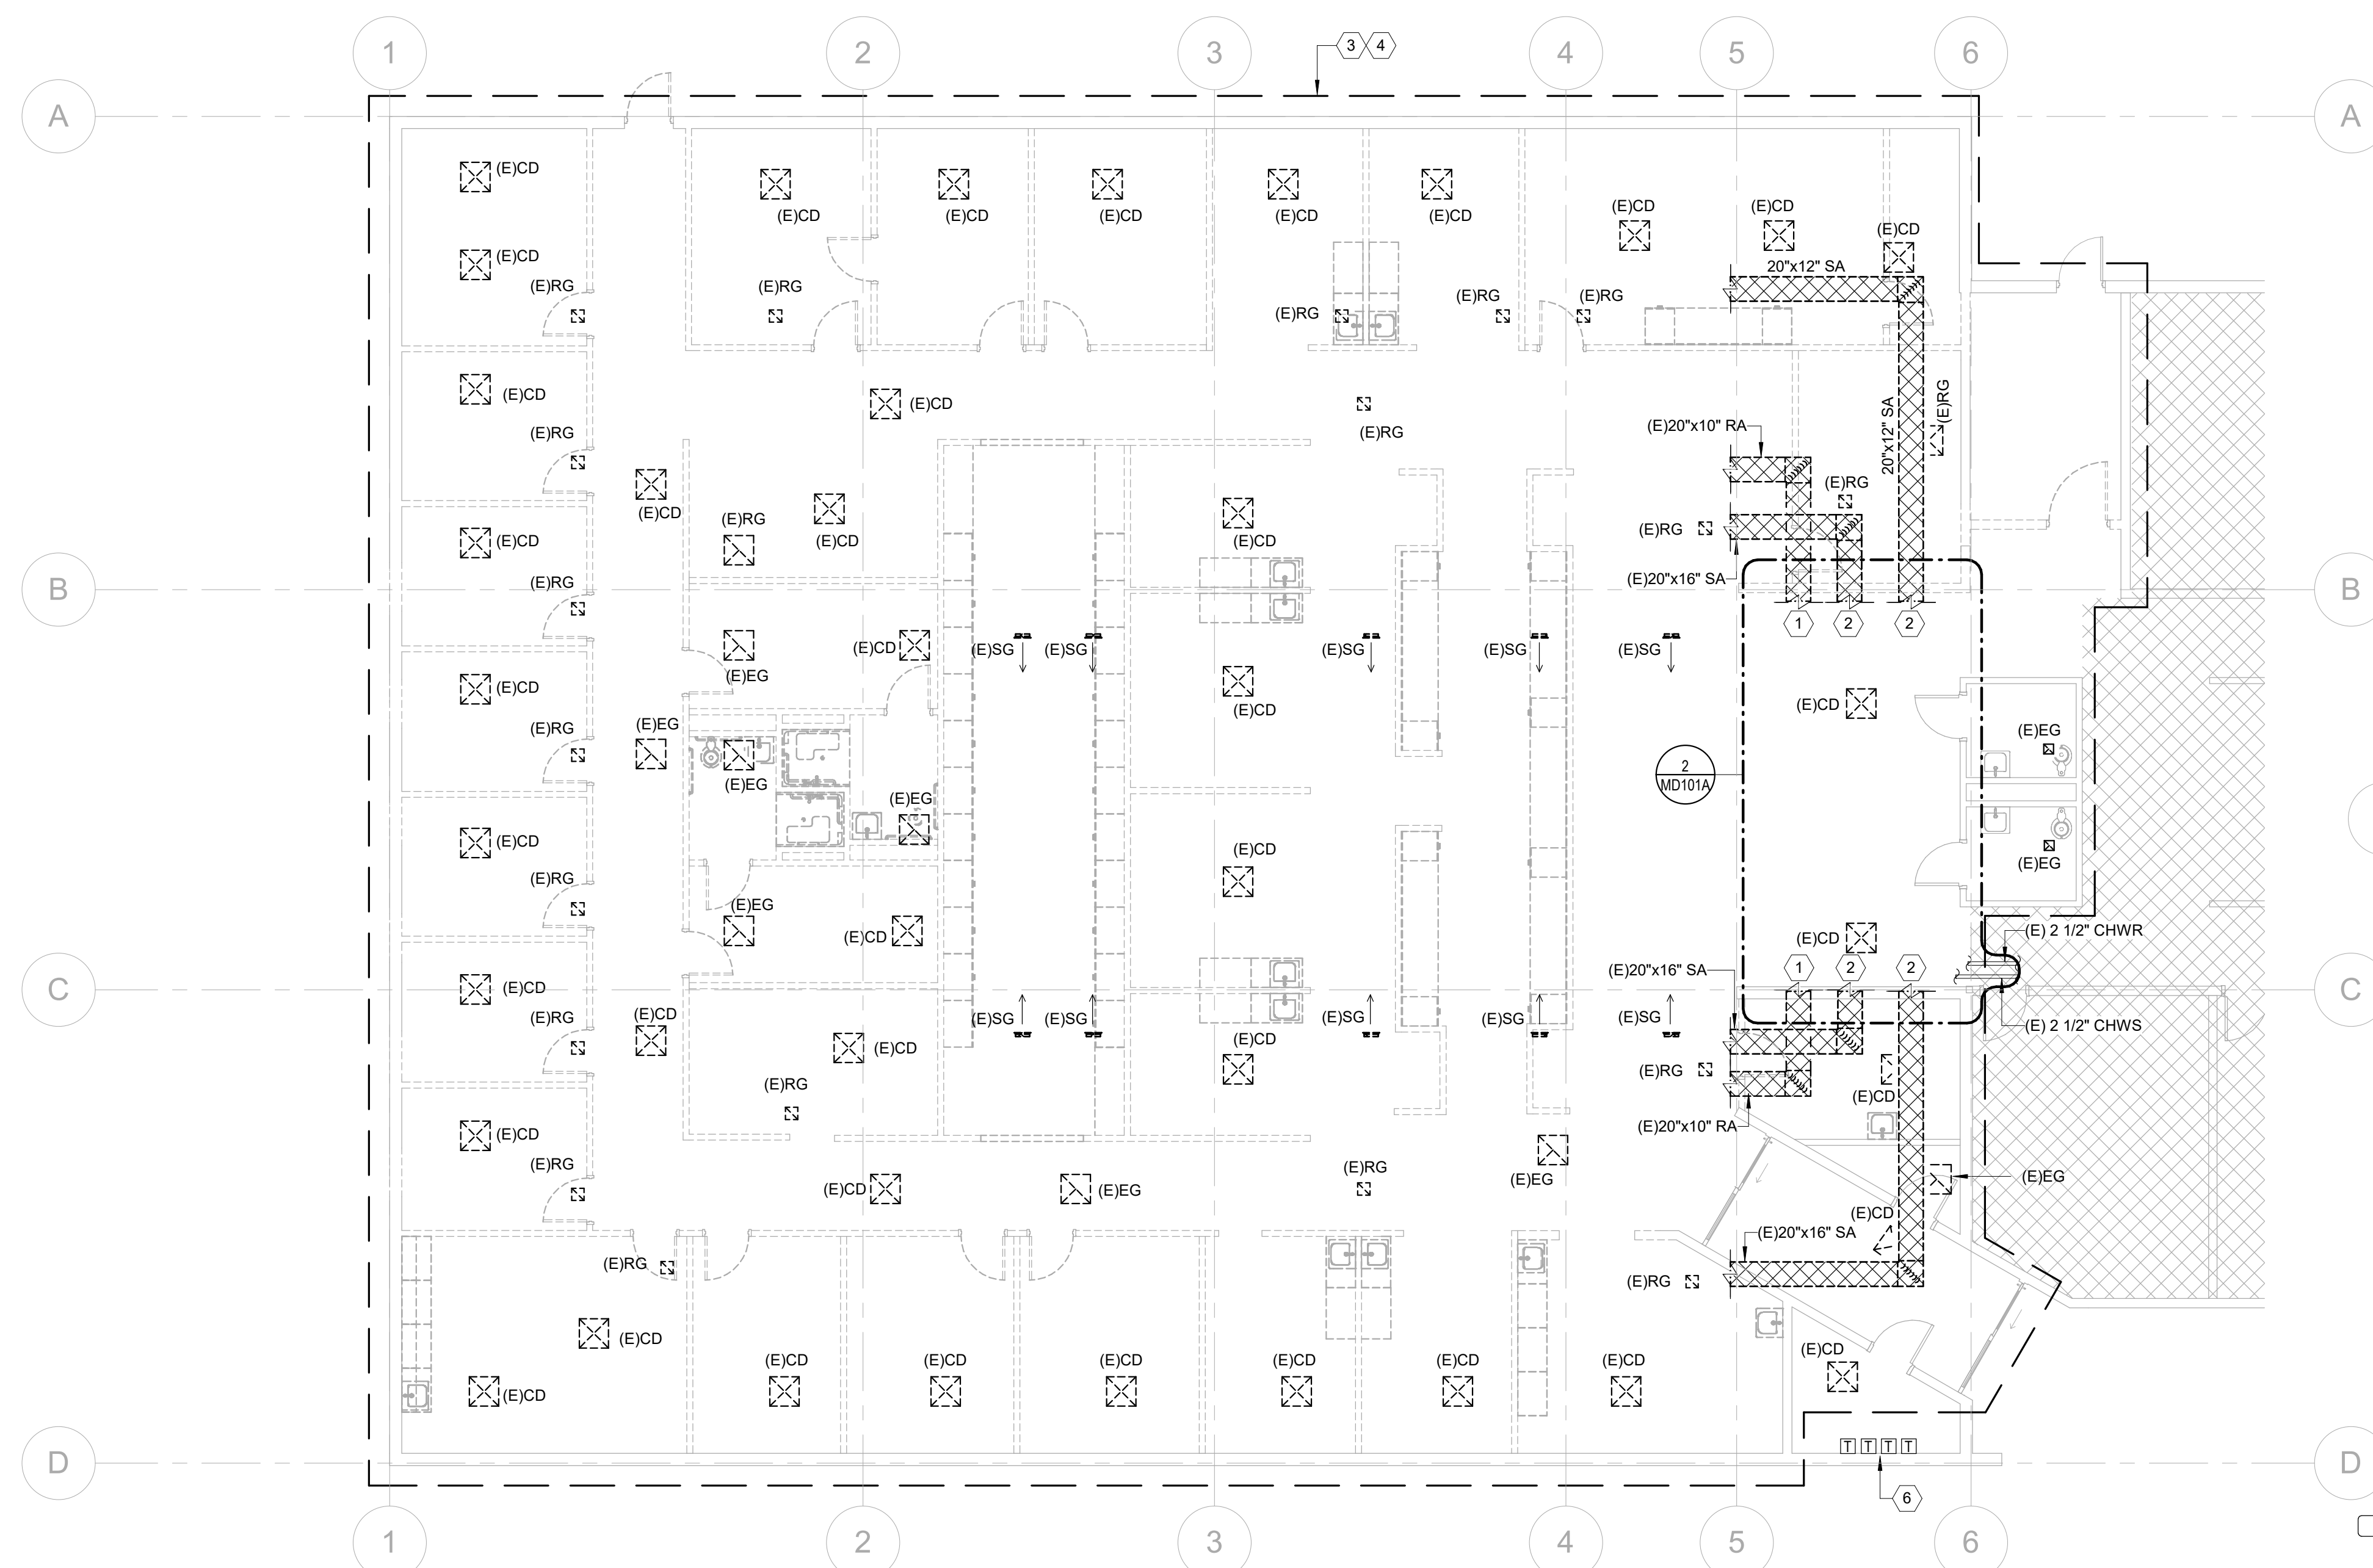

 1 PARTIAL FLOOR PLAN - MECHANICAL DEMOLITION - JIA  
1/8" = 1'-0"

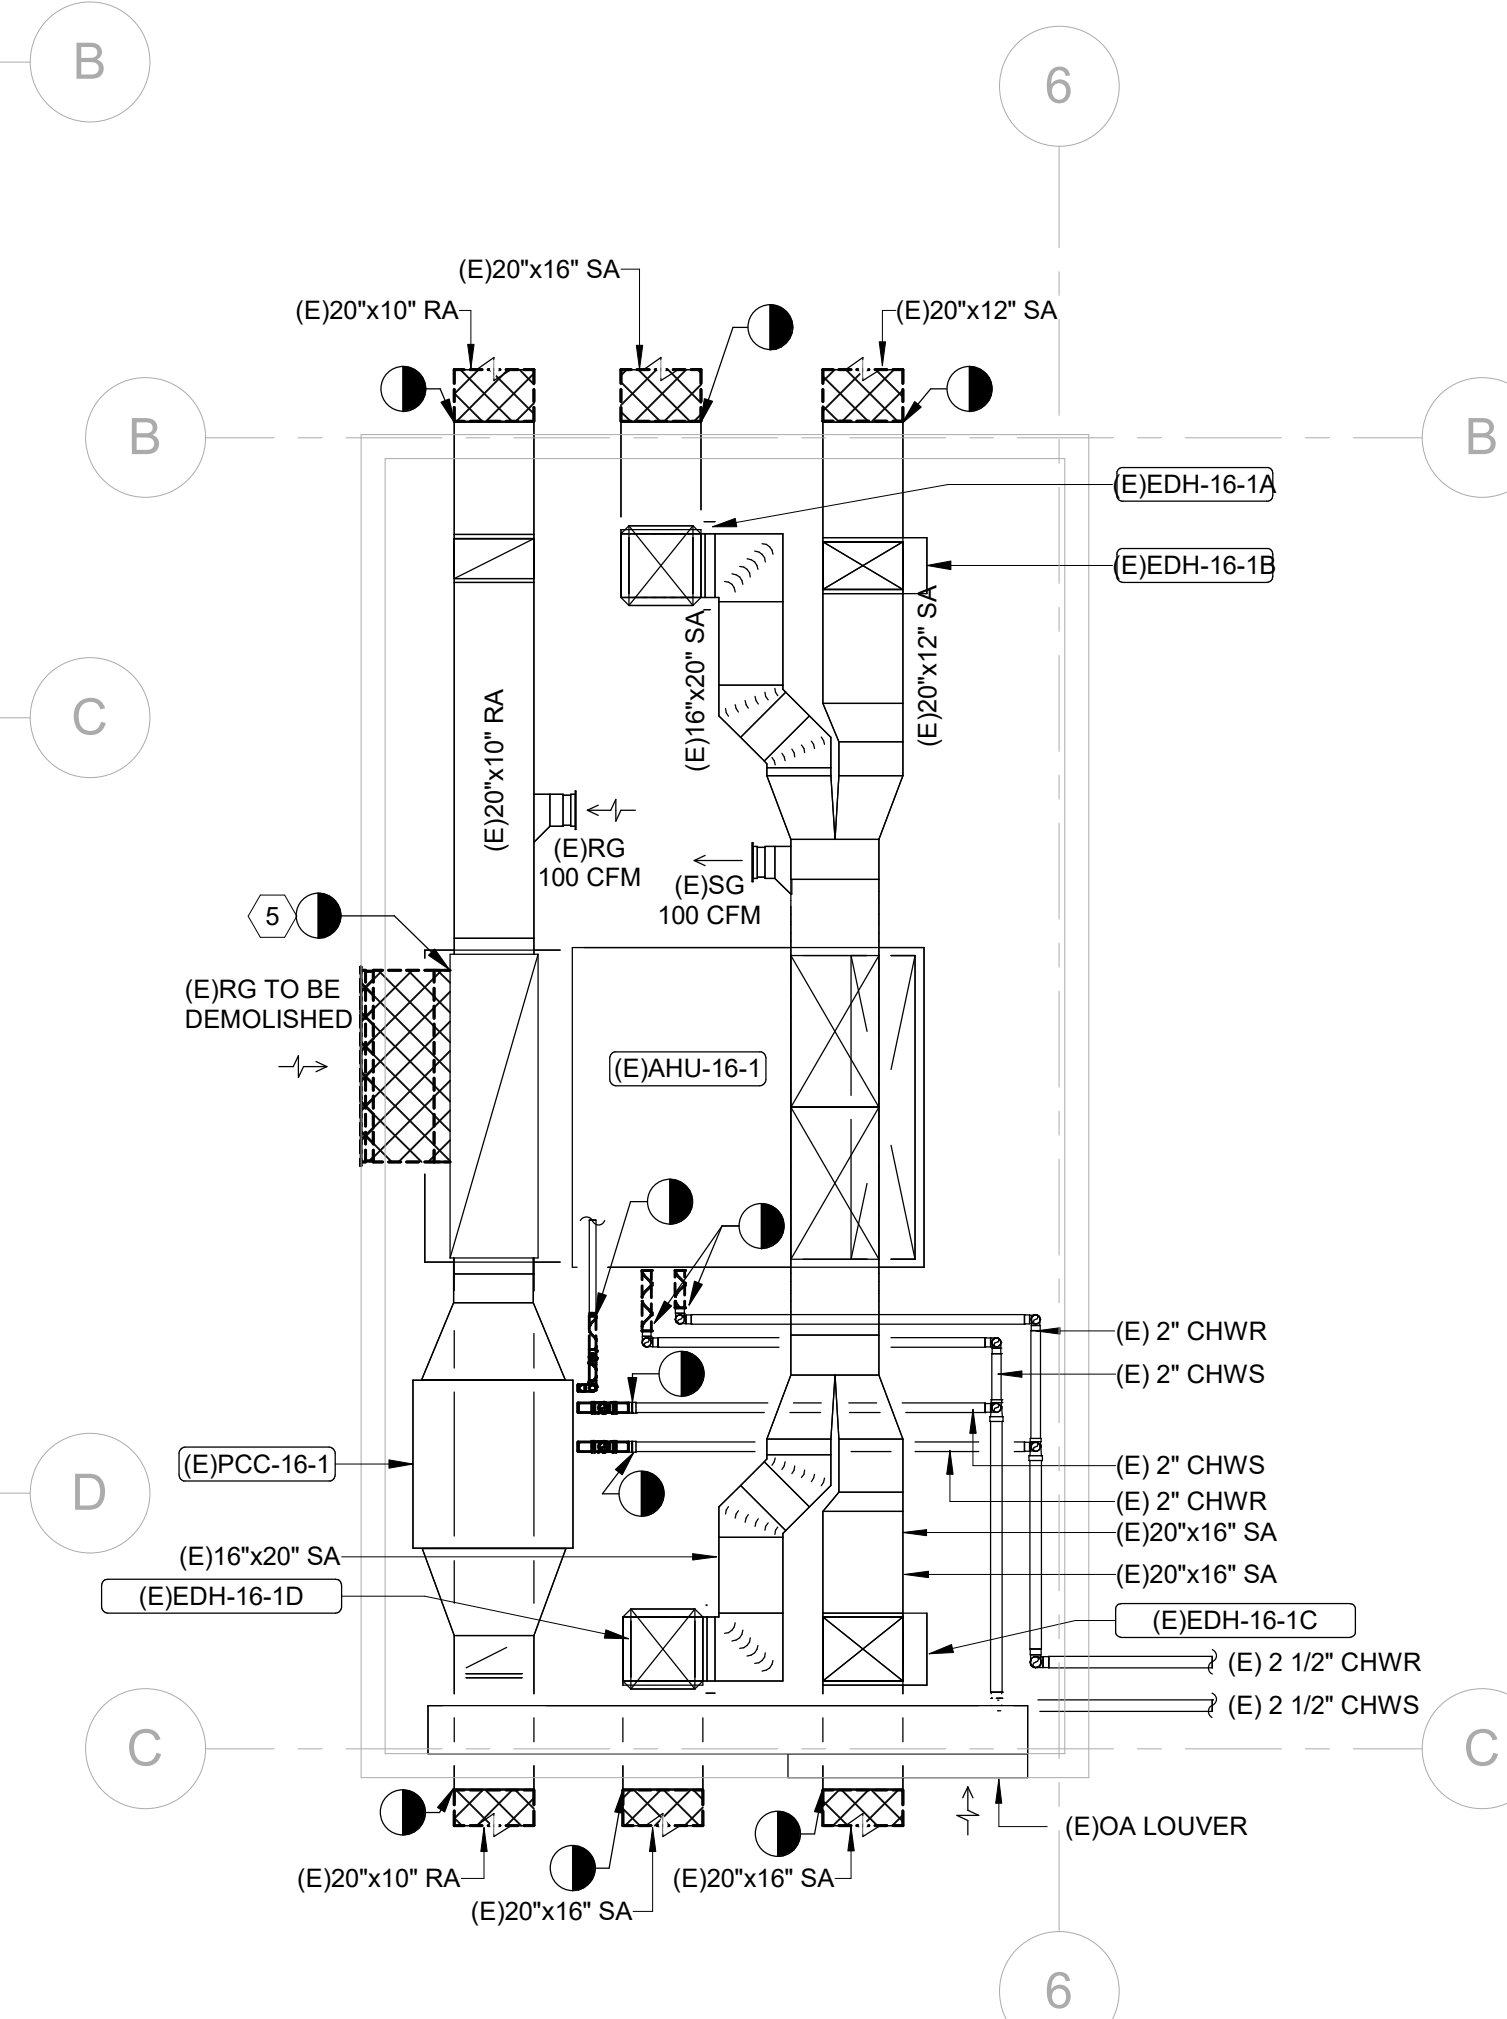

 2 ENLARGED PLAN - MEZZANINE PLAN - MECHANICAL DEMOLITION  
1/4" = 1'-0"

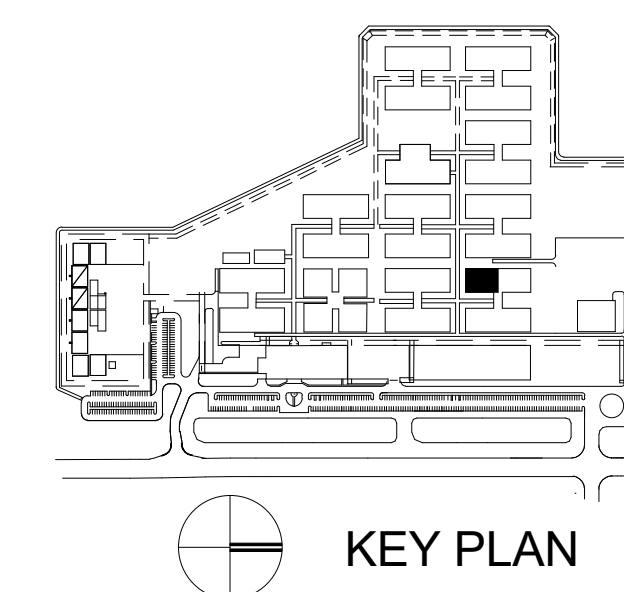

HCSO MENTAL HEALTH CLINIC

22310 N. FALKENBURG ROAD  
TAMPA, FLORIDA 33619

# PARTIAL FLOOR PLAN - MECHANICAL DEMOLITION - JIA

[illegible]

DRAWN BY: PBJ  
REVIEW BY: NPS


THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
p 863.682.1882  
f 863.687.6346  
lic. AR94778

lunz.com


24001.01

MD101A

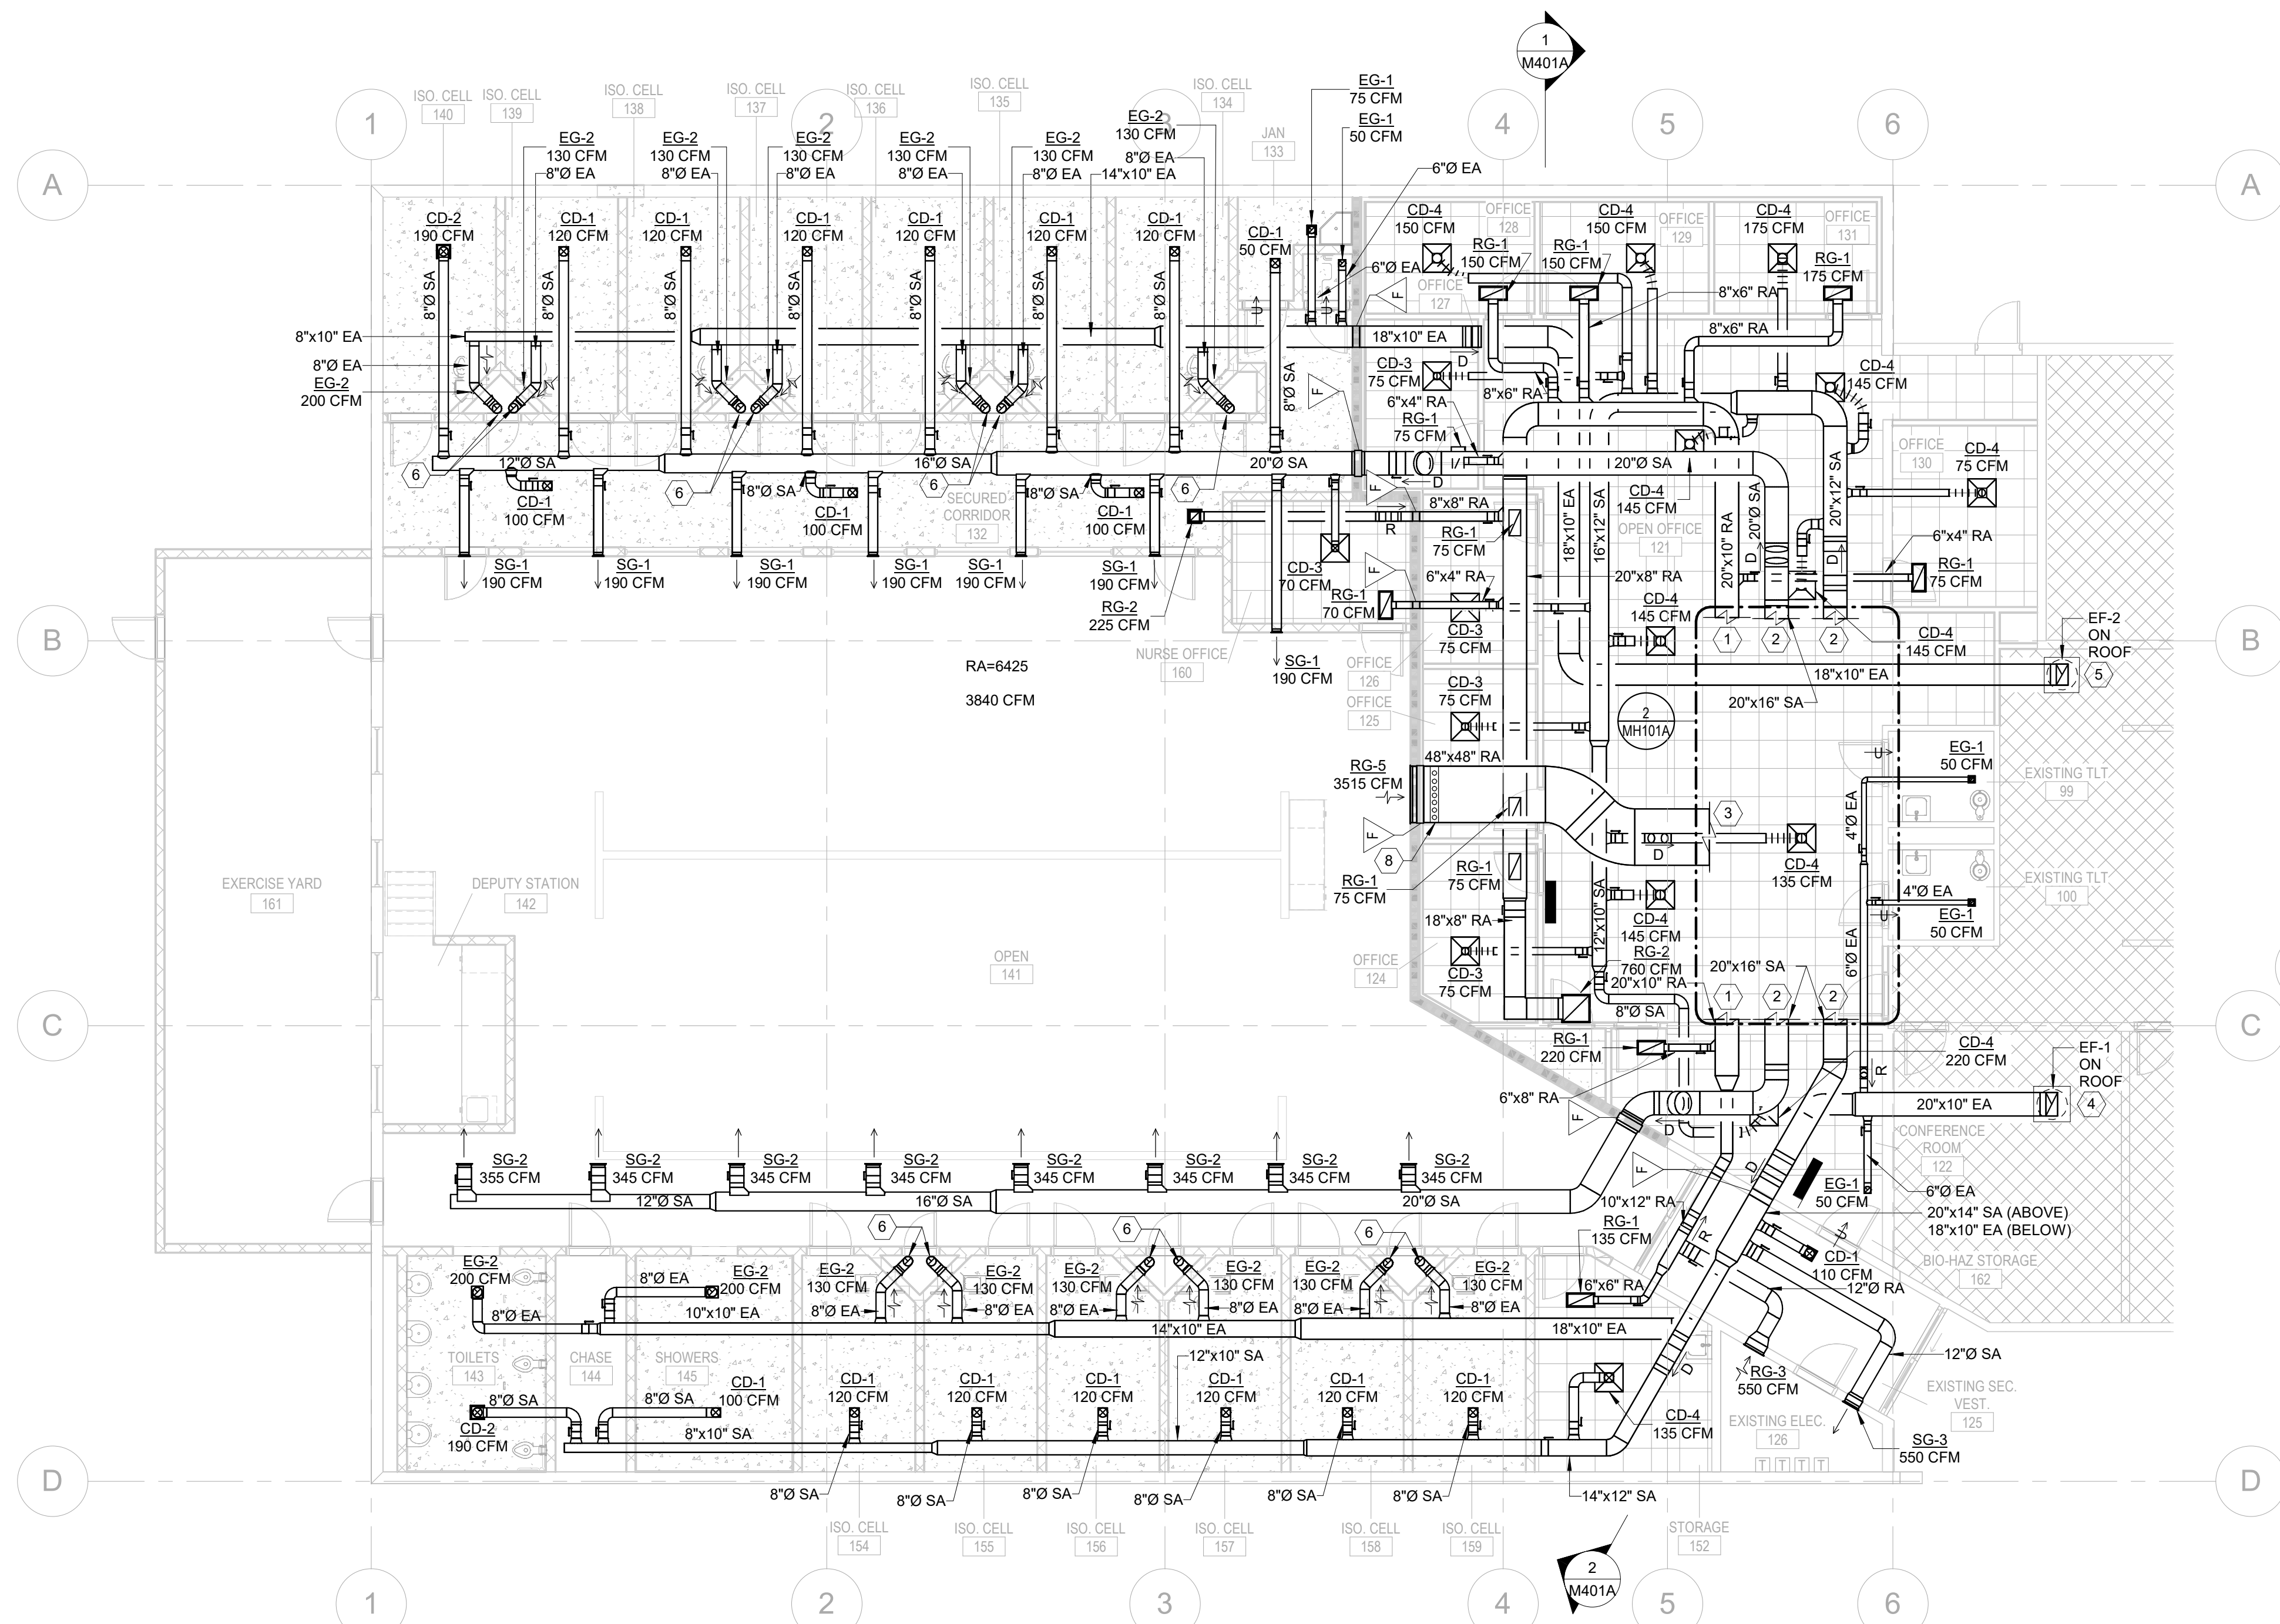

1 PARTIAL FLOOR PLAN - MECHANICAL DUCTWORK - JIA  
1/8" = 1'-0"

2 ENLARGED PLAN - MEZZANINE PLAN - MECHANICAL DUCTWORK  
1/4" = 1'-0"

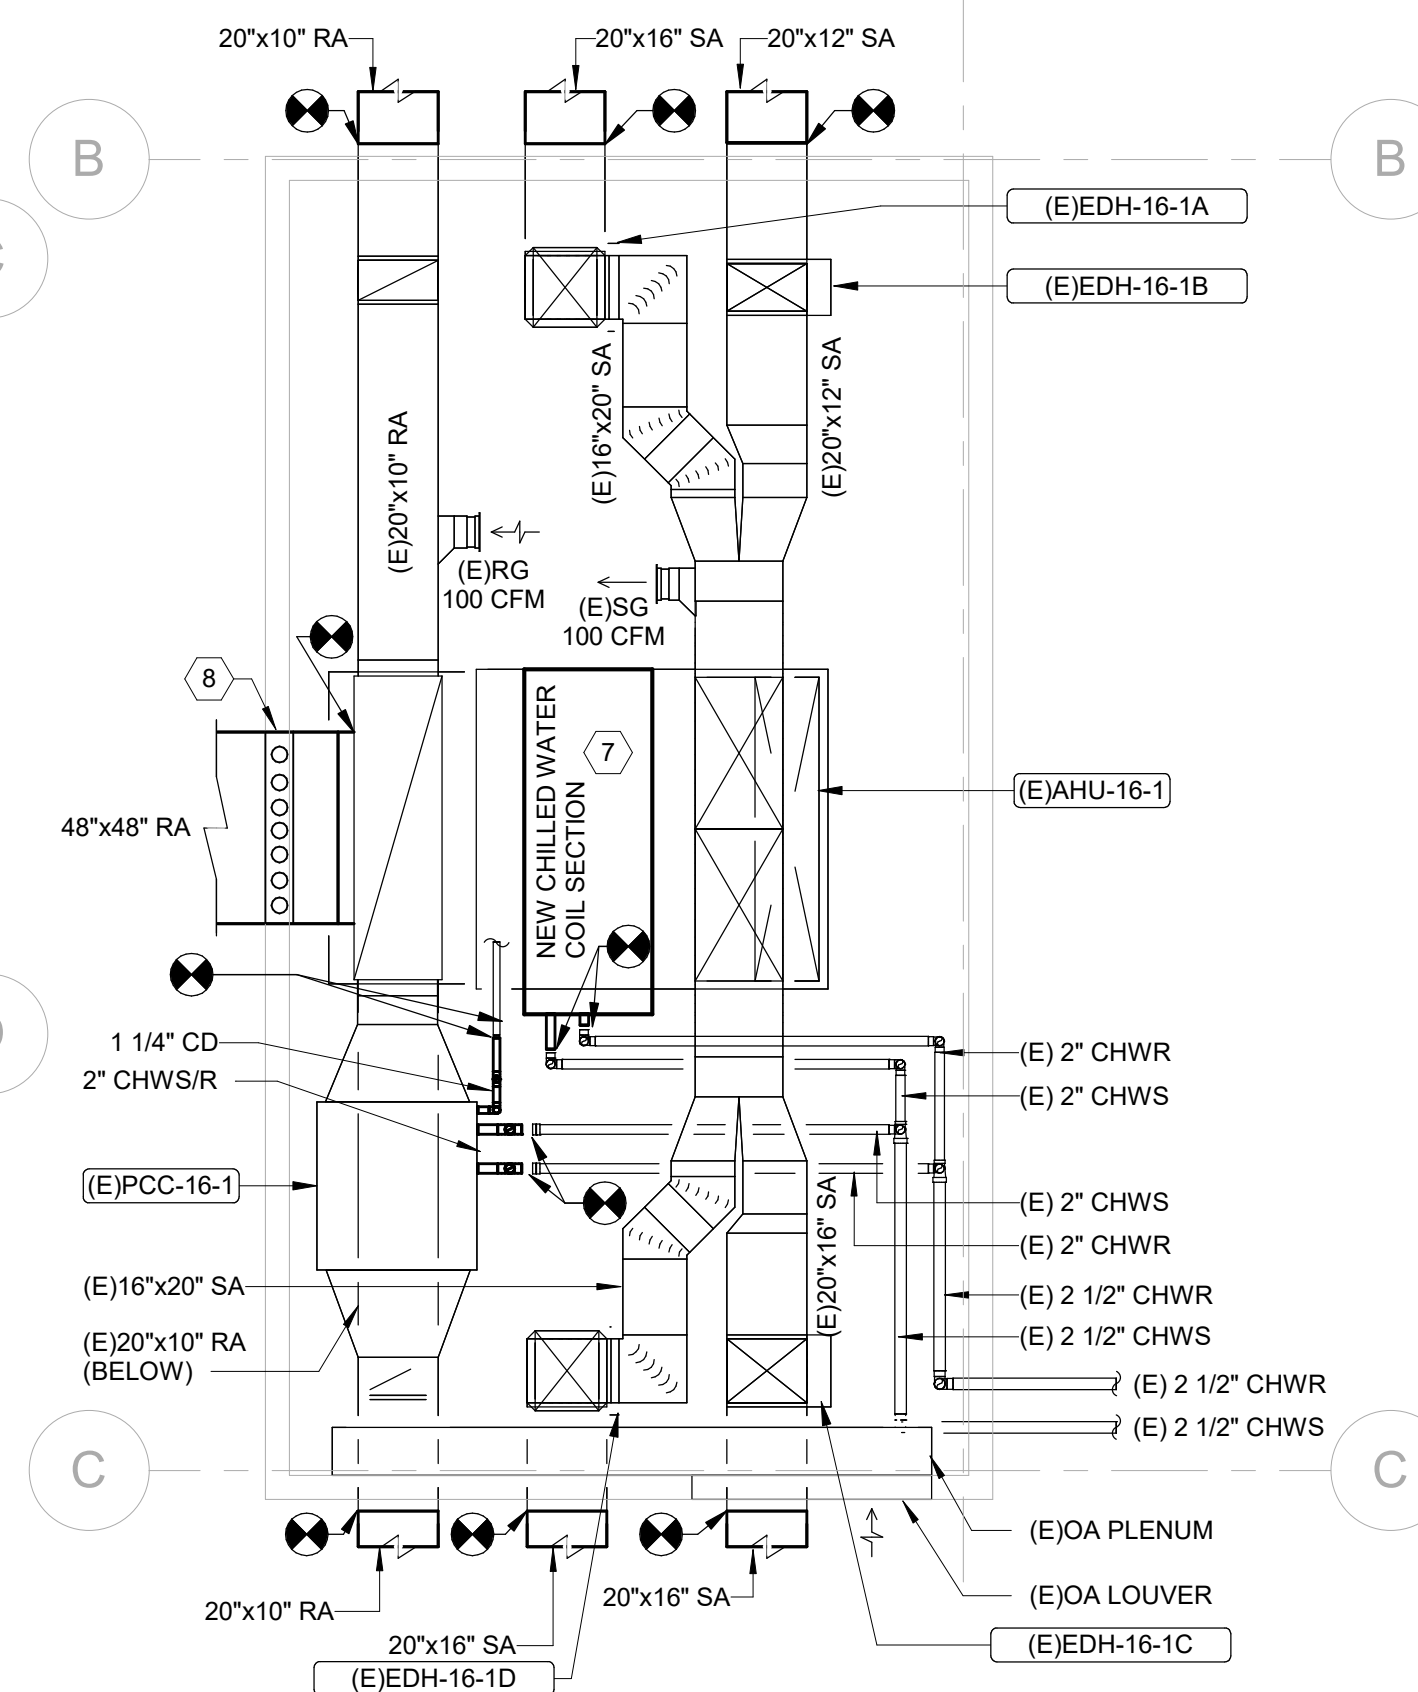

## GENERAL NOTES

- COORDINATE ALL DIFFUSER LOCATIONS WITH ARCHITECTURAL DRAWINGS AS WELL AS ALL OTHER TRADES.
- THESE DRAWINGS ARE DIAGRAMMATIC IN NATURE AND DO NOT NECESSARILY SHOW ALL ELBOWS, OFFSETS, UNIONS, VALVES, AND FITTINGS REQUIRED TO COMPLETE INSTALLATION.
- CONTRACTOR SHALL MAKE DUCT ROUTING ADJUSTMENTS AS NECESSARY TO MEET FIELD CONDITIONS.
- CONTRACTOR SHALL REPLACE FILTERS ON HVAC EQUIPMENT AFTER ALL DUST PRODUCING CONSTRUCTION HAS BEEN COMPLETED AND PRIOR TO FINAL PUNCH.
- ALL ROOF MOUNTED EXHAUST EQUIPMENT (EF-1 & EF-2) SHALL BE LOCATED AT LEAST 10'-0" AWAY FROM ALL OUTSIDE AIR INTAKES.
- ALL EXISTING EQUIPMENT TO BE REUSED SHALL BE PRESSURE TESTED, THOROUGHLY CLEANED, AND SANITIZED TO AVOID POSSIBLE CONTAMINATION.
- THERMOSTATS SHALL NOT BE LOCATED ON WALL IN DIRECT THROW PATH OF SUPPLY CEILING DIFFUSERS.
- CAP AND SEAL EXISTING EXHAUST DUCTWORK THAT WAS DEMOLISHED BACK TO EXISTING ABANDONED ROOF EXHAUST FANS.

## KEYNOTES

- CONNECT TO EXISTING RETURN DUCTWORK AT MECHANICAL ROOM WALL PENETRATION. REFER TO ENLARGED PLAN ON THIS SHEET FOR CONTINUATION.
- CONNECT TO EXISTING SUPPLY DUCTWORK AT MECHANICAL ROOM WALL PENETRATION. REFER TO ENLARGED PLAN ON THIS SHEET FOR CONTINUATION.
- 48" x 48" RETURN DUCTWORK SHALL BE CONNECTED TO EXISTING RETURN PLENUM IN MEZZANINE MECHANICAL ROOM. REFER TO ENLARGED PLAN ON THIS SHEET FOR CONTINUATION.
- 20" x 10" EXHAUST DUCT UP TO EF-1 ON ROOF. TRANSITION TO FULL SIZE OF UNIT OPENING IN VERTICAL.
- 18" x 10" EXHAUST DUCT UP TO EF-2 ON ROOF. TRANSITION TO FULL SIZE OF UNIT OPENING IN VERTICAL.
- INSTALL MANUAL DAMPER IN VERTICAL TO BE ACCESSIBLE FROM CHASE.
- NEW CHILLED WATER COIL SECTION SHALL BE INSTALLED PER MANUFACTURER'S INSTRUCTIONS. GENERAL CONTRACTOR SHALL EXTEND AHU CONCRETE PAD AS REQUIRED TO ACCOMMODATE WIDER COIL SECTION FOOTPRINT. NEW 2" CHILLED WATER SUPPLY AND RETURN, AND 1 1/4" CONDENSATE DRAINAGE SHALL BE INSTALLED AS REQUIRED TO CONNECT EXISTING PIPING SYSTEMS TO NEW CHILLED WATER COIL AND DRAIN PAN.
- PROVIDE SECURITY BARS FOR 48x48 DUCT PENETRATION. COORDINATE SIZE AND SPACING REQUIREMENTS WITH HCSO. MAXIMUM SECURITY BAR GRILLE SHALL BE EQUAL TO PRICE MODEL "MSBG."

KEY PLAN

#	ISSUED FOR	DATE
1	CD - JIA	06.20.24
2	75% - JIA	07.26.24
3	PERMIT/BID	08.20.24
4	ADDENDUM #1	09.04.24

DRAWN BY: PBJ  
REVIEW BY: NPS

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P: 883.682.1082  
F: 883.687.6346  
E: AL004778

lunz.com


24001.01

MH101A




A

B

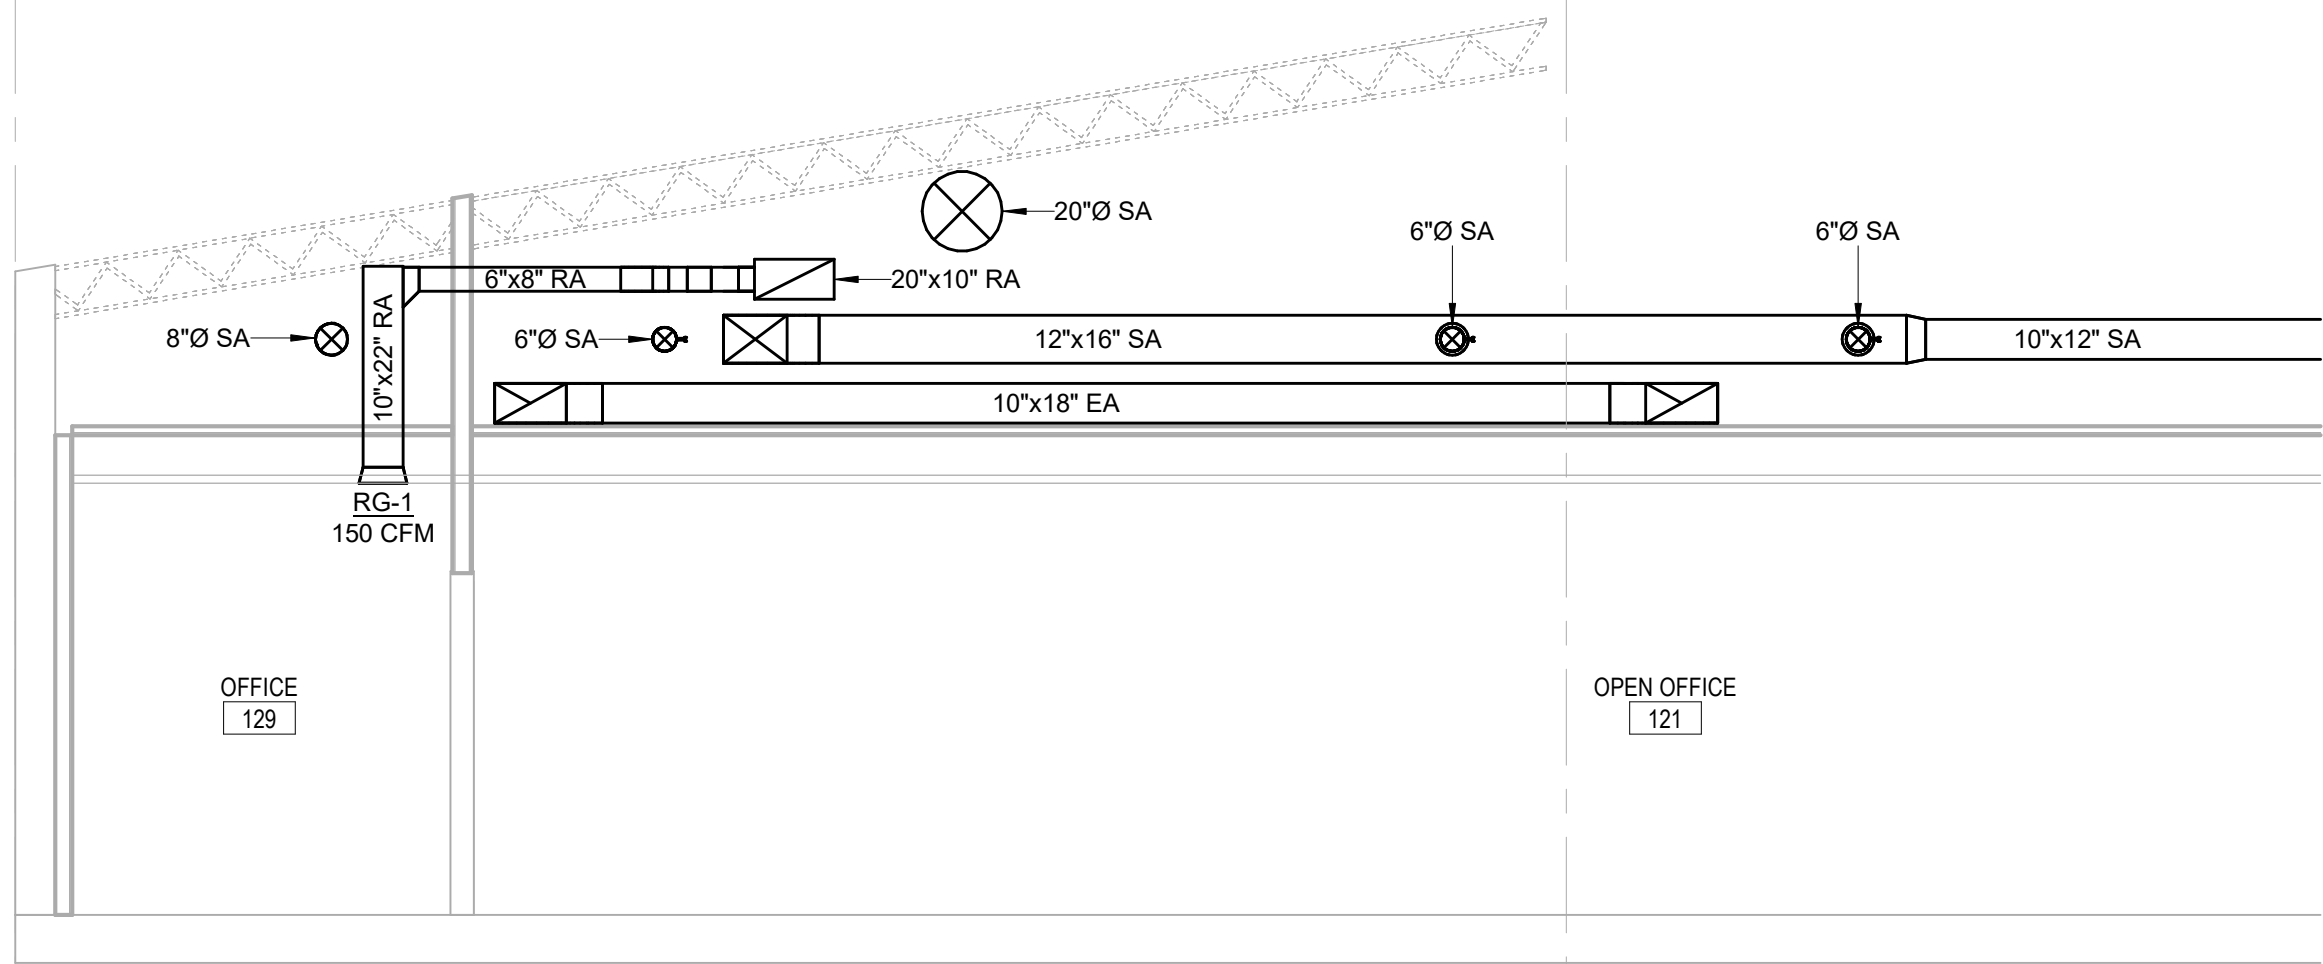

1 SECTION VIEW - OFFICE SPACE CEILING COORDINATION  
1/4" = 1'-0"

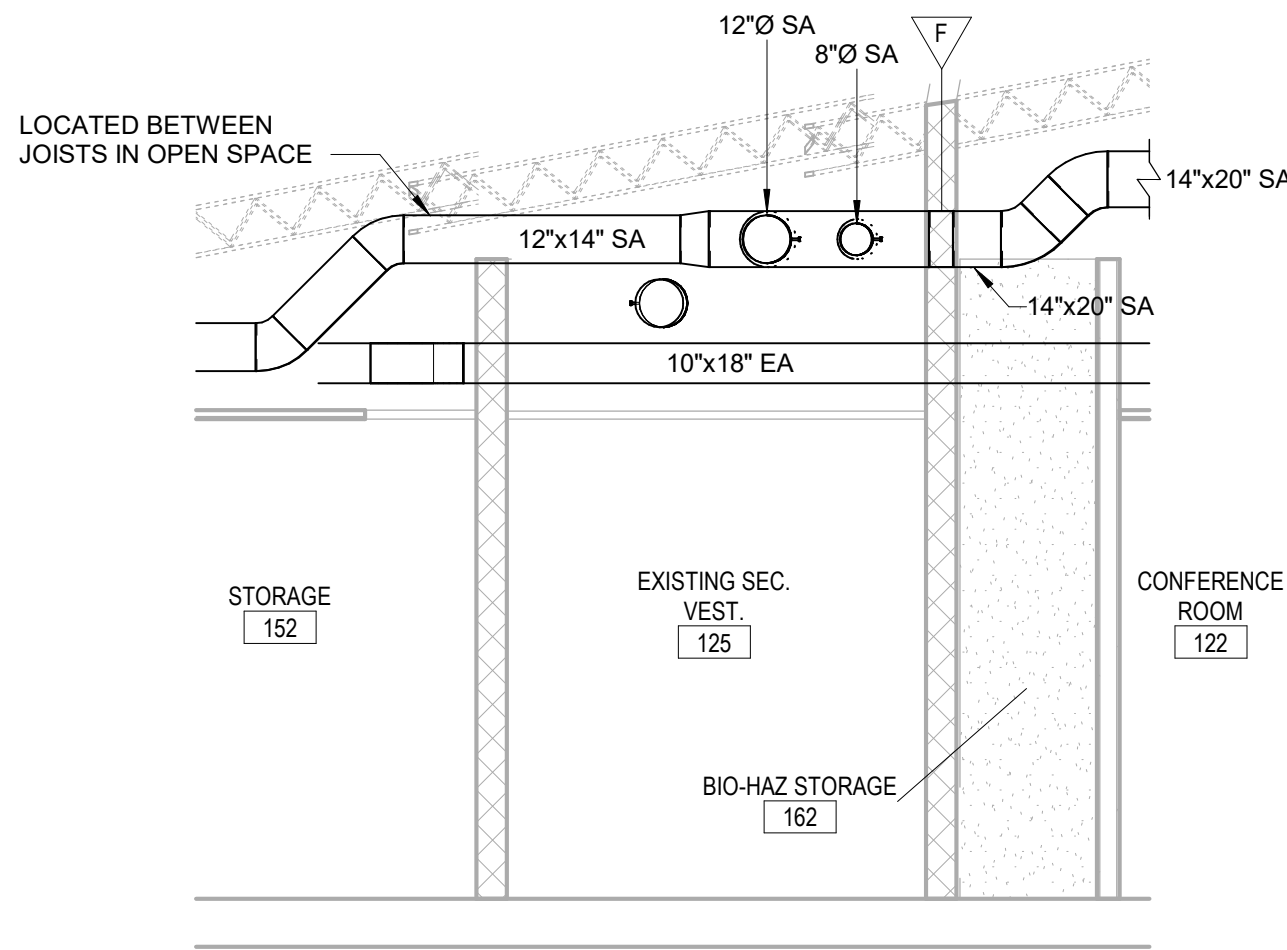

2 SECTION VIEW - SECURED VESTIBULE CEILING COORDINATION  
1/4" = 1'-0"

THE  
**LUNZ**  
GROUP

**MES**  
GROUP

550 North Reo Street  
Suite 203, Tampa, FL  
33609  
813.289.4700  
COA # 8304

HCSO MENTAL HEALTH CLINIC

2310 N. FALKENBURG ROAD  
TAMPA, FLORIDA 33619

MECHANICAL SECTION VIEWS

#	ISSUED FOR	DATE
	DS - JA	06.20.24
	75% - JA	07.26.24
	PERMIT/BID	08.20.24
	ADDENDUM #1	09.05.24

DRAWN BY: PBJ  
REVIEW BY: NPS

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P 883.682.1852  
F 883.687.6346  
or: 804.4778

lunz.com

24001.01

M401A





AIR HANDLING UNIT SCHEDULE																										
MARK	LOCATION	MANUFACTURER	MODEL #	NOMINAL TONNAGE	SUPPLY FAN							CHILLED WATER COIL							FILTERS			DIMENSIONS			NOTES	
					SUPPLY CFM	OA CFM	ESP	# OF FANS	WHEEL DIAMETER (IN.)	HP	VOLTS/Ø/HZ	TOTAL (MBH)	SENSIBLE (MBH)	EAT (DB/WB)	LAT (DB/WB)	AIR ΔP (IN. W.C.)	GPM	EWT/LWT	WATER ΔP (FT H2O)	TYPE	EFFICIENCY	ΔP (IN. W.C.)	LENGTH (IN.)	WIDTH (IN.)		HEIGHT (IN.)
(E)AHU-16-1	MEZZANINE MECH ROOM	DAIKIN	CAH017	13.5	9265	2840	2.00	1	22.25	7.5	460/3/60	162.0	124.3	66.3/59.2	54	0.48	27.00	44 / 56	12.70	PLEATED	MERV 8	0.66	88	80	46	1
(E)PCC-16-1	MEZZANINE MECH ROOM	DAIKIN	CAC007	18.4	-	2840	0.30	-	-	-	-	221.1	115.0	92.0/77.0	55	1.06	42.80	44 / 56	11.50	PLEATED	MERV 8	0.59	42	40	42	2
* DESIGN CONDITIONS: OUTDOOR: SUMMER-92°F/77°F WINTER-40°F INDOOR: 75°F/50% RH																										
NOTES:																										
1. EXISTING AIR HANDLING UNIT TO REMAIN. EXISTING CHILLED WATER COIL SECTION TO BE REMOVED AND REPLACED WITH NEW COIL SECTION. FURNISHED BY MANUFACTURER; INSTALLED BY MECHANICAL CONTRACTOR. CHILLED WATER COIL SECTION REPLACEMENT TO BE INSTALLED PER MANUFACTURER'S INSTRUCTIONS. CONTRACTOR SHALL EXTEND EXISTING CONCRETE PAD AS REQUIRED TO ACCOMMODATE WIDER COIL SECTION.																										
2. EXISTING PRE-COOLING COIL UNIT TO REMAIN. EXISTING CHILLED WATER COIL TO BE REMOVED AND REPLACED WITH NEW COIL. FURNISHED BY MANUFACTURER; INSTALLED BY MECHANICAL CONTRACTOR. CHILLED WATER COIL REPLACEMENT TO BE INSTALLED PER MANUFACTURER'S INSTRUCTIONS.																										

OUTSIDE AIR CALCULATION - SINGLE ZONE (AHU-16-1)											
OUTSIDE AIR CALCULATIONS BASED ON 2023 FLORIDA BUILDING CODE - MECHANICAL TABLE 403.3.1.1 "MINIMUM VENTILATION RATES"											
ROOM	AREA (FT²)	*PEOPLE /1000 FT²	PEOPLE**	CFM / PERSON	PEOPLE CFM	CFM / FT²	AREA CFM	AIR DISTRIBUTION EFFECTIVENESS	REQUIRED CFM	SUPPLIED CFM	CFM DIFFERENCE
121 - OPEN OFFICE	1385	5	11	5	55	0.06	83.1	0.8	173	175	2
122 - CONFERENCE ROOM	170	50	8	5	40	0.06	10.2	0.8	63	65	2
123 - EXISTING SEC. VEST.	155	0	0	0	0	0.06	9.3	0.8	12	15	3
124 - OFFICE	100	5	1	5	5	0.06	6	0.8	14	15	1
125 - OFFICE	96	5	1	5	5	0.06	5.76	0.8	14	15	1
126 - OFFICE	96	5	1	5	5	0.06	5.76	0.8	14	15	1
127 - OFFICE	96	5	1	5	5	0.06	5.76	0.8	14	15	1
128 - OFFICE	96	5	1	5	5	0.06	5.76	0.8	14	15	1
129 - OFFICE	96	5	1	5	5	0.06	5.76	0.8	14	15	1
130 - OFFICE	96	5	1	5	5	0.06	5.76	0.8	14	15	1
131 - OFFICE	135	5	1	5	5	0.06	8.1	0.8	17	20	3
132 - SECURED CORRIDOR	600	0	0	0	0	0.06	36	0.8	45	45	0
134 - ISO. CELL	120	25	1	5	5	0.12	14.4	0.8	25	25	0
135 - ISO. CELL	120	25	1	5	5	0.12	14.4	0.8	25	25	0
136 - ISO. CELL	120	25	1	5	5	0.12	14.4	0.8	25	25	0
137 - ISO. CELL	120	25	1	5	5	0.12	14.4	0.8	25	25	0
138 - ISO. CELL	120	25	1	5	5	0.12	14.4	0.8	25	25	0
139 - ISO. CELL	120	25	1	5	5	0.12	14.4	0.8	25	25	0
140 - ISO. CELL	120	25	1	5	5	0.12	14.4	0.8	25	25	0
141 - OPEN	3580	30	20	5	100	0.06	214.8	0.8	394	395	1
142 - SHERIFF'S STATION	125	5	2	5	10	0.06	7.5	0.8	22	25	3
152 - STORAGE	220	2	0	5	0	0.06	13.2	0.8	17	20	3
154 - ISO. CELL	120	25	1	5	5	0.12	14.4	0.8	25	25	0
155 - ISO. CELL	120	25	1	5	5	0.12	14.4	0.8	25	25	0
156 - ISO. CELL	120	25	1	5	5	0.12	14.4	0.8	25	25	0
157 - ISO. CELL	120	25	1	5	5	0.12	14.4	0.8	25	25	0
158 - ISO. CELL	120	25	1	5	5	0.12	14.4	0.8	25	25	0
159 - ISO. CELL	120	25	1	5	5	0.12	14.4	0.8	25	25	0
160 - NURSE OFFICE	105	25	1	5	5	0.12	12.6	0.8	22	25	3
TOTAL CFM REQ'D									1188	1215	27

BUILDING PRESSURIZATION			
MARK	OA	MARK	EA
(E)AHU-16-1	2,840	EF-1	1,330
		EF-2	1,105
Total	2,840	Total	2,435
OA BEING SUPPLIED		2840 CFM	
AIR BEING EXHAUSTED		-2435 CFM	
		405 CFM BUILDING PRESSURIZATION	

GRILLE, REGISTER, AND DIFFUSER SCHEDULE									
MARK	MANUFACTURER	MODEL #	DESCRIPTION	CFM RANGE	NECK SIZE	INSTALLATION	FINISH	MATERIAL	REMARKS
CD-1	ANEMOSTAT	SSV432	MAXIMUM SECURITY CEILING DIFFUSER W/ SLOPED, BEVELED EDGES	0 - 150	8 x 8	FLANGED	WHITE	STAINLESS STEEL	1 - 6
CD-2	ANEMOSTAT	SSV432	MAXIMUM SECURITY CEILING DIFFUSER W/ SLOPED, BEVELED EDGES	160 - 280	12 x 12	FLANGED	WHITE	STAINLESS STEEL	1 - 6
CD-3	TITUS	TDC	24" x 24" LOUVERED FACE CEILING DIFFUSER W/ ROUND NECK	0 - 110	6"Ø	LAY-IN	WHITE	ALUMINUM	1 - 5
CD-4	TITUS	TDC	24" x 24" LOUVERED FACE CEILING DIFFUSER W/ ROUND NECK	110 - 220	8"Ø	LAY-IN	WHITE	ALUMINUM	1 - 5
SG-1	ANEMOSTAT	ASLG	EXTRA HEAVY DUTY BAR GRILLE W/ FIXED LOUVERS; 11.5" x 11.5" FACE PLATE	130 - 250	8 x 8	SIDEWALL	WHITE	STAINLESS STEEL	1 - 6
SG-2	ANEMOSTAT	ASLG	EXTRA HEAVY DUTY BAR GRILLE W/ FIXED LOUVERS; 15.5" x 15.5" FACE PLATE	300 - 450	12 x 12	DUCT MOUNTED	WHITE	STAINLESS STEEL	1 - 6
SG-3	ANEMOSTAT	ASLG	EXTRA HEAVY DUTY BAR GRILLE W/ FIXED LOUVERS; 17.5" x 17.5" FACE PLATE	450 - 600	14 x 14	SIDEWALL	WHITE	STAINLESS STEEL	1 - 6
EG-1	ANEMOSTAT	SV6	BEVELED EDGE MAXIMUM SECURITY GRILLE 8.4" x 7.4" ROUGH OPENING	0 - 110	6 x 6	SEE PLANS	WHITE	STAINLESS STEEL	1 - 6
EG-2	ANEMOSTAT	SV6	BEVELED EDGE MAXIMUM SECURITY GRILLE 10.4" x 9.4" ROUGH OPENING	120 - 200	8 x 8	SEE PLANS	WHITE	STAINLESS STEEL	1 - 6
EG-3	ANEMOSTAT	SV6	BEVELED EDGE MAXIMUM SECURITY GRILLE 12.4" x 11.4" ROUGH OPENING	200 - 300	10 x 10	SEE PLANS	WHITE	STAINLESS STEEL	1 - 6
RG-1	TITUS	50F	24" x 12" EGGRATE RETURN GRILLE 1/2" x 1/2" x 1/2" GRID	0 - 800	22 x 10	LAY-IN	WHITE	ALUMINUM	1 - 5
RG-2	TITUS	50F	24" x 12" EGGRATE RETURN GRILLE 1/2" x 1/2" x 1/2" GRID	800 - 1750	22 x 22	LAY-IN	WHITE	ALUMINUM	1 - 5
RG-3	ANEMOSTAT	SV6	BEVELED EDGE MAXIMUM SECURITY GRILLE 20.4" x 19.4" ROUGH OPENING	500 - 650	18 x 18	SIDEWALL	WHITE	STAINLESS STEEL	1 - 6
RG-4	ANEMOSTAT	SV6	BEVELED EDGE MAXIMUM SECURITY GRILLE 12.4" x 11.4" ROUGH OPENING	200 - 300	10 x 10	SEE PLANS	WHITE	STAINLESS STEEL	1 - 6
RG-5	ANEMOSTAT	HD35-MS	RETURN GRILLE W/ FIXED LOUVERS 40" DEFLECTION; 49.875" x 49.875" FACE PLATE	3000 - 4500	48 x 48	SIDEWALL	WHITE	STAINLESS STEEL	1 - 6
NOTES: 1. PAINT PER ARCHITECT. 2. NECK SIZE AS LISTED. SEE PLANS FOR DUCT RUNOUT SIZE. 3. DAMPERS SHALL BE INSTALLED IN DUCTWORK FOR ALL DIFFUSERS/GRILLES UNLESS OTHERWISE INDICATED. 4. INSTALL AIR DEVICES PER MANUFACTURER'S INSTRUCTIONS. 5. AIR DEVICES SHALL BE MAXIMUM SECURITY RATED AND LIGATURE RESISTANT.									

EXHAUST FAN SCHEDULE											
MARK	MANUFACTURER	MODEL #	TYPE	CFM	ESP	HP	VOLTS/Ø	BDD	DRIVE	WEIGHT (LBS)	REMARKS
EF-1	GREENHECK	G-120-VG	ROOF	1,330	0.5	1/2	115/1	YES	DIRECT	100	1 - 5
EF-2	GREENHECK	G-120-VG	ROOF	1,105	0.5	1/2	115/1	YES	DIRECT	100	1 - 5
NOTES: 1. PROVIDE WITH GRAVITY BACKDRAFT DAMPER, BIRDSCREEN, ECM MOTOR, AND SPEED CONTROLLER. 2. PROVIDE FACTORY DISCONNECT SWITCH. 3. ROOF CURB TO BE FURNISHED BY MANUFACTURER; INSTALLED BY MECHANICAL CONTRACTOR. 4. ROOF CURB SHALL HAVE HIGH WIND RATING OF NO LESS THAN 160 MPH PER FBC 2023. 5. FAN SHALL BE INTERLOCKED WITH (E) AHU-16-1.											

ELECTRIC DUCT HEATER SCHEDULE								
MARK	MANUFACTURER	MODEL #	TYPE	LENGTH	DEPTH	HEIGHT	VOLTS/Ø	NOTES
(E) EDH-16-1A	TUTCO	MR SERIES	SLIP-IN	-	-	-	480/3	1
(E) EDH-16-1B	TUTCO	MR SERIES	SLIP-IN	-	-	-	480/3	1
(E) EDH-16-1C	TUTCO	MR SERIES	SLIP-IN	-	-	-	480/3	1
(E) EDH-16-1D	TUTCO	MR SERIES	SLIP-IN	-	-	-	480/3	1
NOTES: 1. EXISTING ELECTRIC DUCT HEATER SHALL REMAIN.								

THE LUNZ GROUP

MES GROUP

550 North Reo Street  
Suite 203, Tampa, FL 33609  
813.289.4700  
COA # 8304

HCSO MENTAL HEALTH CLINIC

2310 N. FALKENBURG ROAD  
TAMPA, FLORIDA 33619

MECHANICAL SCHEDULES - JIA

#	ISSUED FOR	DATE
	05 - JIA	06.20.24
	75% - JIA	07.26.24
	PERMIT/BID	08.20.24
	ADDENDUM #1	09.05.24

DRAWN BY: PBJ  
REVIEW BY: NPS

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P 883.682.1082  
F 883.687.6346  
E: AL004776

lunz.com

ELECTRICAL ABBREVIATIONS LIST			
1P	1 POLE (2P, 3P, 4P, ETC.)	MCB	MAIN CIRCUIT BREAKER
A	AMPERE	MCC	MOTOR CONTROL CENTER
AC	ABOVE COUNTER	MDC	MAIN DISTRIBUTION CENTER
ACLG	ABOVE CEILING	MDP	MAIN DISTRIBUTION PANEL
ADO	AUTOMATIC DOOR OPENER	MFR	MANUFACTURER
AF	AMP FRAME	MFS	MAIN FUSED DISCONNECT SW
AFF	ABOVE FINISHED FLOOR	MH	MANHOLE
AFG	ABOVE FINISHED GRADE	MI	MICROPHONE
AFI	ARC FAULT CIRCUIT INTERRUPTER	MIN	MINIMUM
AHU	AIR HANDLING UNIT	MISC	MISCELLANEOUS
AL	ALUMINUM	MLO	MAIN LUGS ONLY
ALT	ALTERNATE	MMS	MANUAL MOTOR STARTER
AMP	AMPERE	MOA	MULTIOUTLET ASSEMBLY
AMPL	AMPLIFIER	MSP	MOTOR STARTER PANELBOARD
ANNUN	ANNUNCIATOR	MSBD	MAIN SWITCHBOARD
APPROX	APPROXIMATELY	MT	MOUNT
AQ-STAT	AQUASTAT	MT.C	EMPTY CONDUIT
ARCH	ARCHITECT, ARCHITECTURAL	MTS	MANUAL TRANSFER SWITCH
AS	AMP SWITCH	MTR	MOTOR, MOTORIZED NORMALLY CLOSED
AT	AMP TRIP	N.C.	NATIONAL ELECTRICAL CODE
ATS	AUTOMATIC TRANSFER SWITCH	NEC	NATIONAL ELECTRICAL CODE
AUTO	AUTOMATIC	NEMA	NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION
AUX	AUXILIARY	NFDS	NON-FUSED SAFETY DISCONNECT SWITCH
AV	AUDIO VISUAL	NIC	NOT IN CONTRACT
AWG	AMERICAN WIRE GAUGE	NL	NIGHT LIGHT
BATT	BATTERY	N.O.	NORMALLY OPEN
BD	BOARD	NPF	NORMAL POWER FACTOR
BLDG	BUILDING	NOT TO SCALE	
BMS	BUILDING MANAGEMENT SYSTEM	OH	OVERHEAD
C	CONDUIT	OL	OVERLOADS
CAB	CABINET	PA	PUBLIC ADDRESS
CAT	CATALOG	PB	PULL BOX OR PUSHBUTTON
CATV	CABLE TELEVISION	PE	PNEUMATIC ELECTRIC
CB	CIRCUIT BREAKER	PEDESTAL	
CCTV	CLOSED CIRCUIT TELEVISION	PF	POWER FACTOR
CKT	CIRCUIT	PH	PHASE
CLG	CEILING	PIV	POST INDICATING VALVE
COMB	COMBINATION	PINL	PANEL
OMPR	COMPRESSOR	PP	POWER POLE
CONN	CONNECTION	PR	PAIR
CONST	CONSTRUCTION	PRI	PRIMARY
CONT	CONTINUATION OR CONTINUOUS	PROJ	PROJECTION
CONTR	CONTRACTOR	PRV	POWER ROOF VENTILATOR
CONV	CONVECTOR	PT	POTENTIAL TRANSFORMER
CP	CIRCULATING PUMP	PVC	POLYVINYL CHLORIDE (CONDUIT)
CRT	CATHODE RAY TUBE	PWR	POWER
CT	CURRENT TRANSFORMER	QUAN	QUANTITY
CTR	CENTER	RCPT	RECEPTACLE
CU	COPPER	REQD	REQUIRED
(D)	DEMOLITION	RM	ROOM
DCP	DOMESTIC WATER CIRCULATING PUMP	RSC	RIGID STEEL CONDUIT
DEPT	DEPARTMENT	RTU	ROOF TOP UNIT
DET	DETAIL	SC	SURFACE CONDUIT
DIA	DIAMETER	SEC	SECONDARY
DISC	DISCONNECT	SHT	SHEET
DIST	DISTRIBUTION	SH	SHOWER
DN	DOWN	SH	SIMILAR
DPR	DAMPER	SN	SOLID NEUTRAL
DS	SAFETY DISCONNECT SWITCH	SPEC	SPECIFICATION
DT	DOUBLE THROW	SPKR	SPEAKER
DWG	DRAWING	SP	SPARE
(E)	EXISTING ITEMS	SR	SURFACE RACEWAY
EC	ELECTRICAL CONTRACTOR	SS	STAINLESS STEEL
ELEC	ELECTRIC, ELECTRICAL	SSW	SELECTOR SWITCH
ELEV	ELEVATOR	S/S	STOP/START PUSHBUTTONS
ELU	EMERGENCY LIGHTING UNIT	STA	STATION
EM	EMERGENCY	STD	STANDARD
EMS	ENERGY MANAGEMENT SYSTEM	SURF	SURFACE MOUNTED
EMT	ELECTRICAL METALLIC TUBING	SW	SWITCH
EP	ELECTRIC PNEUMATIC	SWBD	SWITCHBOARD
EQUIP	EQUIPMENT	SYM	SYMMETRICAL
EWIC	ELECTRIC WATER COOLER	SYS	SYSTEM
EXIST	EXISTING	TEL	TELEPHONE
EXH	EXHAUST	TEL DATA	TELEPHONE/DATA
EXP	EXPLOSION PROOF	TERM	TERMINAL
FA	FIRE ALARM	TL	TWIST LOCK
FABP	FIRE ALARM BOOSTER POWER	TR	TAMPER RESISTANT
FACP	FIRE ALARM CONTROL PANEL	T-STAT	THERMOSTAT
FCU	FAN COIL UNIT	TTC	TELEPHONE TERMINAL CABINET
FIXT	FIXTURE	TV	TELEVISION
FLR	FLOOR	TVTC	TELEVISION TERMINAL CABINET
FLUOR	FLUORESCENT	TYC	TYPICAL
FU	FUSE	UP	UNDER COUNTER
FUS	FUSED SAFETY DISCONNECT SWITCH	UE	UNDERGROUND ELECTRICAL
GA	GAUGE	UG	UNDERGROUND
GAL	GALLON	UH	UNIT HEATER
GALV	GALVANIZED	UT	UNDERGROUND TELEPHONE
GC	GENERAL CONTRACTOR	UTIL	UTILITY
GEN	GENERATOR	UV	ULTRAVIOLET
GFI	GROUND FAULT CIRCUIT INTERRUPTER	V	VOLT
GFP	GROUND FAULT PROTECTOR	VA	VOLT-AMPERES
GND	GROUND	VDT	VIDEO DISPLAY TERMINAL
GRS	GALVANIZED RIGID STEEL (CONDUIT)	VERT	VERTICAL
GYP BD	GYP SUM BOARD	VFD	VARIABLE FREQUENCY DRIVE
HCA	HANDS-OFF AUTOMATIC SWITCH	VOL	VOLUME
HORIZ	HORIZONTAL	W	WATT
HP	HORSEPOWER	W	WITH
HPF	HIGH POWER FACTOR	WG	WIRE GUARD
HT	HEIGHT	WH	WATER HEATER
HTG	HEATING	W/O	WITHOUT
HTR	HEATER	WP	WEATHERPROOF
HV	HIGH VOLTAGE	XFMR	TRANSFORMER
HVAC	HEATING, VENTILATING AND AIR CONDITIONING	XFR	TRANSFER
IC	INTERRUPTING CAPACITY		
IG	ISOLATED GROUND	∠	ANGLE
IMC	INTERMEDIATE METAL CONDUIT	@	AT
INCAND	INCANDESCENT	▲	DELTA
IR	INFRARED	▲	FEET
I/W	INTERLOCK WITH	*	INCHES
J-BOX	JUNCTION BOX	#	NUMBER
KV	KILOVOLT	Ø	PHASE
KVA	KILOVOLT-AMPERE	C	CENTER LINE
KVAR	KILOVOLT-AMPERE REACTIVE	P	PLATE
KW	KILOWATT		
KWH	KILOWATT HOUR		
LOC	LOCATE OR LOCATION		
LT	LIGHT		
LTG	LIGHTING		
LTNG	LIGHTNING		
LV	LOW VOLTAGE		
MAX	MAXIMUM		
MAG S	MAGNETIC STARTER		
MC	MOMENTARY CONTACT		
MC	MECHANICAL CONTRACTOR		

ELECTRICAL SYMBOL LEGEND			
(MOUNTING HEIGH TO CENTER LINE OF BOX, UNLESS NOTED OTHERWISE)			
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	2X4 FIXTURE - RECESSED, SURFACE, OR PENDANT MOUNTED - TYPE AS SPECIFIED		SIMPLEX RECEPTACLE (18" AFF, UON)
	2X4 CRITICAL BRANCH FIXTURE - RECESSED, SURFACE, OR PENDANT MOUNTED - TYPE AS SPECIFIED		DUPLEX RECEPTACLE (18" AFF, UON)
	2X4 LIFE SAFETY BRANCH FIXTURE - RECESSED, SURFACE, OR PENDANT MOUNTED - TYPE AS SPECIFIED		DUPLEX RECEPTACE 6" ABOVE COUNTER BACKSPASH OR 48" AFF
	2X2 FIXTURE - RECESSED, SURFACE, OR PENDANT MOUNTED - TYPE AS SPECIFIED		DOUBLE DUPLEX RECEPTACLE (18" AFF, UON)
	2X2 CRITICAL BRANCH FIXTURE - RECESSED, SURFACE, OR PENDANT MOUNTED - TYPE AS SPECIFIED		DOUBLE DUPLEX RECEPTACE 6" ABOVE COUNTER BACKSPASH OR 48" AFF
	2X2 LIFE SAFETY BRANCH FIXTURE - RECESSED, SURFACE, OR PENDANT MOUNTED - TYPE AS SPECIFIED		TOP SWITCHED OUTLET, AS NOTED ON PLANS
	1X4 FIXTURE - RECESSED, SURFACE, OR PENDANT MOUNTED - TYPE AS SPECIFIED		TOP AND BOTTOM SWITCHED OUTLET, AS NOTED ON PLANS
	1X4 CRITICAL BRANCH FIXTURE - RECESSED, SURFACE, OR PENDANT MOUNTED - TYPE AS SPECIFIED		USB RECEPTACLE COMBINATION
	1X4 LIFE SAFETY BRANCH FIXTURE - RECESSED, SURFACE, OR PENDANT MOUNTED - TYPE AS SPECIFIED		DUPLEX RECEPTACLE - FLOOR MOUNTED
	4" LINEAR INDUSTRIAL STRIP FIXTURE - TYPE AS SPECIFIED		DOUBLE DUPLEX RECEPTACLE - FLOOR MOUNTED
	4" CRITICAL BRANCH LINEAR INDUSTRIAL STRIP FIXTURE - TYPE AS SPECIFIED		DUPLEX RECEPTACLE - CEILING MOUNTED
	4" LIFE SAFETY BRANCH LINEAR INDUSTRIAL STRIP FIXTURE - TYPE AS SPECIFIED		DOUBLE DUPLEX RECEPTACLE - CEILING MOUNTED
	RECESSED CAN LIGHT - TYPE AS SPECIFIED		RANGE RECEPTACLE, 4" AFF TO CENTER, 120/240V, 1 PHASE, 3 WIRE PLUS GROUND, 50 AMPS NEMA 14-50.
	RECESSED CAN LIGHT - TYPE AS SPECIFIED		DRYER RECEPTACLE, 48" AFF TO CENTER, 120/240V, 1 PHASE, 3 WIRE PLUS GROUND, 30 AMPS NEMA 14-30.
	LIGHTING FIXTURE - PENDANT MOUNTED - TYPE AS SPECIFIED		RETRACTABLE CORD REEL WITH DUPLEX NEMA 5-20 RECEPTACLE, PROVIDE WITH 30' OF RETRACTABLE S.O. CORD.
	CRITICAL BRANCH LIGHTING FIXTURE - PENDANT MOUNTED - TYPE AS SPECIFIED		RETRACTABLE CORD REEL WITH DOUBLE DUPLEX NEMA 5-20 RECEPTABLES, PROVIDE WITH 30' OF RETRACTABLE S.O. CORD.
	WALL SCONCE LIGHTING FIXTURE - SURFACE MOUNTED - TYPE AS SPECIFIED		SPECIAL PURPOSE RECEPTACLE, NEMA TYPE AS NOTED ON PLANS (18" AFF, UON)
	CRITICAL BRANCH WALL SCONCE LIGHTING FIXTURE - SURFACE MOUNTED - TYPE AS SPECIFIED		DISCONNECT SWITCH - NON-FUSED - FRAME/FUSE/POLES/NEMA AS NOTED ON PLANS, ALL DISCONNECTS SHALL BE HEAVY DUTY AND NEMA TYPE 1 U.O.N.
	EXTERIOR POLE MOUNTED FIXTURE - TYPE AS SPECIFIED		DISCONNECT SWITCH - FUSED - FRAME/FUSE/POLES/NEMA AS NOTED ON PLANS, ALL DISCONNECTS SHALL BE HEAVY DUTY AND NEMA TYPE 1 U.O.N.
	EXTERIOR POST TOP MOUNTED FIXTURE - TYPE AS SPECIFIED		RELAY
	SELF CONTAINED EMERGENCY LIGHTING UNIT - TYPE AS SPECIFIED		PUSH BUTTON
	COMBINATION EXIT SIGN & SELF CONTAINED EMERGENCY LIGHTING UNIT - TYPE AS SPECIFIED		JUNCTION BOX
	EXIT LIGHT, CEILING-MOUNTED, SHADING AND ARROWS INDICATE FACES AND DIRECTION		MOTOR RATED SWITCH WITH THERMAL OVERLOADS FOR FRACTIONAL HORSEPOWER MOTORS
	EXIT LIGHT, WALL-MOUNTED, SHADING AND ARROWS INDICATE FACES AND DIRECTION		POWER POLE (OPEN OFFICE STYLE)
	EXIT LIGHT, WALL-MOUNTED, SHADING AND ARROWS INDICATE FACES AND DIRECTION		MOTOR CONNECTION - HORSE POWER AS NOTED
	TRANSFORMER		TRANSFORMER
	SINGLE-POLE, LOW VOLTAGE, 3-WAY AND 4-WAY SWITCHES (48" AFF)		
	LOCAL WALL DIMMER SWITCH (48" AFF)		
	FAN SWITCH (48" AFF)		
	WALL MOUNTED OCCUPANCY SENSOR SWITCH: DUAL TECHNOLOGY (PASSIVE INFRARED/ULTRASONIC)		
	CEILING MOUNTED OCCUPANCY/VACANCY SENSOR, DUAL TECHNOLOGY (PASSIVE INFRARED/ULTRASONIC)		
	DAYLIGHT SENSOR		
	ROOM CONTROLLER (REFER TO PLANS)		
	LIGHTING RELAY (UL924 GENERATOR TRANSFER DEVICE)		
	TIME CLOCK (REFER TO PLANS)		

CONDUIT AND WIRING	
	BRANCH CIRCUIT RUN CONCEALED
	BRANCH CIRCUIT RUN UNDER FLOOR
	HOME RUN TO PANEL 2A SPACES 1, 3, & 5, REFER TO PANEL SCHEDULES

FIRE ALARM SYMBOLS	
	MANUAL PULL STATION (48" AFF)
	BELL/STROBE LIGHT COMBINATION (80" AFF)
	STROBE LIGHT (80" AFF)
	HORN (80" AFF)
	HORN/STROBE LIGHT COMBINATION (80" AFF)
	MINI HORN (80" AFF)
	PROGRAM BELL (80 AFF)
	CHIME/FLASH COMBINATION (80" AFF)
	SPEAKER (80" AFF)
	SPEAKER/STROBE COMBINATION (80" AFF)
	STANDALONE SMOKE ALARM - WALL MOUNTED; CEILING MOUNTED
	STANDALONE COMBO SMOKE/CARBON MONOXIDE ALARM - WALL MOUNTED; CEILING MOUNTED
	SMOKE DETECTOR TIED TO FACP - WALL MOUNTED; CEILING MOUNTED
	HEAT DETECTOR TIED TO FACP - WALL MOUNTED; CEILING MOUNTED
	COMBINATION SMOKE/HEAT DETECTOR TIED TO FACP - WALL MOUNTED; CEILING MOUNTED
	COMBO SMOKE/CARBON MONOXIDE DETECTOR TIED TO FACP - WALL MOUNTED; CEILING MOUNTED
	DUCT DETECTOR
	TAMPER SWITCH
	FLOW SWITCH
	MAGNETIC DOOR HOLDER (72" AFF)
	FIRE ALARM CONTROL PANEL SURFACE OR RECESSED

COORDINATION NOTES	
A.	FIRE ALARM DEVICES ARE SHOWN FOR REFERENCE ONLY. FULLY FUNCTIONAL FIRE ALARM SYSTEM TO INCLUDE FIRE CONTROL PANELS, DIALERS, EXPANDER MODULES, ANNUNCIATION AND NOTIFICATION DEVICES, WIRING, PROGRAMMING, TESTING, WARRANTY AND COMMISSIONING SHALL BE INCLUDED IN THIS PROJECT BID. THE GENERAL CONTRACTOR SHALL PROVIDE SIGNED AND SEALED SHOP DRAWINGS SHOWING ALL DEVICES, EQUIPMENT, CIRCUITS AND CALCULATIONS REQUIRED FOR PERMITTING. COORDINATE WITH AHJ IF SEPARATE PERMIT IS REQUIRED OR SUBMIT UNDER THIS POINT.

GENERAL PROJECT NOTES	
1.	THIS IS A COMPLETE LIST OF ELECTRICAL SYMBOLS AND ABBREVIATIONS FOR REFERENCE ONLY. SYMBOLS SHOWN ON THIS DRAWING MAY NOT APPEAR ON THE FOLLOWING DRAWINGS.
2.	THE CONTRACTOR SHALL COORDINATE ALL REQUIRED SHUTDOWNS ON EXISTING UTILITIES WITH OWNER REPRESENTATIVES IN ORDER TO MINIMIZE IMPACT TO OTHER AREAS.
3.	PERFORM ALL WORK IN COMPLIANCE WITH ALL APPLICABLE FEDERAL, STATE, AND LOCAL CODES, REGULATIONS, AND STANDARDS ADOPTED BY THE AUTHORITY HAVING JURISDICTION. IF CONFLICTS EXIST BETWEEN THESE ENGINEERING DOCUMENTS AND CODES, THE MOST STRINGENT REQUIREMENTS SHALL GOVERN.
4.	ALL CONSTRUCTION WORK SHALL ALSO MEET THE FOLLOWING CODE REQUIREMENTS: A. FLORIDA BUILDING CODE, BUILDING, 8TH EDITION (2023) B. FLORIDA BUILDING CODE, ENERGY CONSERVATION, 8TH EDITION (2023) C. FLORIDA FIRE PREVENTION CODE, 8TH EDITION (2023) D. NFPA 101-2021, THE LIFE SAFETY CODE E. NFPA 70-2020, NATIONAL ELECTRICAL CODE F. NFPA 72-2019, NATIONAL FIRE ALARM CODE
5.	THE ELECTRICAL DRAWINGS ARE SCHEMATIC IN NATURE. BEFORE STARTING THE WORK THE CONTRACTOR SHALL REVIEW ALL OTHER DISCIPLINE DRAWINGS AND VERIFY FIELD CONDITIONS AND SHALL MAKE ANY REQUIRED MINOR ADJUSTMENTS WITHOUT EXTRA COST TO THE OWNER. ANY MAJOR DISCREPANCIES FOUND SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT/ENGINEER.
6.	ALL WIRING SHALL BE IN CONDUIT. MINIMUM CONDUIT SIZE SHALL BE 3/4". MINIMUM CONDUCTOR SIZE SHALL BE #12 AWG. ALL NEW CIRCUITS SHALL BE PROVIDED WITH AN INDIVIDUAL NEUTRAL AND INSULATED CONDUCTOR WITH THE PHASE CONDUCTOR.
7.	ALL CONDUITS INSTALLED INTERIOR SHALL BE EMT. ALL CONDUITS INSTALLED EXTERIOR UNDERGROUND SHALL BE PVC SCHEDULED 40. ALL CONDUITS INSTALLED EXTERIOR AND EXPOSED SHALL BE RGS.
8.	CONDUCTORS #10 AND SMALLER SHALL BE SOLID COPPER. CONDUCTORS #8 AND LARGER SHALL BE STRANDED COPPER. UNLESS NOTED OTHERWISE, CONDUCTORS INSULATION SHALL BE DUAL RATED AT THHN/THWN.
9.	ALL DEVICES, EQUIPMENT MATERIAL AND LABOR SHALL BE PROVIDED BY THE CONTRACTOR UNLESS NOTED OTHERWISE.
10.	ALL ELECTRICAL EQUIPMENT AND DEVICES SHALL BE MOUNTED AS PER EQUIPMENT AND DEVICE MANUFACTURER RECOMMENDATIONS.
11.	CONTRACTOR SHALL PROVIDE SUBMITTALS TO ARCHITECT/ENGINEER FOR REVIEW AND APPROVAL OF ALL ELECTRICAL EQUIPMENT AND DEVICES DESCRIBED IN THE SUBMITTAL REGISTER. SUBMITTALS SHALL INCLUDE CUT SHEETS, DIMENSIONS, WIRING DIAGRAMS, ACCESSORIES, OPERATION MANUALS, AND ALL NECESSARY INFORMATION FOR REVIEWER TO MAKE A SOUND EVALUATION.
12.	PROVIDE STARTUP OF ALL ELECTRICAL SYSTEMS AND COORDINATE WITH ARCHITECT/ENGINEER FOR OWNER STARTUP WITNESSING.
13.	PROVIDED LAMINATED PLASTIC NAMEPLATES FOR EACH EQUIPMENT ENCLOSURE. EACH NAMEPLATE IDENTIFY EQUIPMENT FUNCTION, PANELBOARD CONNECTED AND CIRCUIT NUMBER. NAMEPLATE SHALL BE MELAMINE PLASTIC (0.125 INCHES THICK), WHITE LETTERS ON BLACK BACKGROUND. MINIMUM SIZE OF LETTERS SHALL BE 2.5 INCHES. IN ADDITION TO EQUIPMENT TAGGING, CONTRACTOR SHALL PROVIDE ARC-FLASH WARNING AND AVAILABLE FAULT CURRENT AT THE TIME OF INSTALLATION AND CALCULATION LABELS FOR PANELBOARDS, OTHER THAN DWELLING UNIT LOAD CENTERS, IN ACCORDANCE WITH NEC 110.
14.	PROVIDE COMPUTER PRINTED ON WHITE WRAPAROUND PAPER WITH CLEAR PLASTIC PROTECTION TAIL FOR ALL WIRE MARKERS. MARKER SHALL STATE PANELBOARD NAME AND CIRCUIT NUMBER ON ALL WIRES IN JUNCTION/PULL BOXES AND IN EQUIPMENT TERMINAL BOXES.
15.	PROVIDE PUNCHED TAPE LABELS ON ALL WIRING DEVICES FOR IDENTIFICATION. SHALL BE 1/2" BLACK TAPE WITH WHITE RAISED LETTERS. TAPE LABELS SHALL STATE PANELBOARD NAME AND CIRCUIT NUMBER.
16.	PROVIDE DIRECTORIES ON ALL PANELBOARDS. ALL LOADS SHALL BE BALANCED TO WITHIN 10%.
17.	CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING A COMPLETE SET OF RECORD DRAWINGS TO THE OWNER AT THE END OF THE CONSTRUCTION.
18.	ALL MATERIALS AND EQUIPMENT TO BE INSTALLED SHALL BE NEW AND FREE OF DEFECTS. ALL ELECTRICAL EQUIPMENT SHALL COMPLY WITH NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA) STANDARDS AND SHALL BE UL LABELED. ALL ELECTRICAL EQUIPMENT AND MATERIALS SHALL BE INSTALLED IN A WORKMANLIKE MANNER.
19.	ALL CONNECTORS AND SPLICES FOR CABLE SIZE #10 AWG AND SMALLER SHALL BE INSULATED. PRESSURE-TYPE. FOR LARGER SIZE CONDUCTORS USE BOLTED CLAMPS WITH INSULATING TAPE.
20.	PROVIDE INSULATION AND CONTINUITY TEST OF ALL 1000V AND LESS WIRES AND CABLES. USE TESTING PROCEDURES DESCRIBED IN INTERNATIONAL ELECTRICAL TESTING AGENCY (NETA) STANDARDS. REPLACE ANY CABLES WITH INSULATION RESISTANCE LESS THAN 100 MEGA OHMS (MOHMS). TEST ALL GROUND FAULT CIRCUIT INTERRUPTING (GFCI) RECEPTACLES. TEST ALL GROUNDING ELECTRODE SYSTEMS WITH FALL OF POTENTIAL METHOD. MAKE RESISTANCE MEASUREMENTS 48 HOURS AFTER LAST RAIN FALL. MAXIMUM RESISTANCE TO GROUND SHALL BE 5 OHMS.
21.	PRIOR TO PASSING FINAL INSPECTION, A THIRD PARTY CONTRACTOR SHALL PROVIDE EVIDENCE THAT THE LIGHTING CONTROL SYSTEMS HAVE BEEN TESTED TO ENSURE THAT CONTROL HARDWARE AND SOFTWARE ARE CALIBRATED, ADJUSTED, PROGRAMMED AND IN PROPER WORKING CONDITION IN ACCORDANCE WITH THE CONSTRUCTION DOCUMENTS AND MANUFACTURER'S INSTRUCTIONS. FUNCTIONAL TESTING SHALL BE IN ACCORDANCE WITH FLORIDA BUILDING CODE - ENERGY CONSERVATION 8TH EDITION (2023) - SECTIONS C408.3.1.1 AND C408.3.1.2 FOR THE APPLICABLE CONTROL TYPE.
22.	CONTRACTOR SHALL PROVIDE RECORD DOCUMENTS, DRAWINGS AND MANUALS TO OWNER WITHIN 60 DAYS AFTER SYSTEM ACCEPTANCE PER FLORIDA BUILDING CODE - ENERGY CONSERVATION 8TH EDITION (2023) - SECTIONS C405.5.4.
23.	PANELBOARDS SHALL BE SUPPLIED WITH BOLT-ON CIRCUIT BREAKERS. ALL BUSBARS, PHASE, NEUTRAL, GROUND IN PANELBOARDS SHALL BE TIN-PLATED ALUMINUM.

ELECTRICAL SHEET LIST	
Sheet Number	Sheet Name
E-001	ELECTRICAL LEGENDS & ABBREVIATIONS
ED-101	PARTIAL FLOOR PLAN - LIGHTING DEMOLITION - PHASE 1
ED-102	PARTIAL FLOOR PLAN - ELECTRICAL DEMOLITION - PHASE 1
E-101	PARTIAL FLOOR PLAN - LIGHTING - PHASE 1
E-102	PARTIAL FLOOR PLAN - POWER - PHASE 1
E-501	ELECTRICAL DETAILS AND SCHEDULE

THE LUNZ GROUP

MES GROUP

550 North Reo Street  
Suite 203, Tampa, FL 33609  
813.289.4700  
COA # 8304

HCSO MENTAL HEALTH CLINIC

2310 N. FALKENBURG ROAD  
TAMPA, FLORIDA 33619

ELECTRICAL LEGENDS & ABBREVIATIONS

24001.01

E-001

DRAWN BY: SLJB  
REVIEW BY: DK


THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P 883.682.1881  
F 883.687.6346  
E: ABB0478

lunz.com

LD 1402006 & 465 11 AM



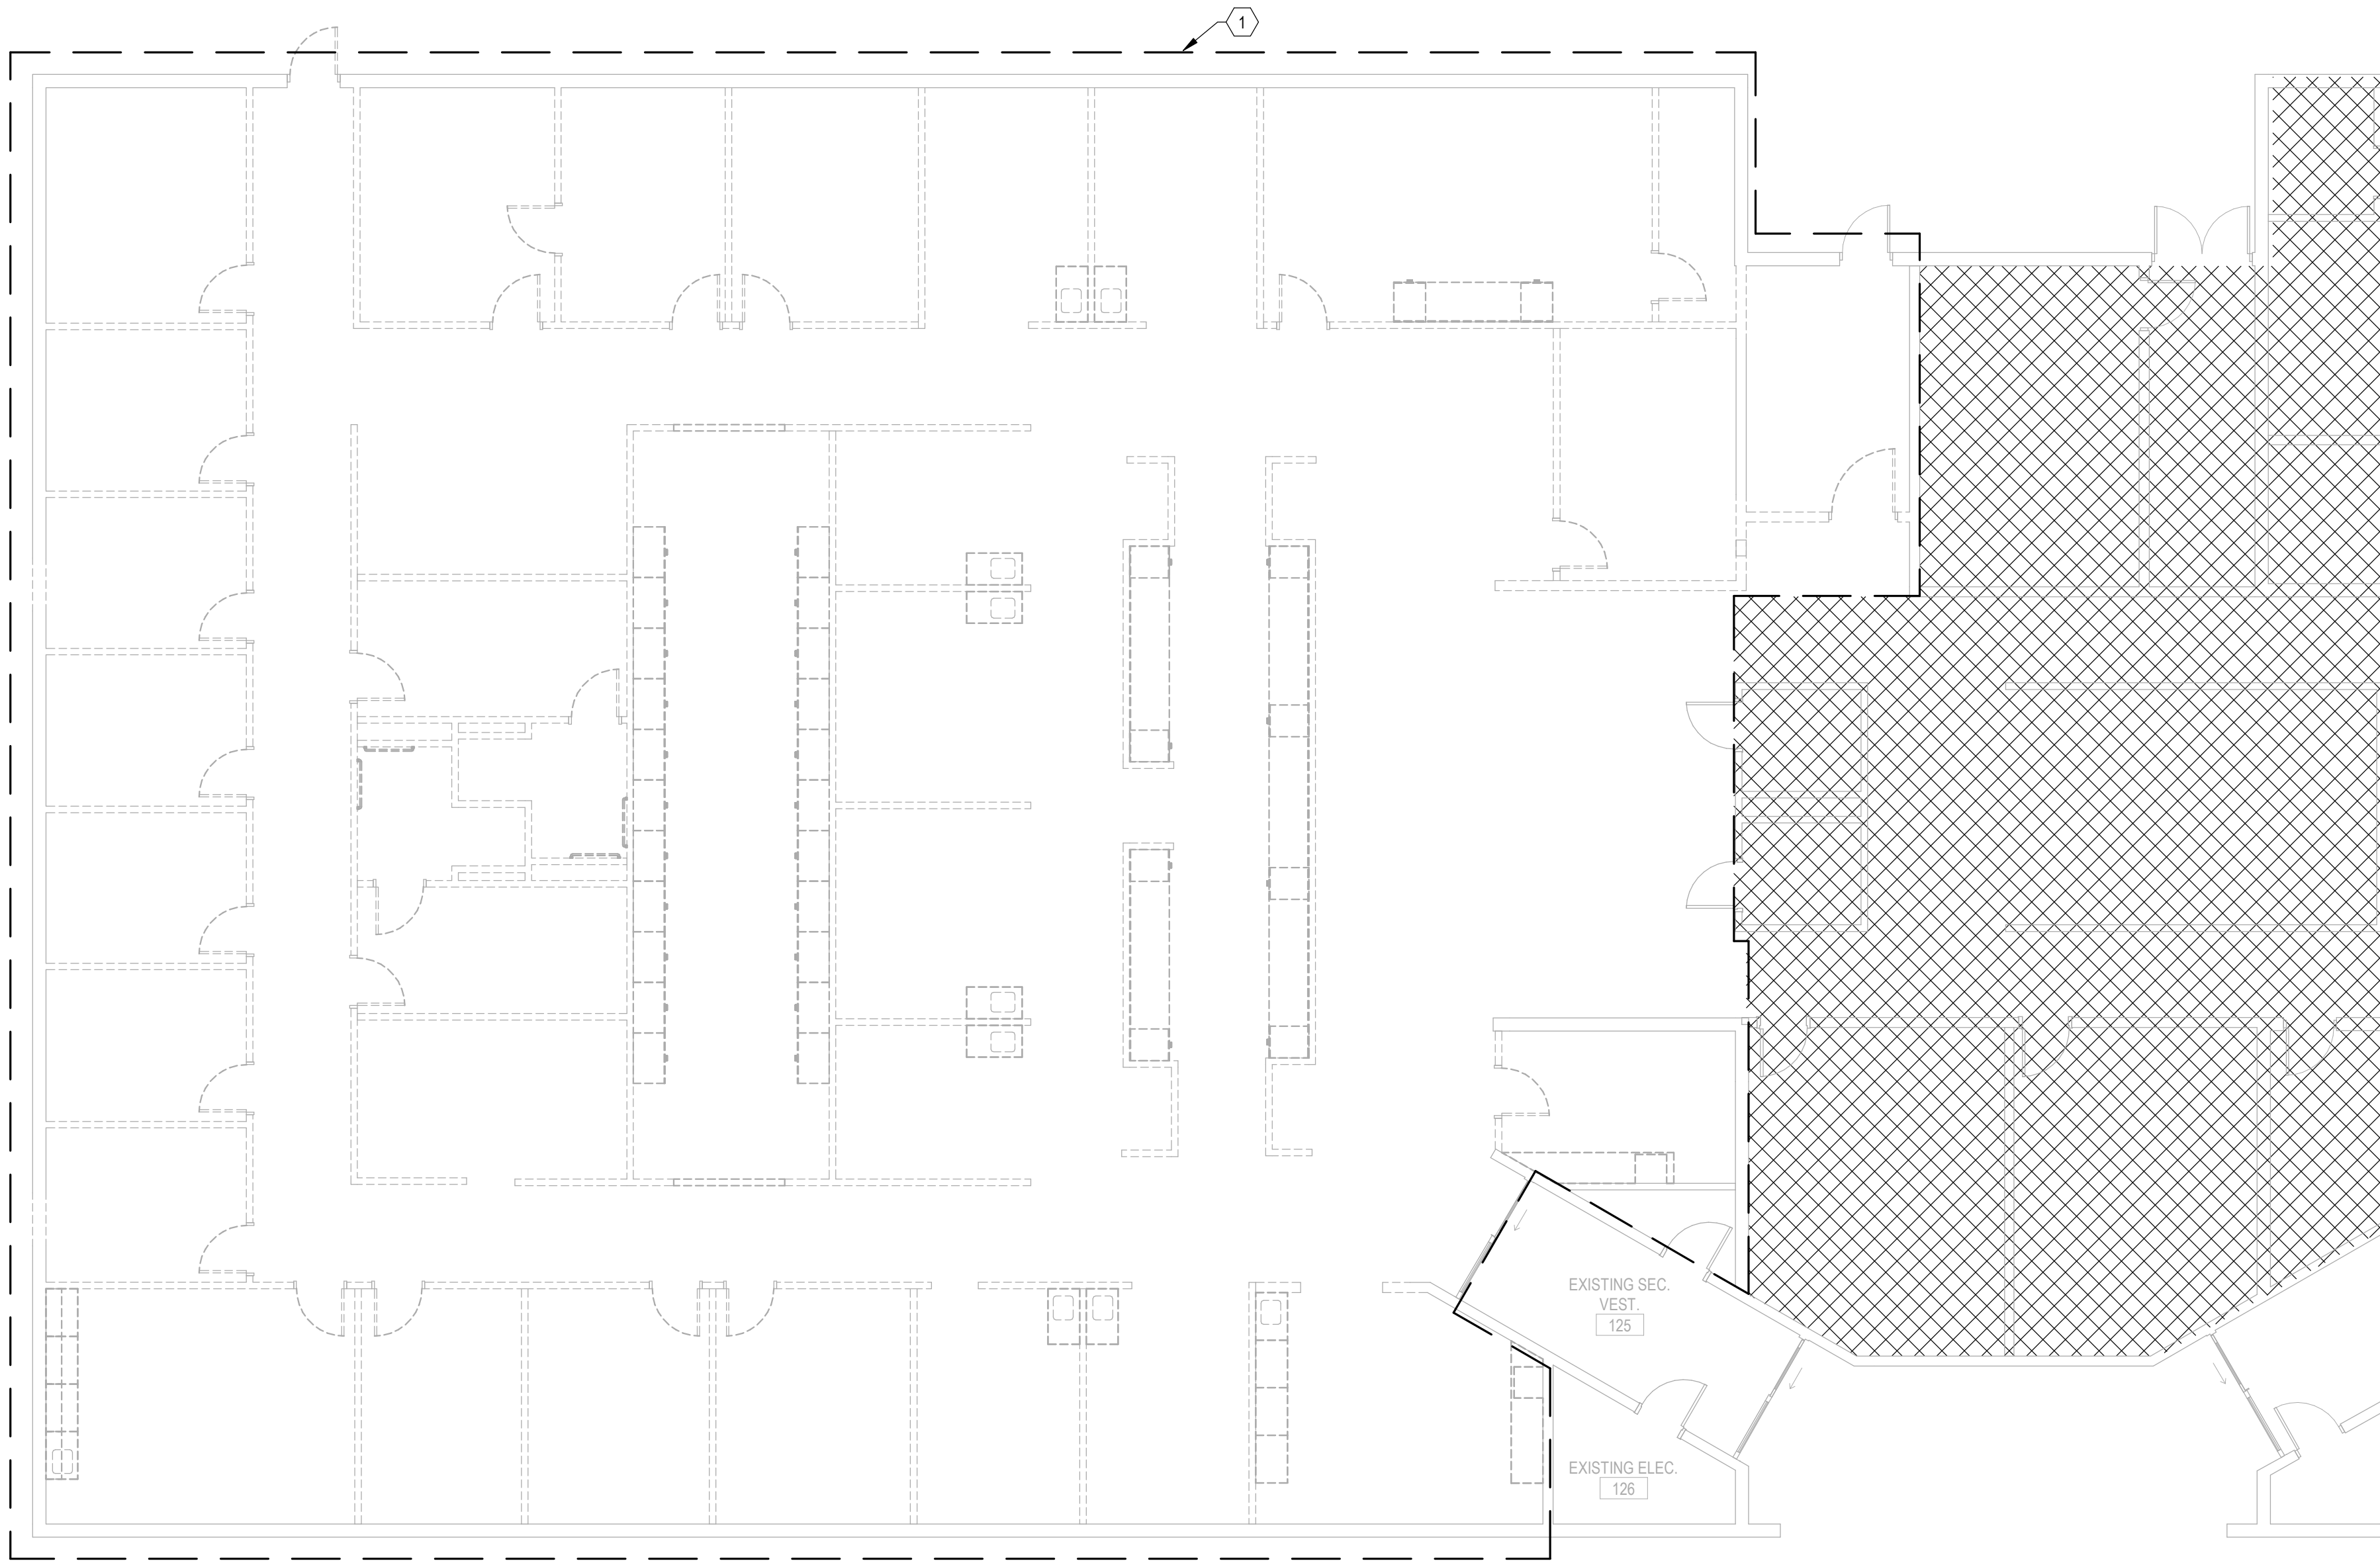

GENERAL NOTES

- A. EXISTING CONDITIONS BASED ON RECORD DOCUMENTS AND FIELD OBSERVATION. ELECTRICAL CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS AND REPORT DISCREPANCIES TO ENGINEER PRIOR TO DISURBING EXISTING INSTALLATION.
- B. NO WORK REQUIRED WITHIN HATCHED AREAS. ALL POWER AND SPECIAL SYSTEM DEVICES, CIRCUITING AND ASSOCIATED WIRING SHALL BE EXISTING TO REMAIN.
- C. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO ENSURE EXISTING CONDITIONS AND LAYOUTS ARE ACCURATE. EXISTING CONDITIONS ARE BASED ON FIELD OBSERVATIONS. THE CONTRACTOR SHALL CONTACT ENGINEER OF RECORD WITH ANY DISCEPANCIES PRIOR TO DISTURBING EXISTING INSTALLATION.
- D. CONTRACTOR SHALL RETAIN BREAKERS MADE SPARE BY DEMOLITION FOR CONNECTION OF NEW WORK UNLESS OTHERWISE NOTED.
- E. ELECTRICAL EQUIPMENT AND FIXTURES INDICATED TO BE REMOVED SHALL BE TURNED OVER TO OWNER FOR FIRST RIGHT OF REFUSAL.
- F. REMOVE ALL ELECTRICAL EQUIPMENT, DEVICES, AND CIRCUITING TO NEAREST POINT OF CONNECTION IN DEMOLITION AREAS UNLESS NOTED OTHERWISE. MAINTAIN EXISTING BREAKERS AND LABEL AS SPARE IN PANELBOARD INDEX.
- G. PROVIDE JUNCTION BOXES, CONDUIT, WIRED CABLE ETC AS REQUIRED TO MAINTAIN CONTINUITY TO EXISTING TO REMAIN POWER DEVICES, EQUIPMENT, ETC.
- H. CONTRACTOR SHALL TEST ALL CIRCUITS, GROUNDS, ETC. FOR CONTINUITY FOR ALL EQUIPMENT, DEVICES FIXTURES, ETC. SHOWN. PROVIDE CIRCUIT EXTENSIONS, CONDUIT, WIRE, ETC. AS REQUIRED FOR COMPLETE SYSTEM CONTINUITY
- I. ALL ABANDONED OR UNUSED, WIRE, CABLING, CONDUIT, ETC SHALL BE REMOVED TO ORIGIN.

KEY NOTES

- 1. ALL METAL HALIDE LIGHTING, LIGHTING CONTROLS AND SYSTEMS TO BE DEMOLISHED IN THIS AREA. EXISTING LIGHTING SHALL BE REMOVED AND UPGRADED TO LEDS. PER AS-BUILTS CIRCUITS 8, 10, 12, 14 FOUND ON EXISTING HGA SERVES THIS AREA.

HCSO MENTAL HEALTH CLINIC

2310 N. FALKENBURG ROAD  
TAMPA, FLORIDA 33619

PARTIAL FLOOR PLAN - LIGHTING DEMOLTION - PHASE 1

#	ISSUED FOR	DATE
	00 - JIA	06.20.24
	75% - JIA	07.26.24
	PERMIT/BID	08.20.24
	ADDENDUM #1	09.03.24

DRAWN BY: SLJB  
REVIEW BY: DK



THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P 883.682.1082  
F 883.687.6346  
or 800.477.78

lunz.com

24001.01

ED-101

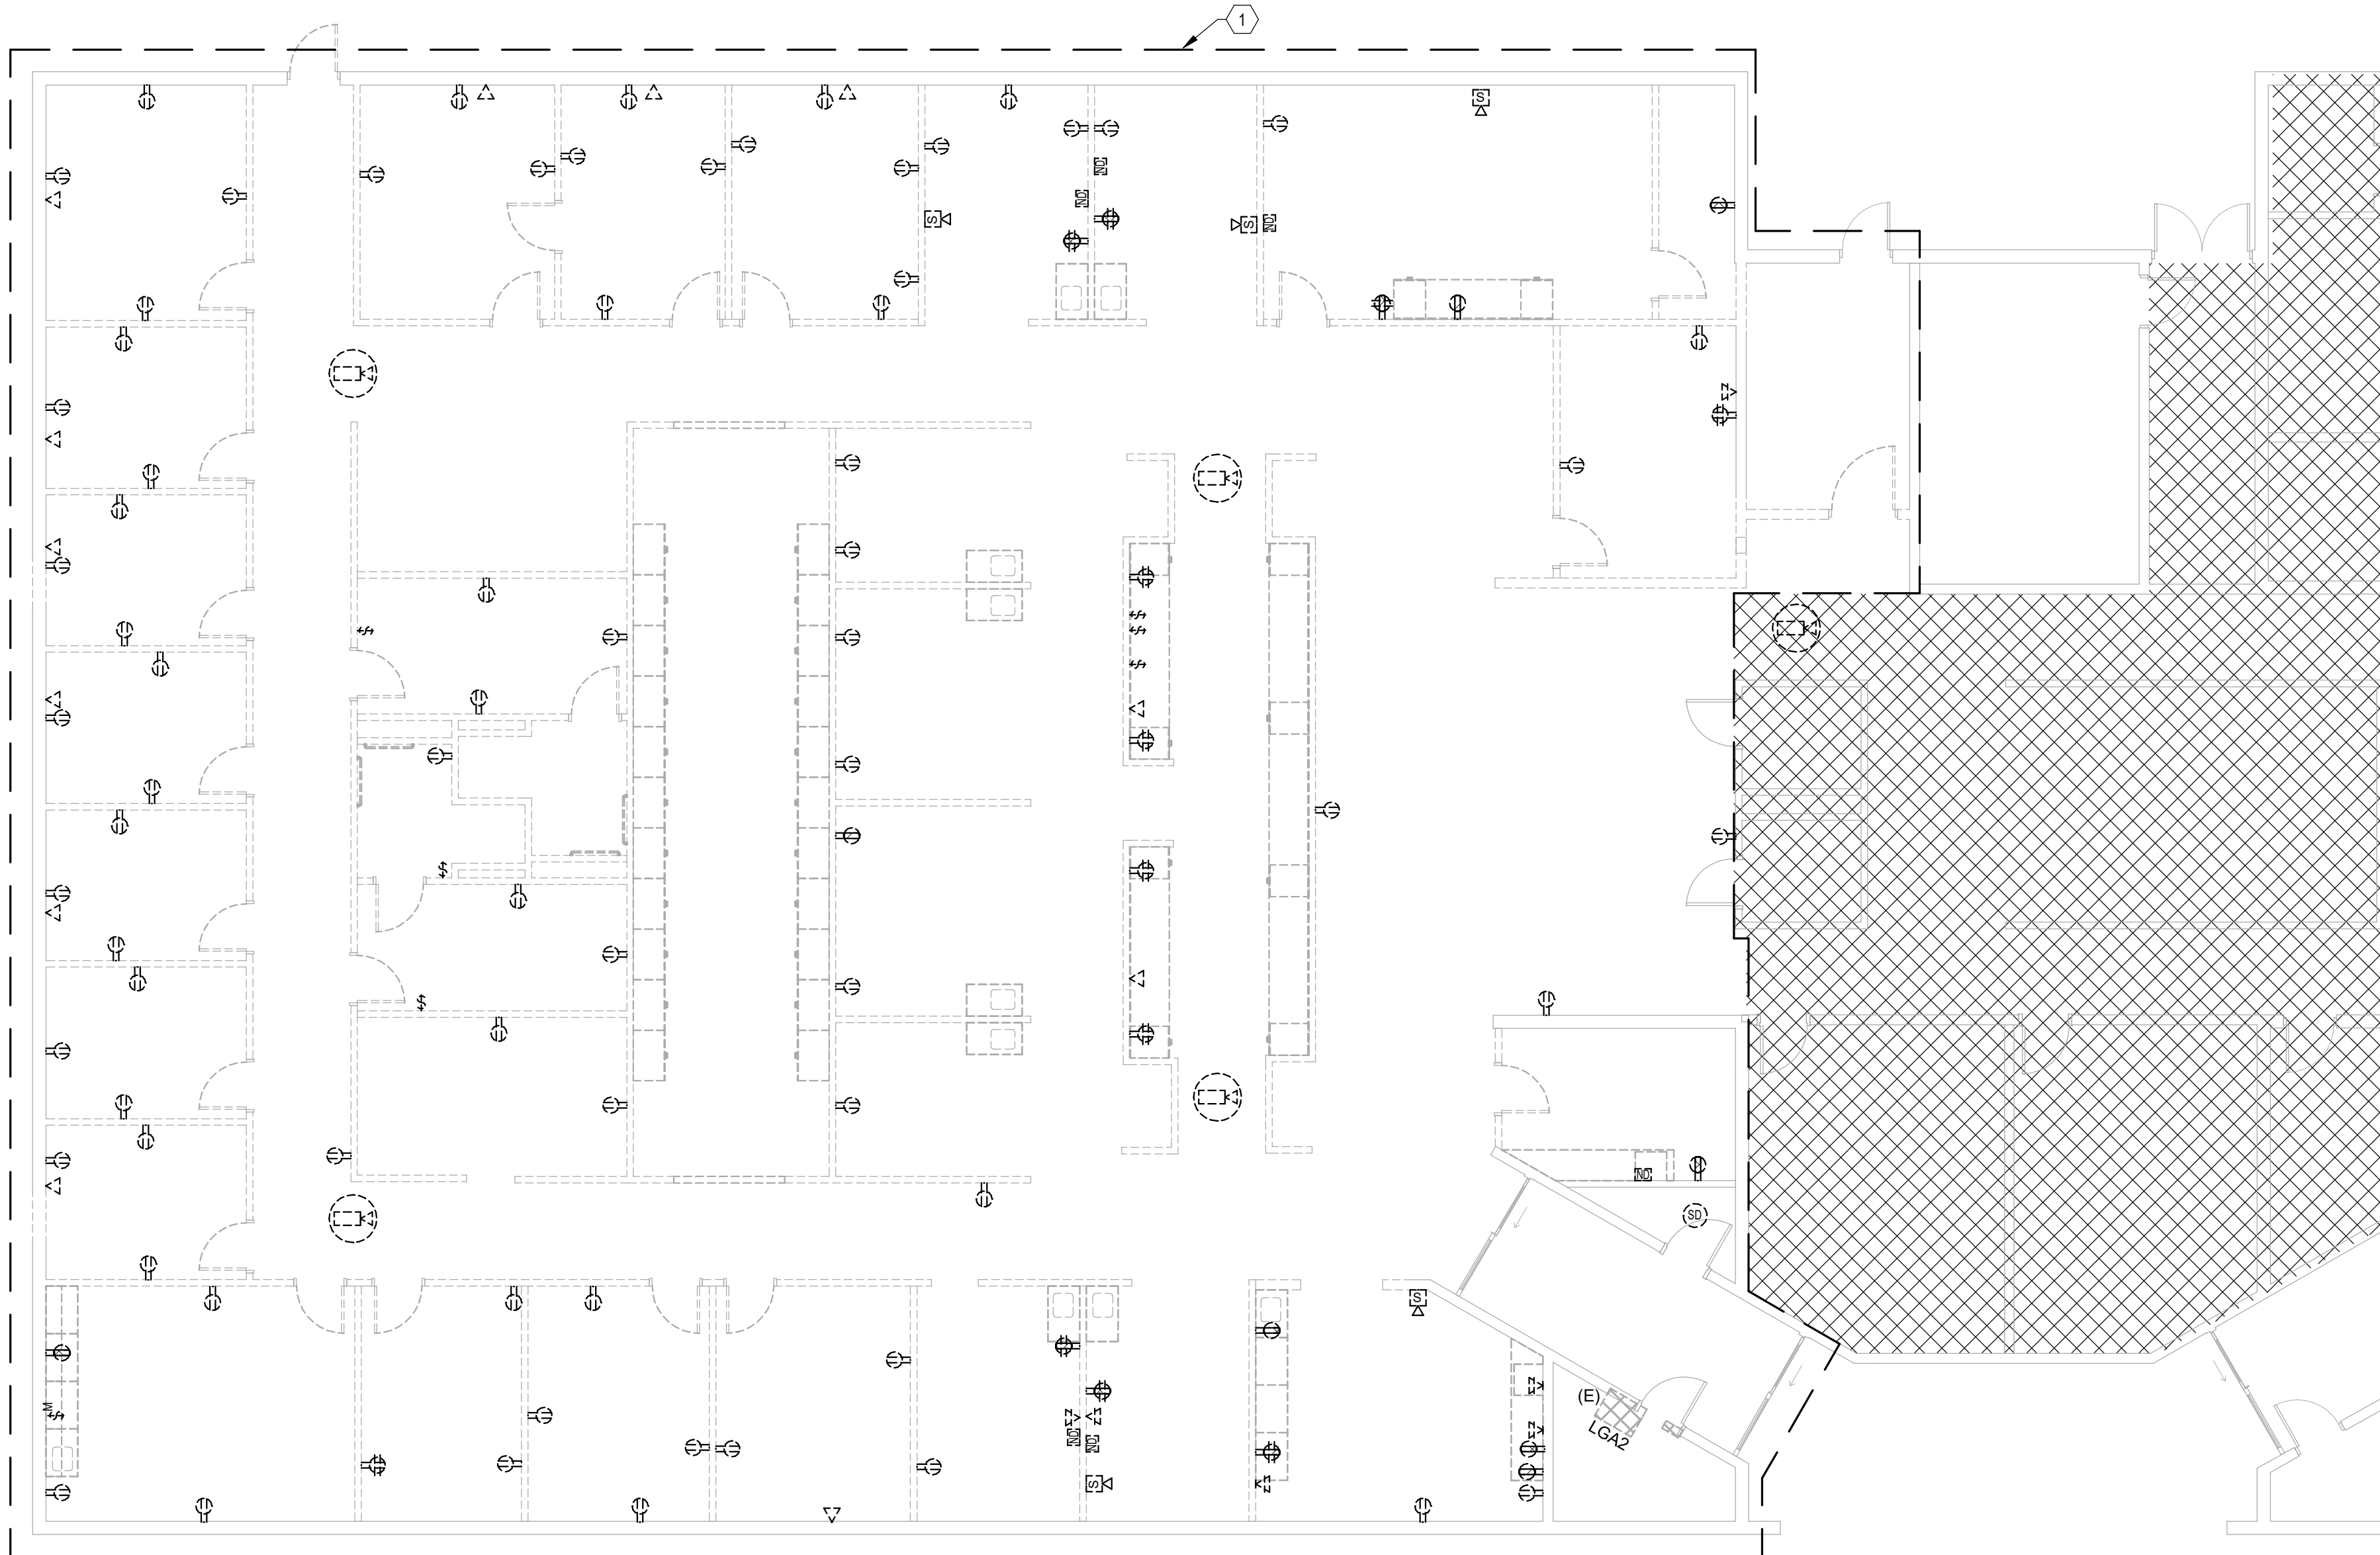

**PARTIAL FLOOR PLAN - ELECTRICAL DEMOLTION - PHASE 1**  
1/8" = 1'-0"

GENERAL NOTES

- A. EXISTING CONDITIONS BASED ON RECORD DOCUMENTS AND FIELD OBSERVATION. ELECTRICAL CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS AND REPORT DISCREPANCIES TO ENGINEER PRIOR TO DISURBING EXISTING INSTALLATION.
- B. NO WORK REQUIRED WITHIN HATCHED AREAS. ALL POWER AND SPECIAL SYSTEM DEVICES, CIRCUITING AND ASSOCIATED WIRING SHALL BE EXISTING TO REMAIN.
- C. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO ENSURE EXISTING CONDITIONS AND LAYOUTS ARE ACCURATE. EXISTING CONDITIONS ARE BASED ON FIELD OBSERVATIONS. THE CONTRACTOR SHALL CONTACT ENGINEER OF RECORD WITH ANY DISCEPANCIES PRIOR TO DISTURBING EXISTING INSTALLATION.
- D. CONTRACTOR SHALL RETAIN BREAKERS MADE SPARE BY DEMOLITION FOR CONNECTION OF NEW WORK UNLESS OTHERWISE NOTED.
- E. ELECTRICAL EQUIPMENT AND FIXTURES INDICATED TO BE REMOVED SHALL BE TURNED OVER TO OWNER FOR FIRST RIGHT OF REFUSAL.
- F. REMOVE ALL ELECTRICAL EQUIPMENT, DEVICES, AND CIRCUITING TO NEAREST POINT OF CONNECTION IN DEMOLITION AREAS UNLESS NOTED OTHERWISE. MAINTAIN EXISTING BREAKERS AND LABEL AS SPARE IN PANELBOARD INDEX.
- G. PROVIDE JUNCTION BOXES, CONDUIT, WIRED CABLE ETC AS REQUIRED TO MAINTAIN CONTINUITY TO EXISTING TO REMAIN POWER DEVICES, EQUIPMENT, ETC.
- H. CONTRACTOR SHALL TEST ALL CIRCUITS, GROUNDS, ETC. FOR CONTINUITY FOR ALL EQUIPMENT, DEVICES FIXTURES, ETC. SHOWN. PROVIDE CIRCUIT EXTENSIONS, CONDUIT, WIRE, ETC. AS REQUIRED FOR COMPLETE SYSTEM CONTINUITY
- I. ALL ABANDONED OR UNUSED, WIRE, CABLING, CONDUIT, ETC SHALL BE REMOVED TO ORIGIN.



KEY NOTES

- 1. THE EXISTING MEDICAL OFFICES, EXAM ROOMS, EQUIPMENT, DEVICES ARE TO BE REMOVED WITHIN THIS AREA AND TO BE DOWNSIZED/CONVERTED TO ISOLATED CELLS/OFFICES. POWER CONSUMPTION WILL BE SUSTAINABLY REDUCED. THE INTENT IS TO REUSE EXISTING SPARE BREAKERS MADE DURING DEMOLITION FOR NEW WORK.

HCSO MENTAL HEALTH CLINIC

2310 N. FALKENBURG ROAD  
TAMPA, FLORIDA 33619

PARTIAL FLOOR PLAN - ELECTRICAL DEMOLTION - PHASE 1

#	ISSUED FOR	DATE
	00 - JIA	06.20.24
	75% - JIA	07.26.24
	PERMIT/BID	08.20.24
	ADDENDUM #1	09.03.24



DRAWN BY: SLJB  
REVIEW BY: DK

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P 863.682.1082  
F 863.687.6346  
W: 4084776

lunz.com



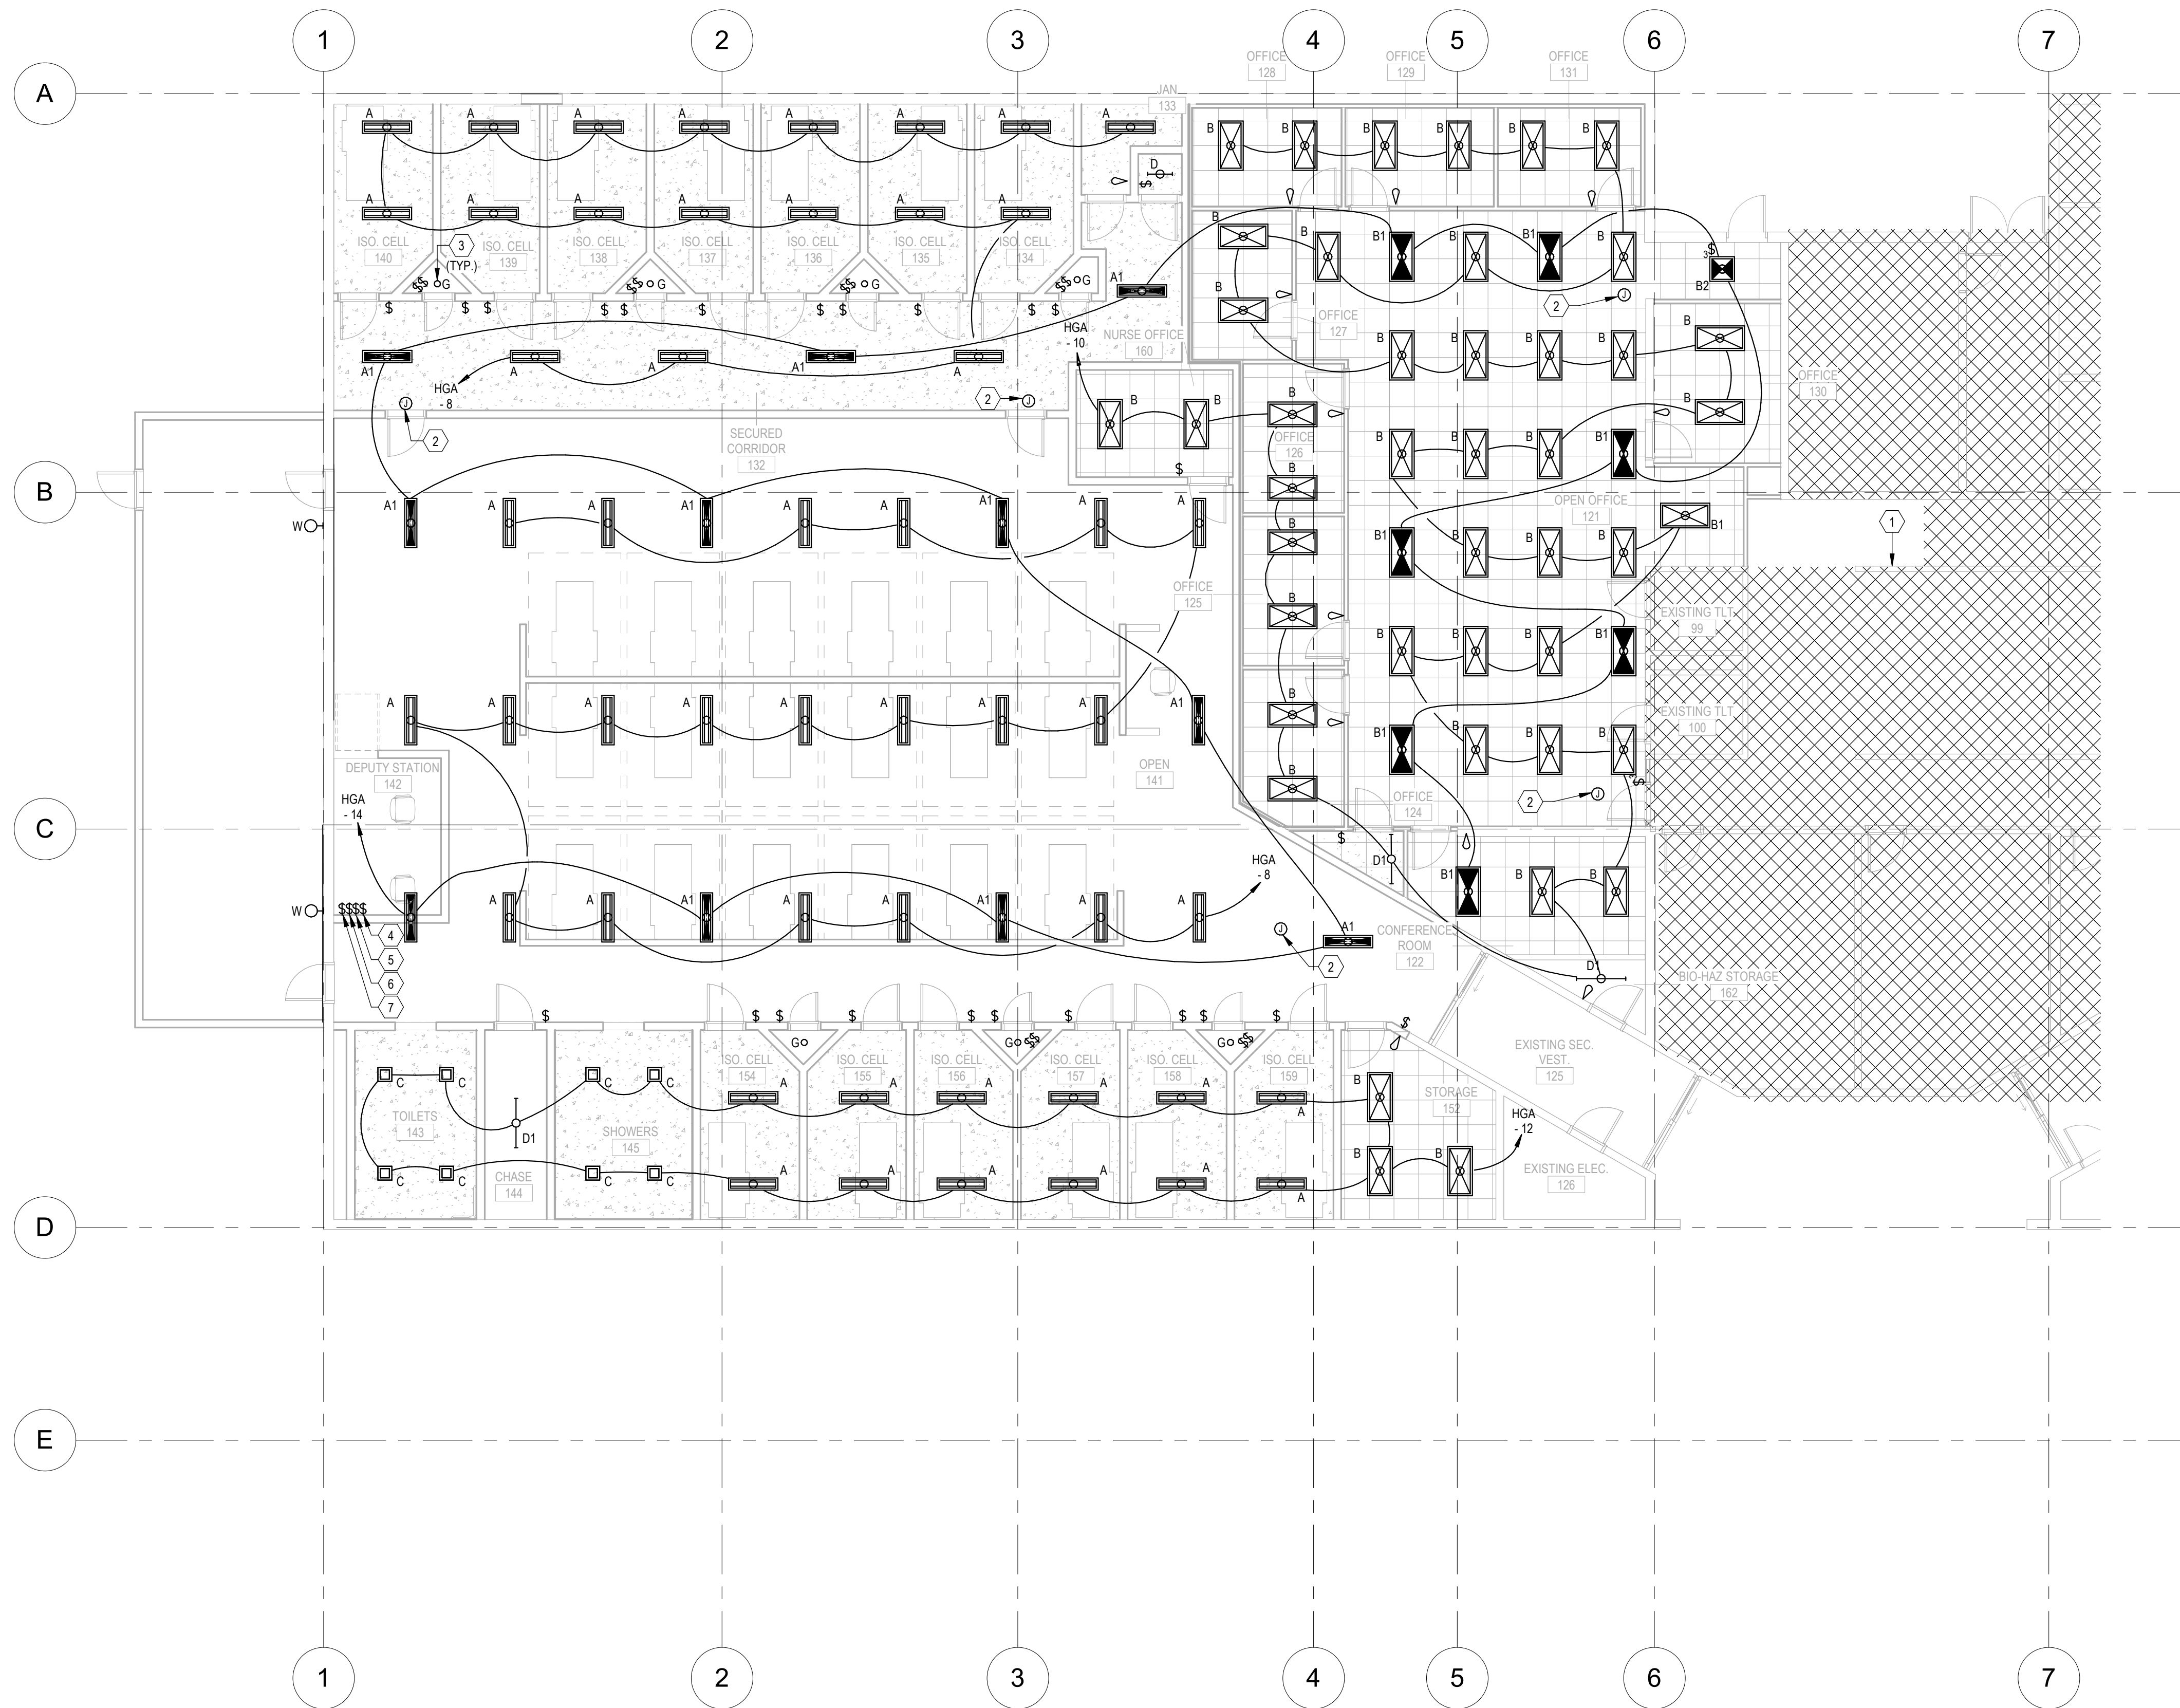

PARTIAL FLOOR PLAN - LIGHTING - PHASE 1

1/8" = 1'-0"

### LIGHTING CONTROL NOTES

- CONTRACTOR SHALL BE RESPONSIBLE FOR IDENTIFICATION OF ALL RATED WALLS, CEILINGS, SLABS, AND THEIR SPECIFIED RATING ON THE ARCHITECTURAL DRAWINGS. ALL DEVICES AND MATERIALS SHALL MEET THE UL RATING OF THE RATED WALLS, CEILINGS AND SLABS ASSEMBLY. CONTRACTOR SHALL PROVIDE AN ASSEMBLY, INSTALLED IN ACCORDANCE WITH UL WHERE NECESSARY.
- CONTRACTOR SHALL COORDINATE ANY WALL MOUNTED LIGHT FIXTURE WITH ARCHITECT AND OWNER PRIOR TO INSTALLATION.
- ALL OCCUPANCY SENSOR CONTROLLED LOADS SHALL TURN OFF WITHIN 20 MINUTES OF THE OCCUPANT LEAVING THE ROOM.
- WHERE MULTIPLE SWITCHES ARE SHOWN AT THE SAME LOCATION, THEY SHALL BE GANGED TOGETHER WITH A COMMON GANG PLATE.
- ALL EXIT LIGHTS AND EMERGENCY BATTERY PACKS SHALL BE CONNECTED TO UNSWITCHED LEG OF THE LOCAL LIGHTING BRANCH CIRCUIT.
- ALL LIGHTING CONTROLS SHALL BE IN ACCORDANCE WITH 2023 FLORIDA BUILDING CODE, ENERGY CONSERVATION.
- PROVIDE DUAL TECH OCCUPANCY/VACANCY SENSORS IN ALL OFFICES, CORRIDORS, OPEN OFFICES, LOUNGES/BREAKROOMS, RESTROOMS, STORAGE ROOMS, AND ALL OTHER SPACES 300 SQUARE FEET OR LESS ENCLOSED BY FLOOR TO CEILING HEIGHT PARTITIONS. THIS EXCLUDES MECHANICAL ROOMS, ELECTRICAL ROOMS, TELECOMMUNICATION SPACES, AND OTHER AREA WHERE THE AUTOMATIC SHUT OFF OF LIGHTS WILL CAUSE A DANGER TO LIFE SAFETY.
- WHERE VACANCY SENSORS ARE REQUIRED, LIGHTS SHALL BE MANUAL ON, AUTOMATIC OFF. LIGHTS SHALL TURN OFF AUTOMATICALLY WITHIN 20 MINUTES OF THE SPACE BECOMING VACANT.
- WHERE OCCUPANCY SENSORS ARE REQUIRED, LIGHTS SHALL TURN ON TO FULL AUTOMATICALLY, TURN OFF AUTOMATICALLY WITHIN 20 MINUTES OF THE SPACE BECOMING UNOCCUPIED, AND SHALL HAVE A SWITCH FOR MANUAL OVERRIDE.
- CONTRACTOR SHALL PROVIDE QUANTITY OF SENSORS REQUIRED WITH PROPER COVERAGE PATTERN TO ACHIEVE REQUIRED LIGHTING CONTROL WITHIN THE SPACE.
- CONTRACTOR SHALL PROVIDE SHOP DRAWINGS FROM THE CONTROLS MANUFACTURER'S REPRESENTATIVE SHOWING LAYOUT, QUANTITY, COVERAGE PATTERNS, AND WIRING DIAGRAM OF COMPLETE SYSTEM.
- FOR CLARITY, ONLY VACANCY (VS) OR OCCUPANCY (OC) ARE SHOWN IN SPACES REQUIRING THAT MODE OF CONTROL.
- PROVIDE LOW VOLTAGE OVERRIDE DIMMING SWITCHES IN ALL SPACES REQUIRING VACANCY/OCCUPANCY SENSORS WITH CONTROL FUNCTION AS OUTLINED.
- PROVIDE ROOM CONTROLLERS AS REQUIRED TO INTERFACE ALL LIGHTS, SWITCHES, SENSORS, ETC. IN ALL SPACES SHOWN TO RECEIVE AUTOMATIC LIGHTING CONTROLS.
- EXTERIOR LIGHTING SHALL BE CONTROLLED BY PHOTOCELL ONTIME CLOCK OFF. PROVIDE TIME CLOCK FOR CONTROLS. COORDINATE TIME OF DAY SCHEDULING WITH STATION REPRESENTATIVE.
- LIGHTING CONTROL SYSTEM SHALL BE A STAND ALONE NON-NETWORKED SYSTEM AS MANUFACTURED BY ACUTY. ALTERNATE APPROVED MANUFACTURERS ARE GREENGATE, WATTSTOPPER, AND HUBBELL.
- ALL AREAS WHERE INMATES ARE NORMALLY OCCUPIED, THESE AREAS ARE NOT REQUIRED TO HAVE ADDITIONAL AUTOMATIC LIGHTING CONTROL DUE TO ENDANGERMENT OF OCCUPANTS FOR THESE AREAS SHALL BE MANUAL ON AND MANUAL OFF AND LOCATED AT A SUPERVISED CENTRAL LOCATION IDENTIFIED BY THE OWNER. PROVIDE LOCK COVER AND KEYS AS REQUIRED BY OWNER.
- THE DESIGN INTENT IS TO REUSE EXISTING LIGHTING CIRCUITS MADE SPARE DURING DEMOLITION. CONTRACTOR SHALL UTILIZE THE CLOSEST SPARE BREAKER PREVIOUSLY SERVICING DEMOLISHED LIGHTING FIXTURES.

### KEYNOTES

- HATCHED AREA NOT IN SCOPE.
- PROVIDE RECESSED JUNCTION BOX AND CONDUIT WITH PULL STRINGS BACK TO ELECTRICAL ROOM FOR FUTURE EXIT SIGNAGE.
- MOUNT FIXTURE ON CEILING, COORDINATE MOUNTING WITH PLUMBING PIPING.
- SWITCH FOR SHOWERS COORDINATE EXACT LOCATION WITH OWNER PRIOR TO INSTALLATION.
- SWITCH FOR TOILETS COORDINATE EXACT LOCATION WITH OWNER PRIOR TO INSTALLATION.
- OVERRIDE SWITCH FOR OPEN ROOM 141 LIGHTING COORDINATE EXACT LOCATION WITH OWNER PRIOR TO INSTALLATION.
- OVERRIDE SWITCH FOR SHOWER AND TOILET CHASE COORDINATE EXACT LOCATION WITH OWNER PRIOR TO INSTALLATION.


#	ISSUED FOR	DATE
	05% - JIA	06.20.24
	75% - JIA	07.26.24
	PERMIT/BID	08.20.24
	ADDENDUM #1	09.05.24

DRAWN BY: SLJB  
REVIEW BY: DK

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P 883.682.1082  
F 883.687.6346  
W: A004778

lunz.com

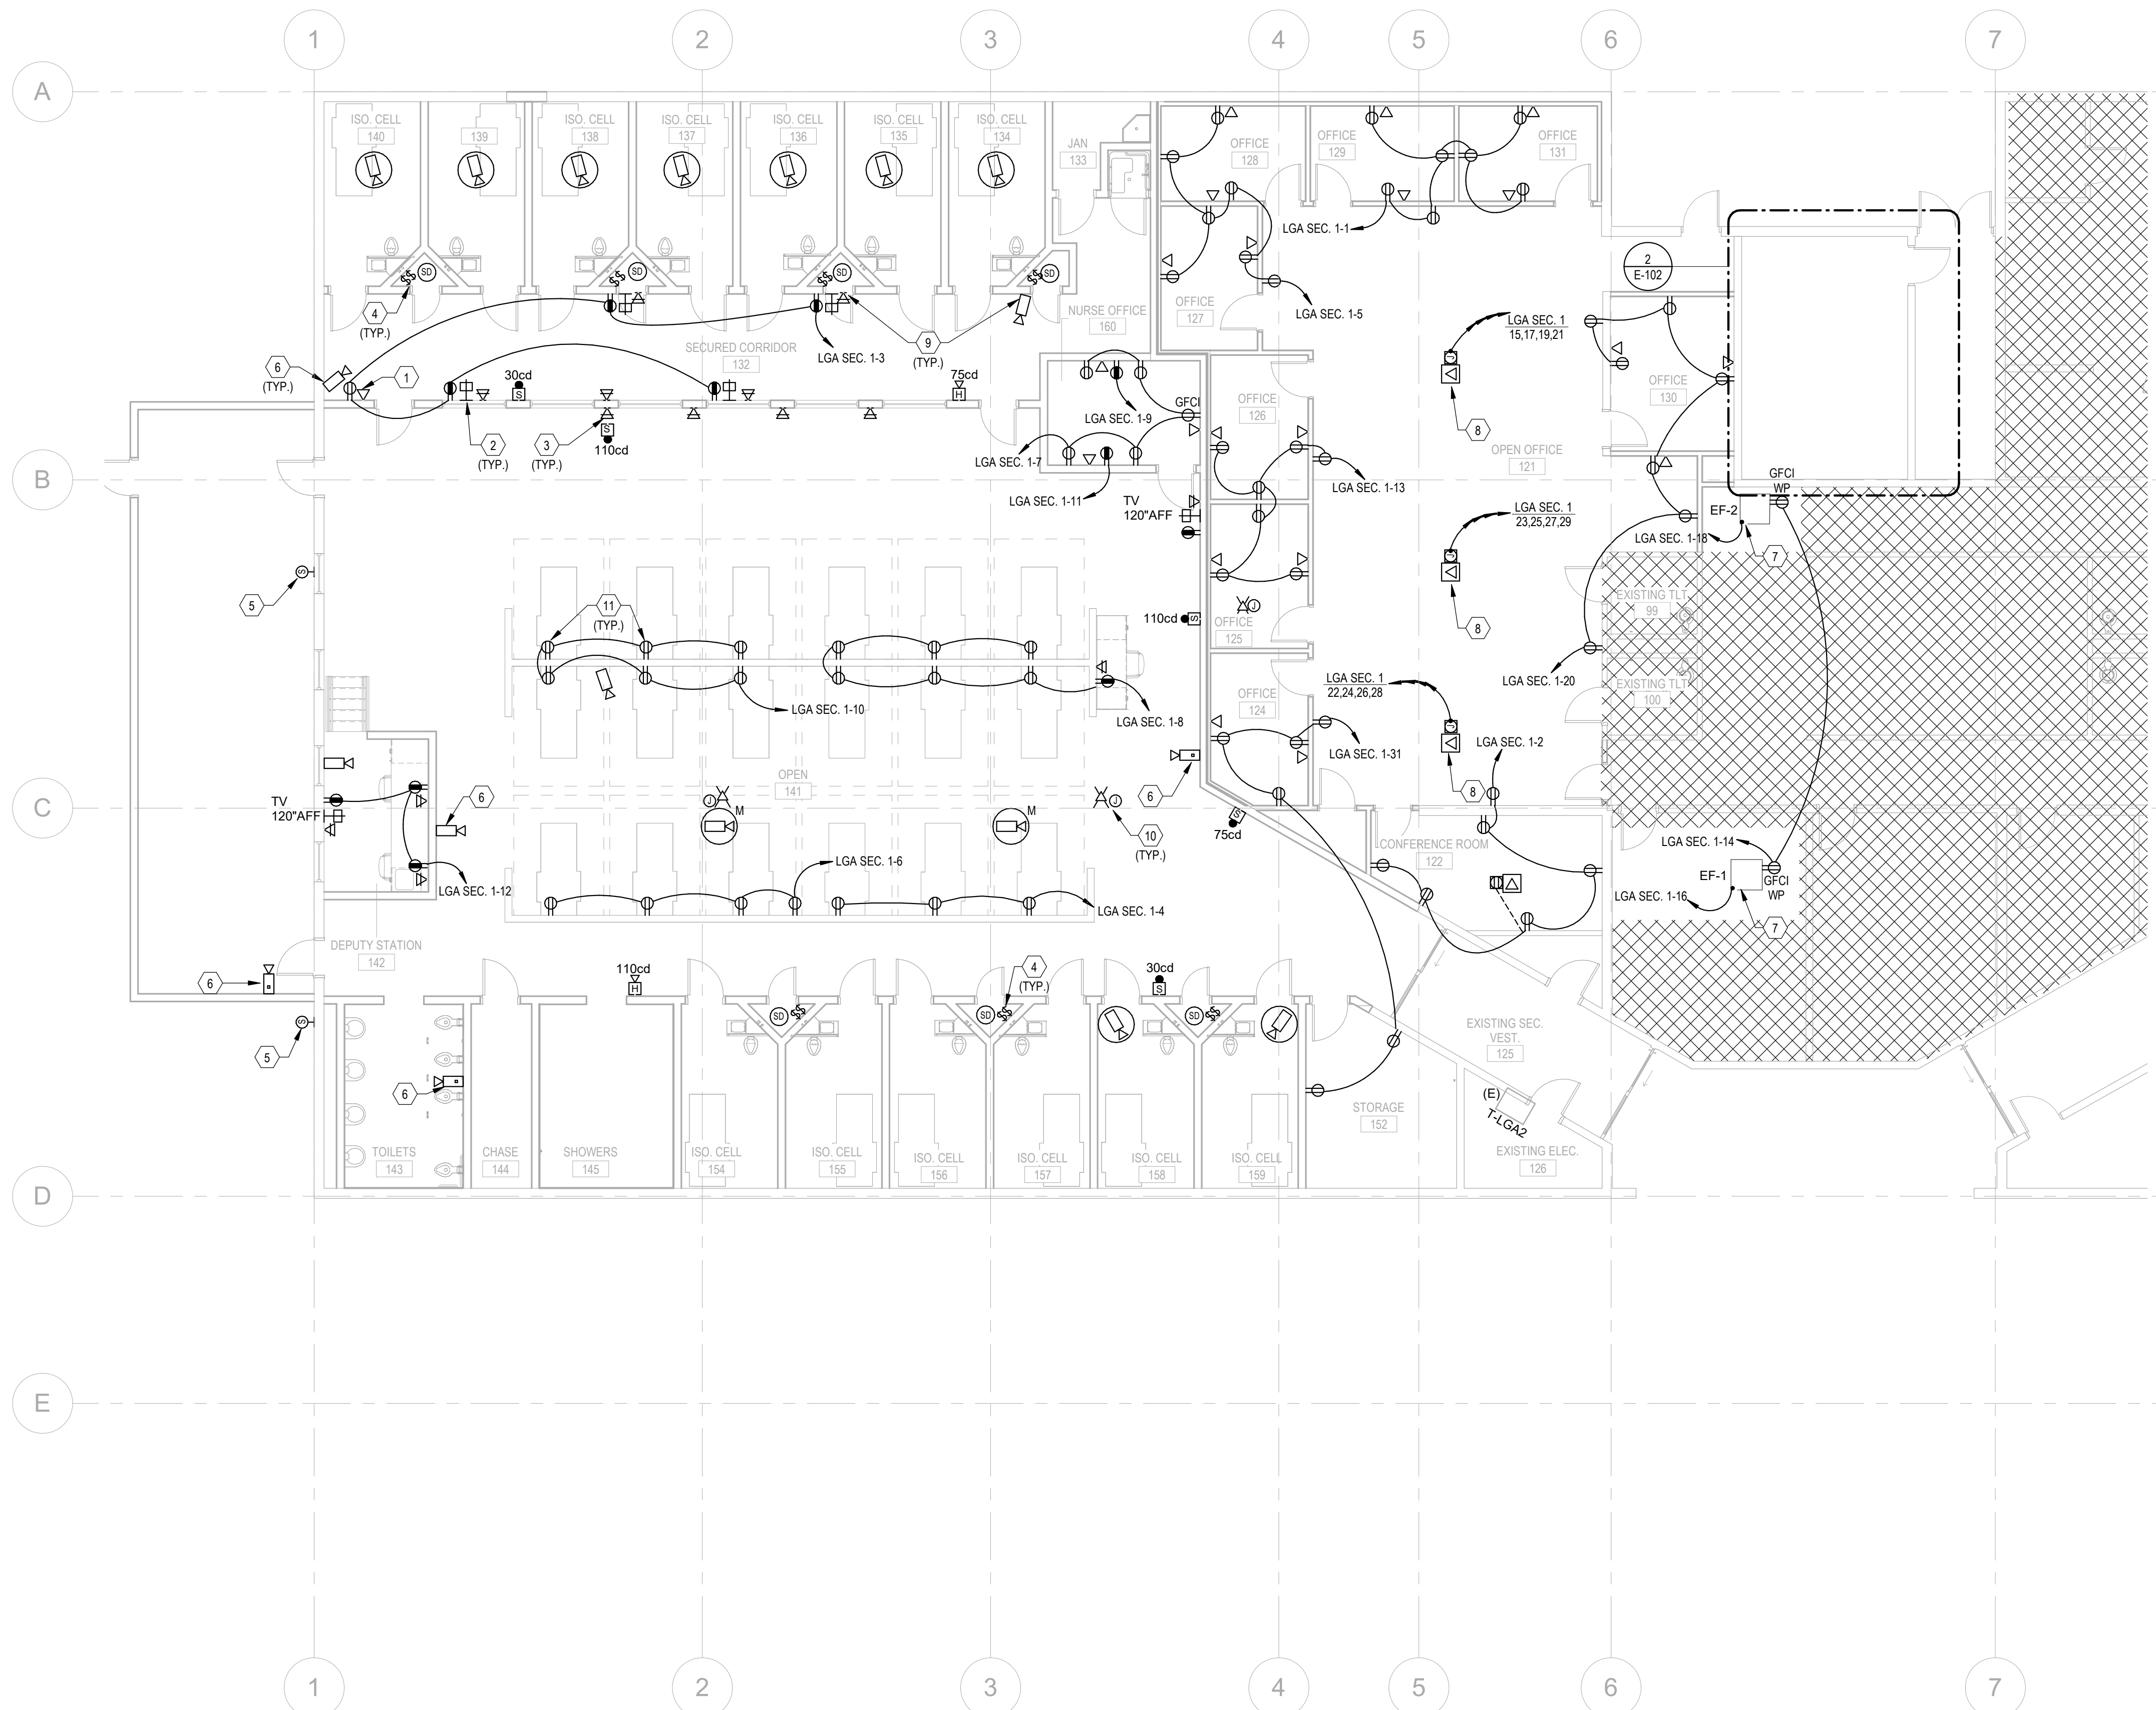

**1** PARTIAL FLOOR PLAN - POWER - PHASE 1  
1/8" = 1'-0"

GENERAL NOTES

A. CONTRACTOR SHALL BE RESPONSIBLE FOR IDENTIFICATION OF ALL RATED WALLS, CEILINGS, SLABS, AND THEIR SPECIFIED RATING ON THE ARCHITECTURAL DRAWINGS. ALL DEVICES AND MATERIALS SHALL MEET THE UL RATING OF THE RATED WALLS, CEILINGS AND SLABS ASSEMBLY. CONTRACTOR SHALL PROVIDE AN ASSEMBLY, INSTALLED IN ACCORDANCE WITH UL WHERE NECESSARY.

B. CONTRACTOR SHALL VERIFY POWER AND CONNECTION REQUIREMENTS FOR ALL CATERING EQUIPMENT PRIOR TO INSTALLATION. VERIFY ALL DEVICE LOCATION AND MOUNTING HEIGHT. MAKE ADJUSTMENT IN FIELD TO MATCH ACTUAL EQUIPMENT BEING INSTALLED.

C. ALL SECURITY, DATA, COMMUNICATIONS, TV OUTLETS AND EQUIPMENT INSTALLATION AND LOCATIONS SHALL BE COORDINATED WITH HCSO IT DEPARTMENT PRIOR TO ROUGH-IN. PROVIDE BACKBOXES AND CONDUIT STUB-UPS WITH PULL STRINGS TO ACCESSIBLE CEILING.

KEYNOTES

1. MOUNT VIDEO CALL BOX POWER AND DATA OUTLETS AT 18" AFF.

2. MOUNT TV OUTLETS ABOVE DOORS AND WINDOWS.

3. MOUNT TELEPHONE OUTLET AT 56" AFF.

4. ISOLATION CELL CAMERA OVERRIDE SWITCHES.

5. WALL MOUNTED SPEAKER.

6. WALL MOUNT SECURITY CAMERA.


7. EXHAUST FAN IS PROVIDED WITH FACTORY DISCONNECT SWITCH. COORDINATE EXACT LOCATION OF EF AND ADEQUATE LENGTH OF FEED PRIOR TO CONNECTION.

8. PROVIDE JUNCTION BOX FOR MODULAR FURNITURE POWER AND DATA WHIP. WIRING SCHEME FOR FURNITURE TO BE (4) CIRCUIT, 2 +2 CONFIGURATION. COORDINATE REQUIREMENTS WITH VENDOR.

9. CONTRACTOR SHALL PROVIDE AND INSTALL 0-3/4" CONDUIT FOR ALL DATA DEVICES AND SECURITY CAMERAS. EACH DATA JACK SHALL HAVE TWO PORTS. COORDINATE WITH ISD (SHERIFF'S INTERNET IT GROUP) FOR EXACT LOCATION OF DEVICES AND TERMINATION LOCATION.

10. CONTRACTOR SHALL INSTALL 0-3/4" CONDUIT AND JUNCTION BOX FOR WIRELESS ACCESS POINTS BACK TO COMM. ROOM. VERIFY EXACT LOCATION AND QUANTITY WITH ISD.

11. OUTLETS FOR PRISONER C-PAP MACHINES.

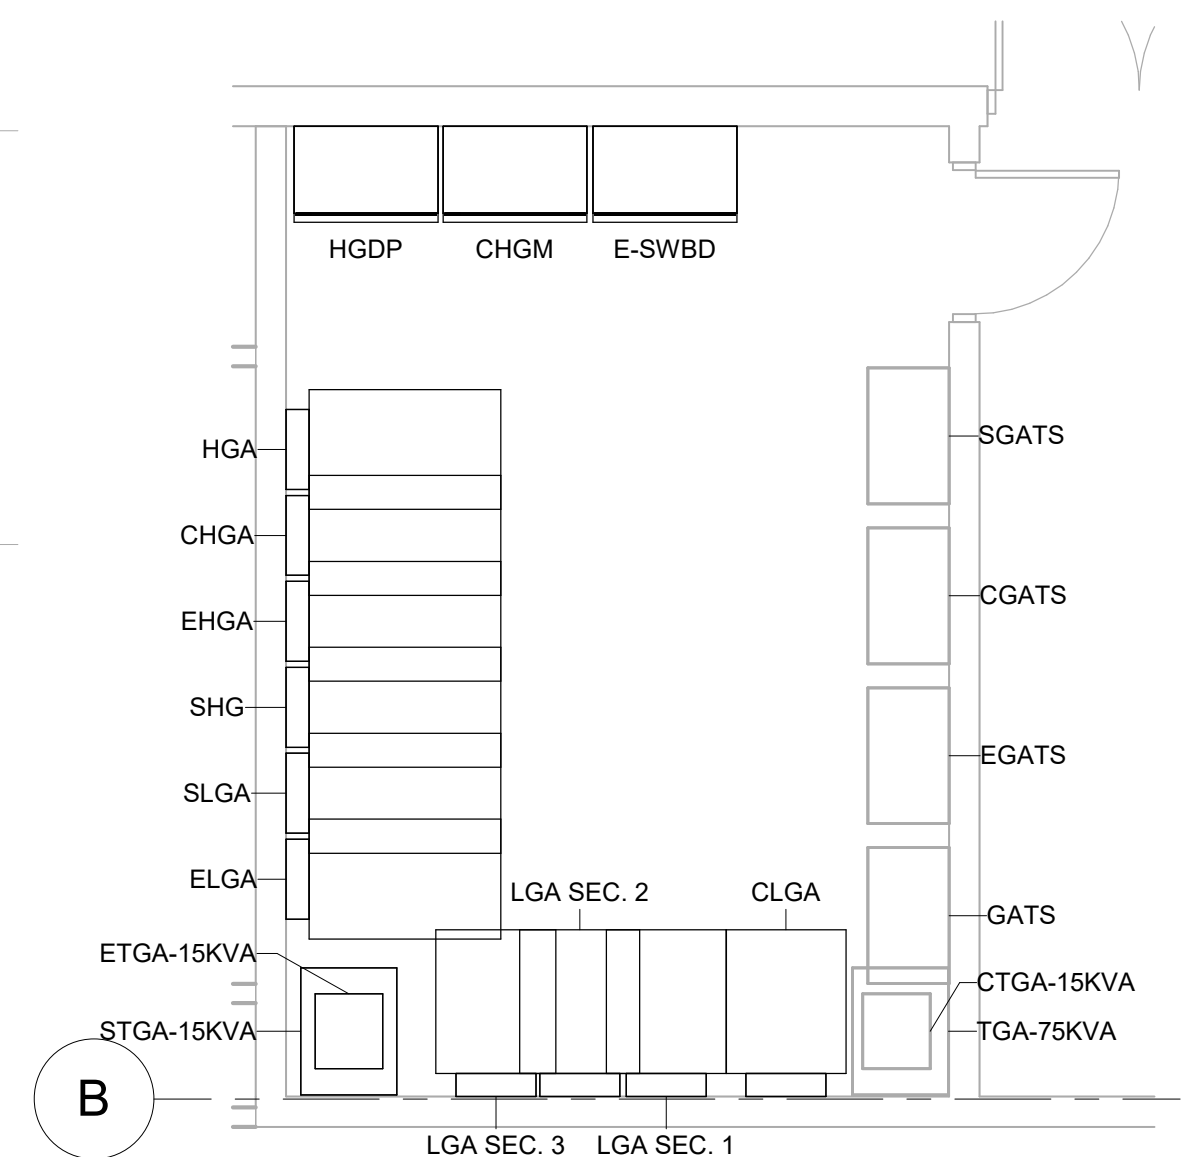

**2** ENLARGED ELECTRICAL ROOM  
1/4" = 1'-0"

#	ISSUED FOR	DATE
1	05 - JIA	05.20.24
2	75% - JIA	07.26.24
3	PERMIT/BID	08.20.24
4	ADDENDUM #1	09.05.24


DRAWN BY: SLJB  
REVIEW BY: DK  
  
THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P 883.682.1852  
F 883.687.6346  
E: AL047@LUNZ.COM

lunz.com




LIGHTING FIXTURE SCHEDULE								
TYPE	MANUFACTURER	CATALOG NUMBER	DESCRIPTION	TEMP	VOLTS	MOUNTING	BALLAST/ TRANSFORMER	INPUT WATTS
A	LUMINAIRE LED	VPF8 4FT MIN10 50W 40K MVOLT OP WHT	4' LIGATURE AND VANDAL RESISTANT, OPAL LENS, DIMMABLE	80CRI/4000K	UNV	SURFACE	0-10V/10%	50
A1	LUMINAIRE LED	VPF8 4FT MIN10 100W 40K MVOLT OP WHT	4' LIGATURE AND VANDAL RESISTANT, OPAL LENS, DIMMABLE	80CRI/4000K	UNV	SUSPEND 17'-0" AFF	0-10V/10%	100
B	LITHONIA	2BLT4 40L AD5M GZ10 LP840	2X4 TROFFER, SMOOTH REFLECTOR AND DIFFUSER, DIMMABLE	80CRI/4000K	UNV	RECESSED	0-10V/10%	30
B1	LITHONIA	2BLT4 30L AD5M GZ10 LP840 DGA	2X4 TROFFER, SMOOTH REFLECTOR AND DIFFUSER, DIMMABLE, DRYWALL ADPATERS	80CRI/4000K	UNV	RECESSED	0-10V/10%	22
B2	LITHONIA	2BLT2 20L AD5M GZ10 LP840	2X2 TROFFER, SMOOTH REFLECTOR AND DIFFUSER, DIMMABLE	80CRI/4000K	UNV	RECESSED	0-10V/10%	16
C	LUMINAIRE LED	RMQ Q11 H16CRSP D14CRSP MIN10 25W 40K MVOLT ALS SES WHT WL	13.5" X 13.5" RECESSED CONFINEMENT FIXTURE, LIGATURE RESISTANT, PRISMATIC ACRULIC LENS, WHITE FINISH, WET LOCATION	80CRI/4000K	UNV	RECESSED	0-10V/10%	25
D	LITHONIA	ZL1 L24 SMR 1500LM FST MVOLT 40K 80CRI WH	2' STRIP, 1500 LUMENS, CURVED LENS, WHITE FINISH, DAMP LOCATION	80CRI/4000K	UNV	SURFACE	0-10V/10%	17
D1	LITHONIA	ZL1 L48 SMR 3000LM FST MVOLT 40K 80CRI WH	4' STRIP, 3000 LUMENS, CURVED LENS, WHITE FINISH, DAMP LOCATION	80CRI/4000K	UNV	SURFACE	0-10V/10%	30
G	JUNO	JSBT 6IN 30K 90CRI WL MW M6	6" DOWNLIGHT 2700K COLOR TEMPERATURE LOW PROFILE	3000K	120V	SURFACE	0-10V/10%	14.4
W	LITHONIA	DSXF3 6 P3 50K 70CRI WFL MVOLT YKC82 DBLXD	FLOOD LIGHT, ADJUSTABLE HEAD, 24,000 LUMENS, WET LOCATION	70CRI/5000K	UNV	WALL	NO DIM	165
X	BEGHELLI	CRV-SR-LR-FACE-C-AL	EXIT SIGN, EDGE LIT, LED, RED LETTERS, SELF POWERED	LED	UNV	SURFACE	NO DIM	4
LIGHTING SCHEDULE NOTES: 1. ALL LAMPS SHALL BE 80+ CRI AND 4000K UNLESS NOTED OTHERWISE. 2. OTHER FIXTURES MAY BE SUBMITTED FOR APPROVAL UP TO 10 WORKING DAYS PRIOR TO BID DATE, TO ALLOW FOR PROPER EVALUATION. SUBMISSIONS WITHIN 10 WORKING DAYS PRIOR TO BID DATE WILL NOT BE EVALUATED. EQUIPMENT IS APPROVED THROUGH ADDENDUM ONLY.								

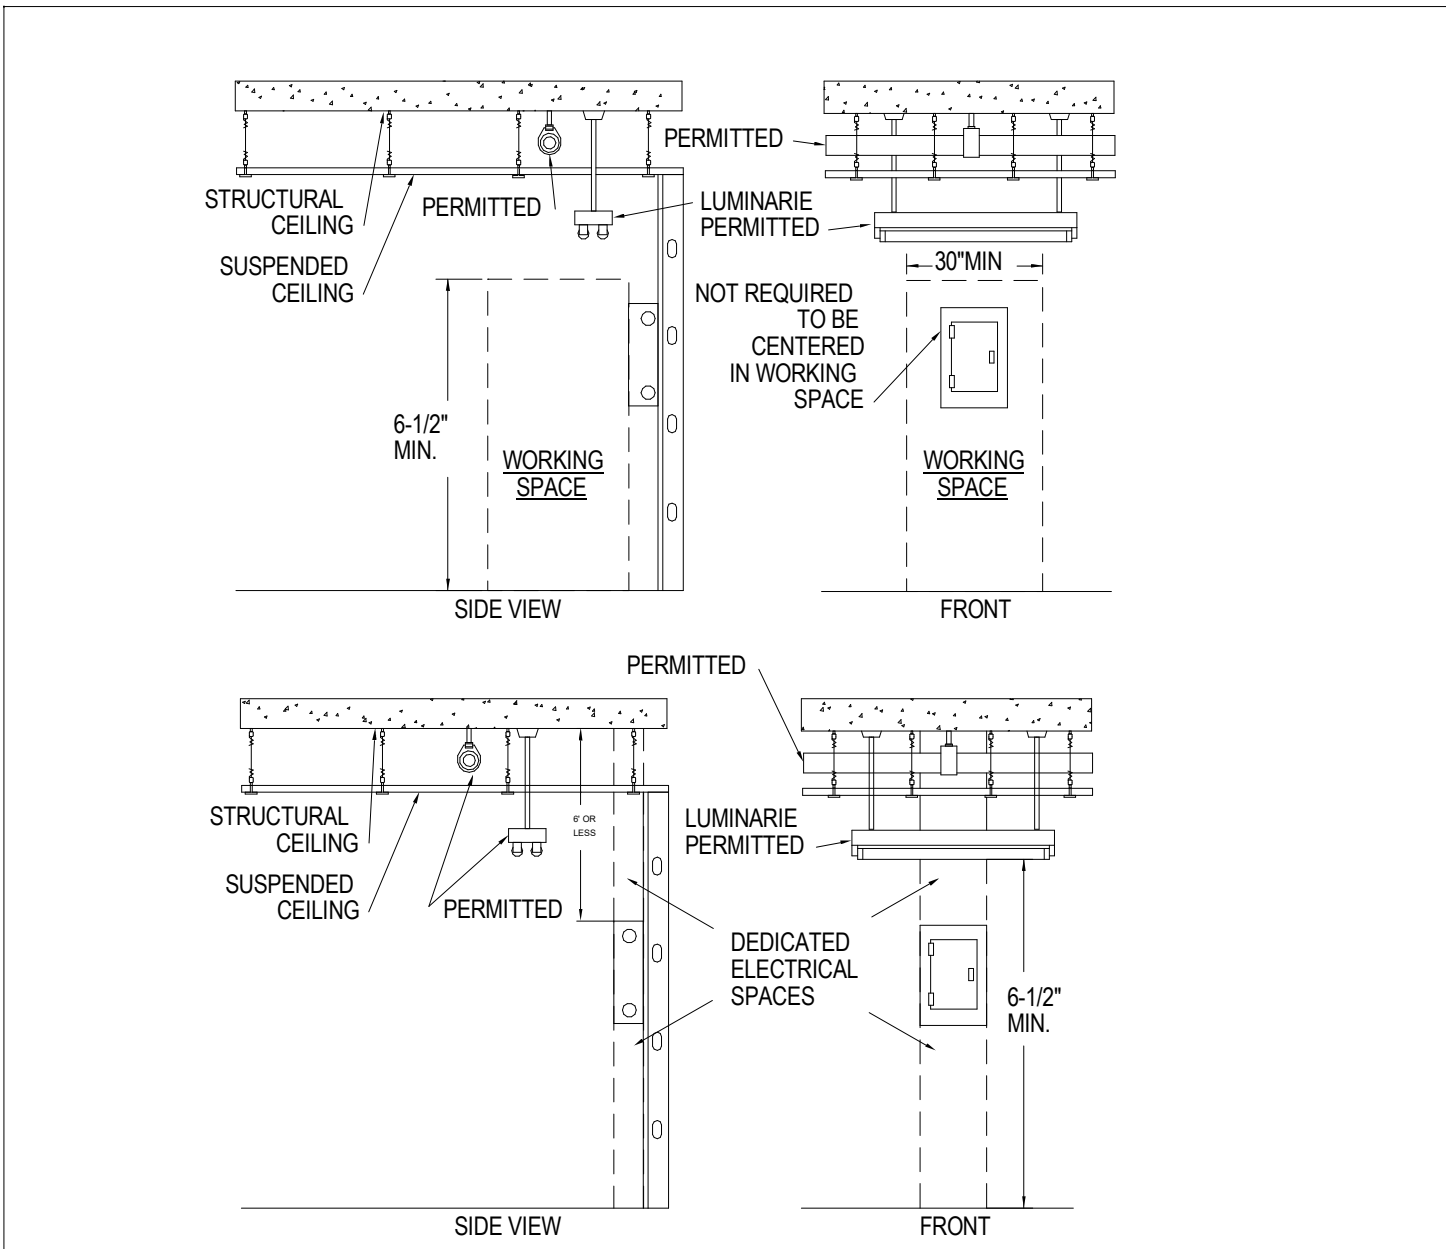


D DEDICATED AND WORKING ELECTRICAL SPACES

NTS

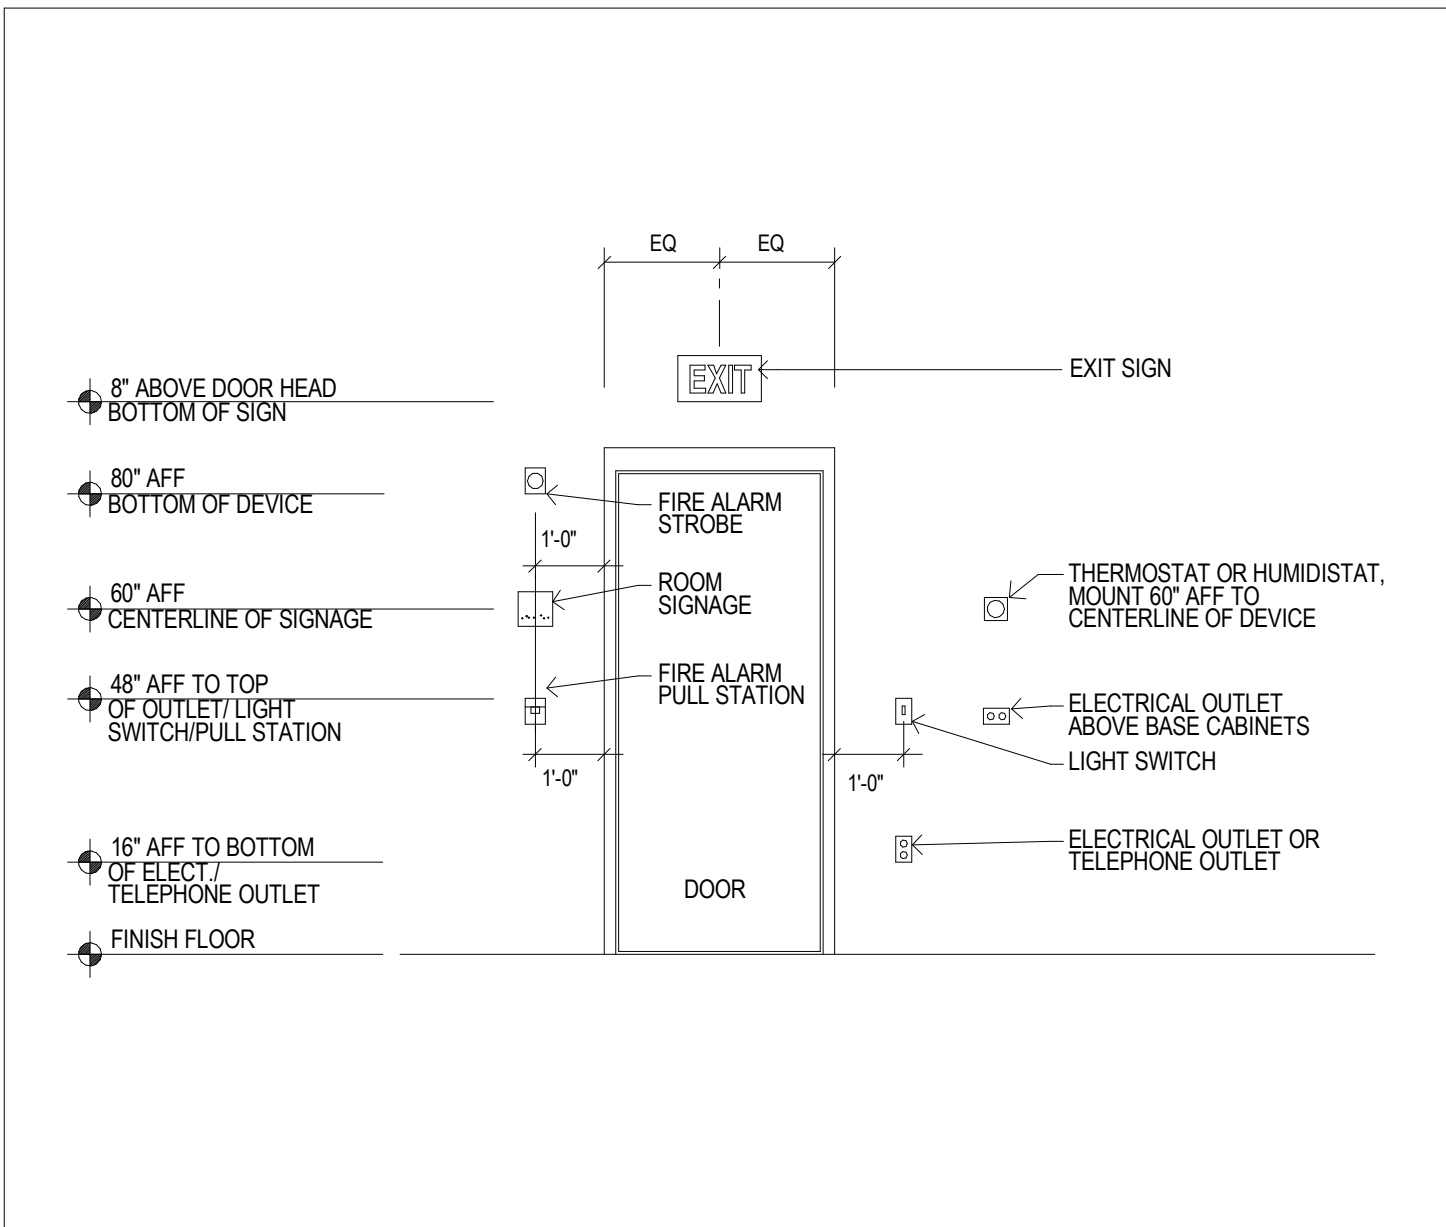


E TYPICAL DEVICE PLACEMENT

NTS

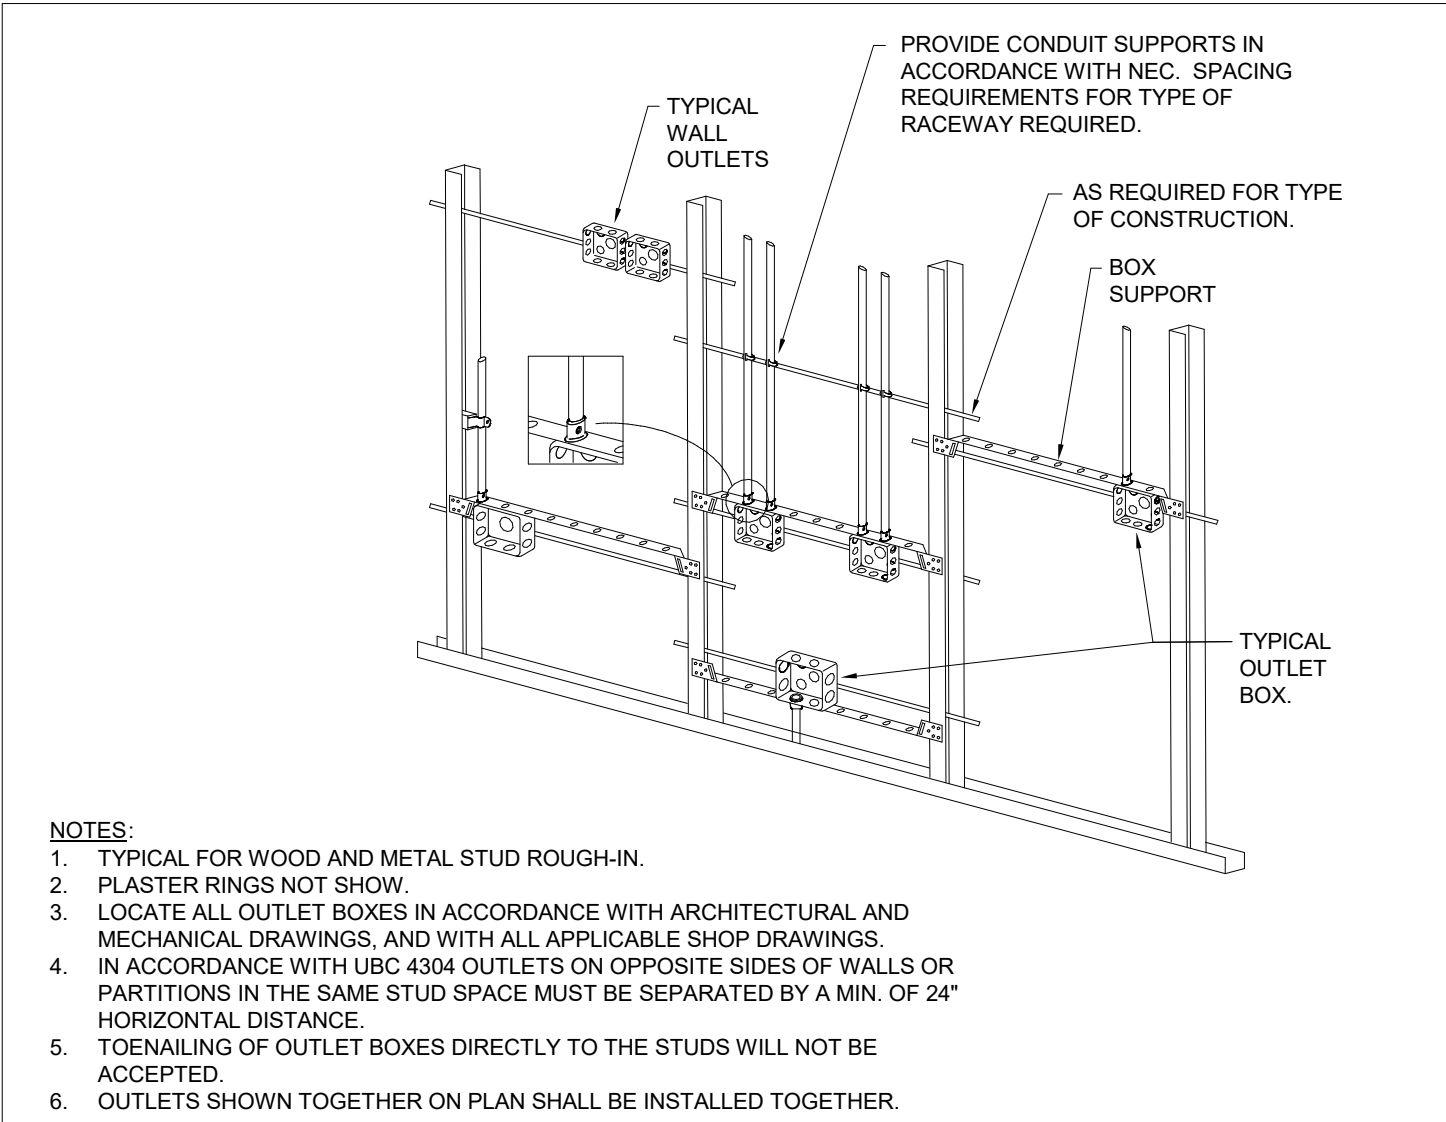


A TYPICAL ROUGH-IN

NTS

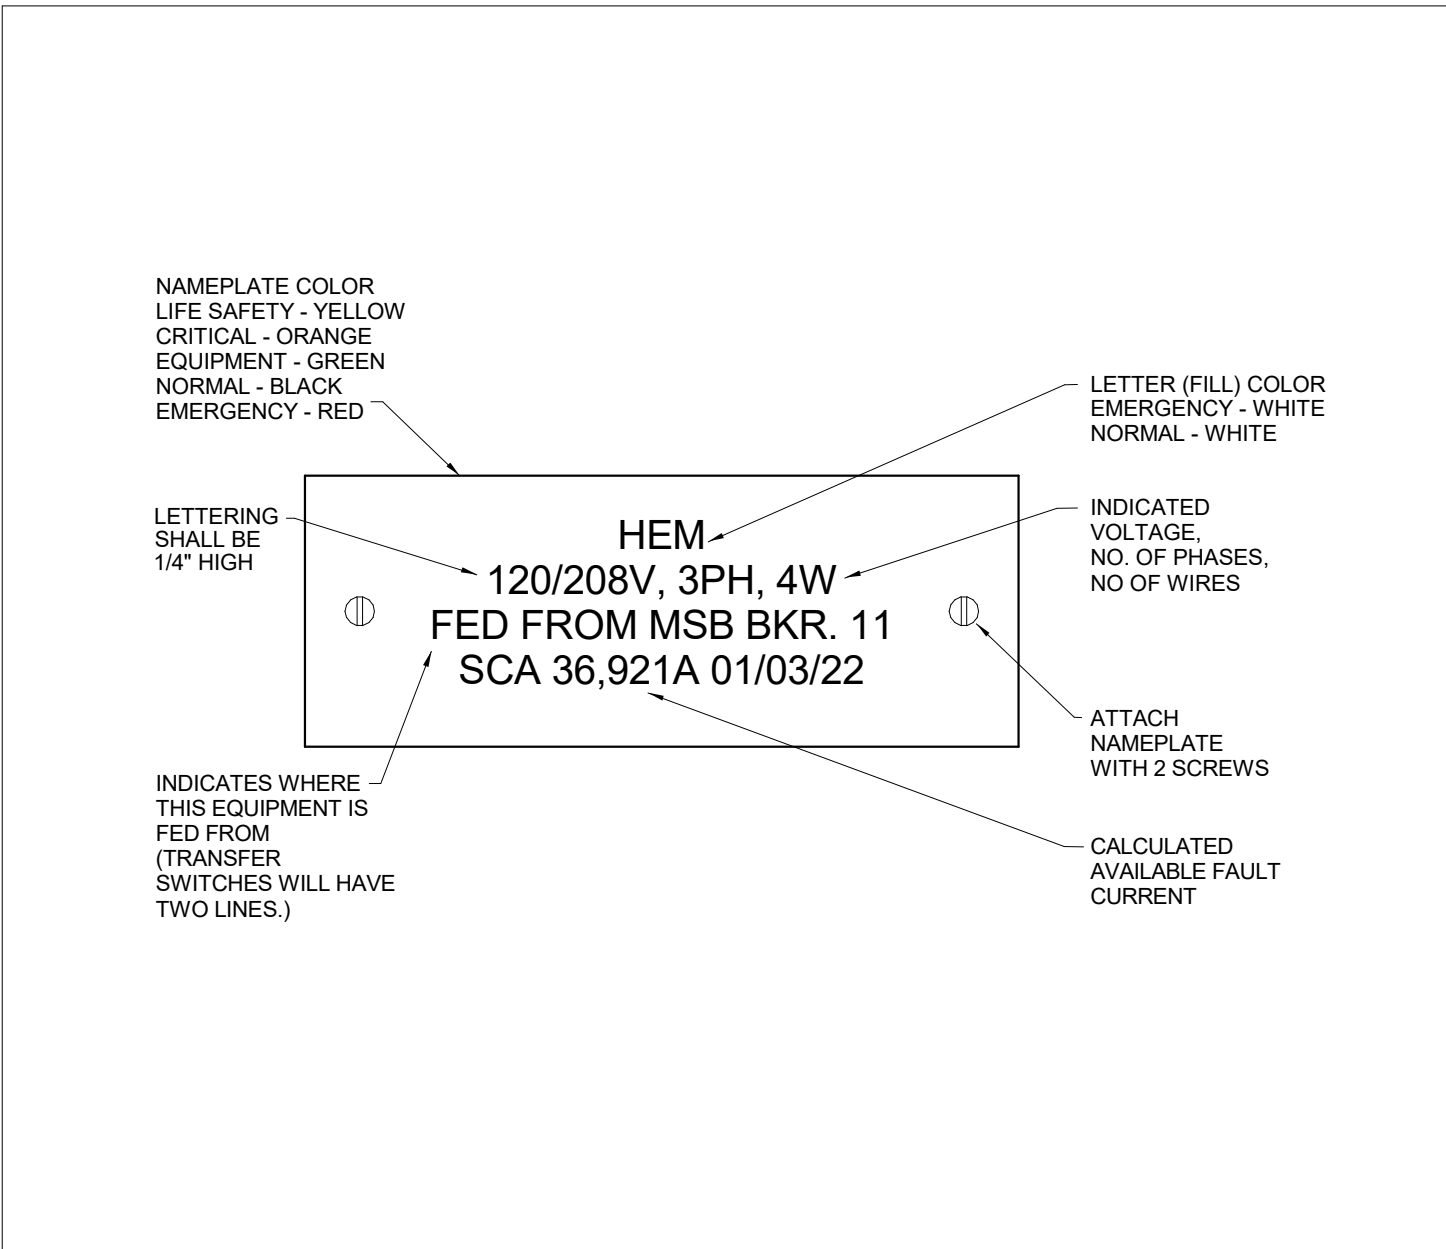

B ELECTRICAL EQUIPMENT NAMEPLATE

NTS

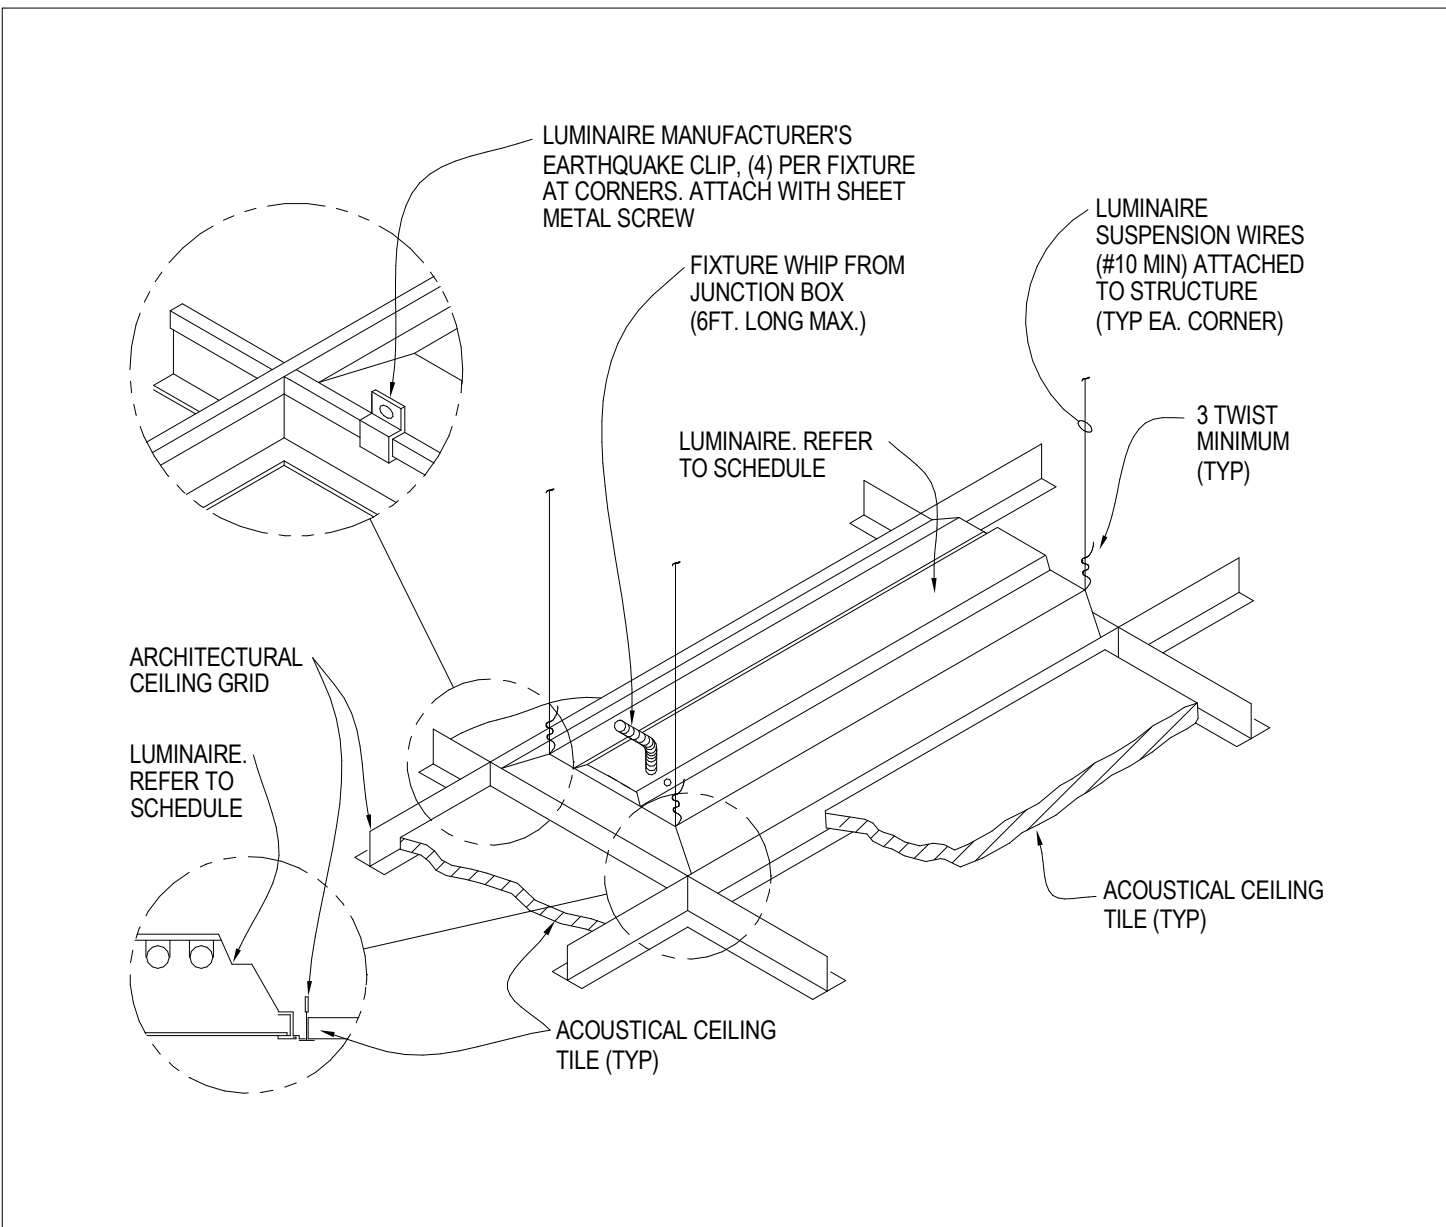

C TYPICAL ROUGH-IN

NTS


#	ISSUED FOR	DATE
	05 - JIA	05.20.24
	75% - JIA	07.26.24
	PERMIT/BID	08.20.24
	ADDENDUM #1	09.05.24

DRAWN BY: SLJB  
REVIEW BY: DK

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P 883.682.1082  
F 883.687.6346  
E: A064778

lunz.com

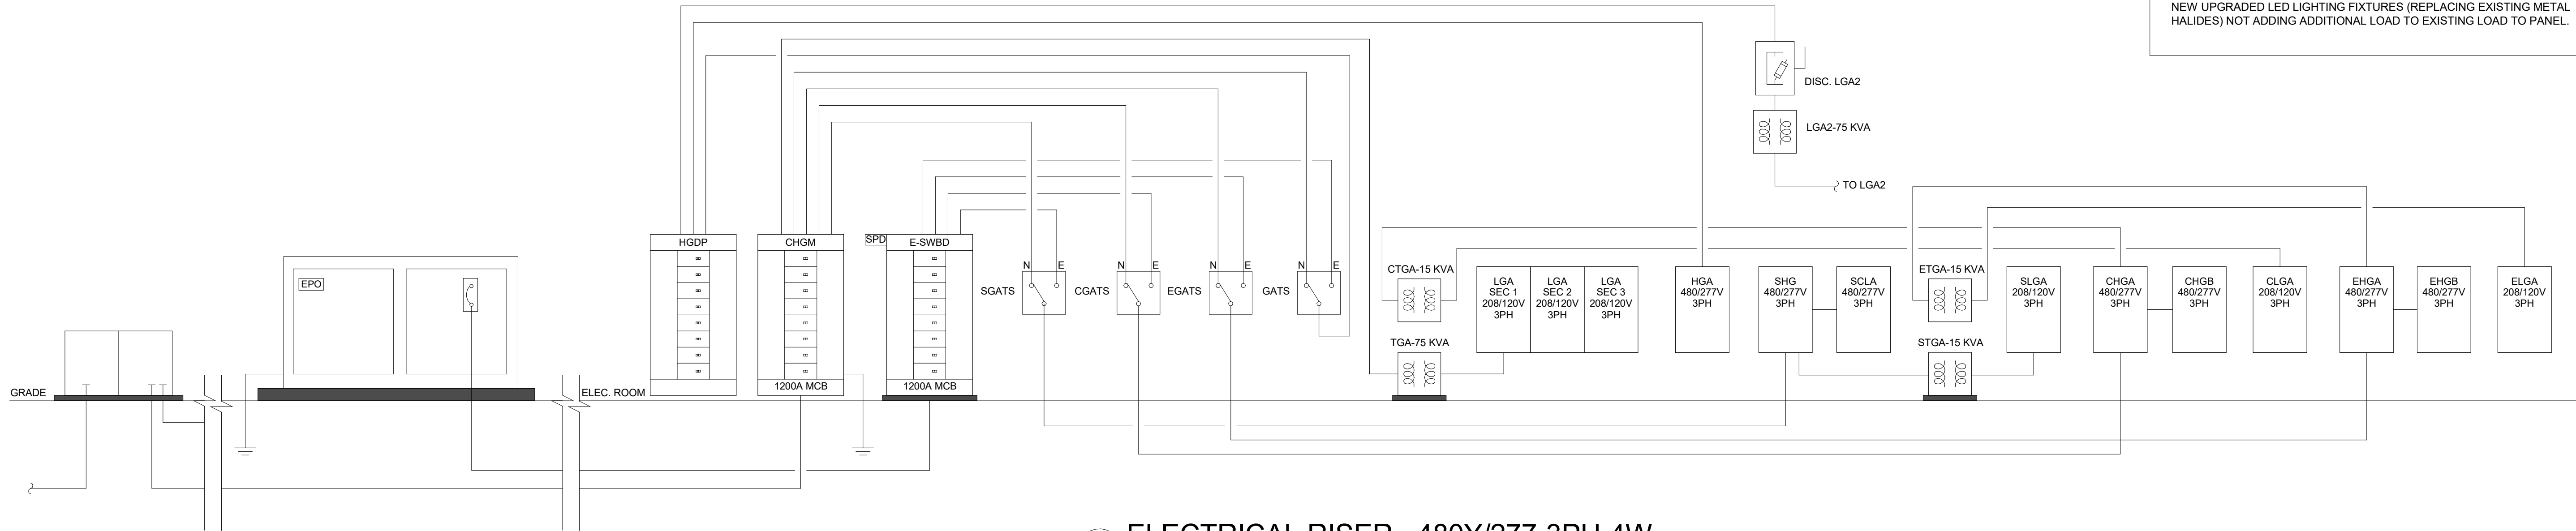

1 ELECTRICAL RISER - 480Y/277-3PH-4W  
FOR REFERENCE ONLY SCALE: NOT TO SCALE

### GENERAL NOTES

- A. EXISTING CONDITIONS ARE BASED ON RECORD DOCUMENTS AND FIELD OBSERVATIONS. NOTIFY ENGINEER OF ANY DISCREPANCIES BETWEEN THESE DRAWINGS AND EXISTING CONDITIONS PRIOR TO DISTURBING EXISTING INSTALLATION.
- B. RISER DIAGRAM SHOWN FOR REFERENCE ONLY. ALL EQUIPMENT AND DEVICES ARE EXISTING TO REMAIN.

### ESTIMATED DEMAND LOAD SUMMARY

RENOVATION SQUARE FOOTAGE = 9.8K SQ/FT  
EXISTING DEMAND LOAD LGA = 56 KVA

PROTECTED BY 225A MAIN CIRCUIT BREAKER FED FROM 75 KVA TRANSFORMER

EXISTING DEMAND REMOVED: 19.6 KVA  
NEW DEMAND ADDED: 25.8 kVA  
NEW TOTAL DEMAND LOAD:  
(56 KVA \* 1.25) - 19.6 KVA + 25.8 KVA = 77.2 KVA @ 208V-3PH = 214 A  
214 A < 225 A

PANEL LGA IS ADEQUATE TO HANDLE NEW LOAD.

NO NEW LOAD ADDED TO HGA.  
NEW UPGRADED LED LIGHTING FIXTURES (REPLACING EXISTING METAL HALIDES) NOT ADDING ADDITIONAL LOAD TO EXISTING LOAD TO PANEL.

### Branch Panel: LGA SEC. 1

Location: Space 5  
Supply From: SURFACE  
Mounting: NEMA 1  
Enclosure: NEMA 1

Volts: 208Y/120  
Phases: 3  
Wires: 4  
Ground Bus:

### EXISTING

A.I.C. Rating: EXISTING  
Mains Type: MCB  
Mains Rating: 225 A  
Bus Rating: 225 A  
GFP:

Notes:  
12-2: 12 AWG WIRE

CCT	Circuit Description	Rating	Poles	Options	Wire and Conduit...	A	B	C	A	B	C	Wire and Conduit...	Options	Poles	Rating	Circuit Description	CCT	
1	R-OFFICE 129, 131, 121	20 A	1		12-2	1260 VA			900 VA			12-2	1	20 A	1	R-OFFICE 122, 121	2	
3	R-SECURED CORRIDOR...	20 A	1		12-2		900 VA			540 VA		12-2	1	20 A	1	R-OPEN 141	4	
5	R-OFFICE 128, 127, 121	20 A	1		12-2			1260 VA			720 VA	12-2	1	20 A	1	R-OPEN 141	6	
7	R-NURSE OFFICE 160	20 A	1		12-2	20180...			1260 VA			12-2	1	20 A	1	R-OPEN 141	8	
9	R-NURSE OFF. 160...	20 A	1		12-2		500 VA			1080 VA		12-2	1	20 A	1	R-OPEN 141	10	
11	R-NURSE OFFICE 160	20 A	1		12-2			500 VA			540 VA	12-2	1	20 A	1	R-DEPUTY STATION 142	12	
13	R-OFFICE 126, 125, 121	20 A	1		12-2	1260 VA			360 VA			12-2	1	20 A	1	R-ROOF REC.	14	
15	R-OPEN OFFICE 121....	20 A	1	HT	12-2		500 VA			528 VA		12-2	1	20 A	1	EF-1	16	
17	R-OPEN OFFICE 121....	20 A	1	HT	12-2			500 VA			528 VA	12-2	1	20 A	1	EF-2	18	
19	R-OPEN OFFICE 121....	20 A	1	HT/IG	12-2	500 VA			1260 VA			12-2	1	20 A	1	R-OFFICE 130, 121	20	
21	R-OPEN OFFICE 121....	20 A	1	HT/IG	12-2		500 VA			500 VA		12-2	HT	1	20 A	1	R-OPEN OFFICE 121....	22
23	R-OPEN OFFICE 121....	20 A	1	HT	12-2			500 VA			500 VA	12-2	HT	1	20 A	1	R-OPEN OFFICE 121....	24
25	R-OPEN OFFICE 121....	20 A	1	HT	12-2	500 VA			500 VA			12-2	HT/IG	1	20 A	1	R-OPEN OFFICE 121....	26
27	R-OPEN OFFICE 121....	20 A	1	HT/IG	12-2		500 VA			500 VA		12-2	HT/IG	1	20 A	1	R-OPEN OFFICE 121....	28
29	R-OPEN OFFICE 121....	20 A	1	HT/IG	12-2			500 VA			0 VA		1	20 A	1	SPARE	30	
31	R-OFFICE 124, 121, 122	20 A	1		12-2	1080 VA			0 VA				1	20 A	1	SPARE	32	
33	SPARE	20 A	1				0 VA			0 VA			1	20 A	1	SPARE	34	
35	SPARE	20 A	1					0 VA			0 VA		1	20 A	1	SPARE	36	
37	SPARE	20 A	1			0 VA			0 VA				1	20 A	1	SPARE	38	
39	SPARE	20 A	1				0 VA			0 VA			1	20 A	1	SPARE	40	
41	SPARE	20 A	1					0 VA			0 VA		1	20 A	1	SPARE	42	

Load Classification	Connected Load	Demand Factor	Estimated Demand	Panel Totals
Motor	1056 VA	112.50%	1188 VA	
R	39600 VA	62.63%	24800 VA	
				Total Conn. Load: 40656 VA
				Total Est. Demand: 25988 VA
				Total Conn.: 112.8 A
				Total Est. Demand: 72.1 A

Notes:  
Motor = LARGEST MOTOR  
MN = MOTOR (NON-SEASONAL)  
L = LIGHTING (CONTINUOUS)  
R = RECEPTACLE  
C = CONTINUOUS  
IG = ISOLATED GROUND CIRCUIT  
VT = HAND TIE CIRCUIT BREAKERS

### Branch Panel: HGA

Location: Space 5  
Supply From: SURFACE  
Mounting: NEMA1  
Enclosure: NEMA1

Volts: 480Y/277  
Phases: 3  
Wires: 4  
Ground Bus:

### EXISTING

A.I.C. Rating: EXISTING  
Mains Type: MLO  
Mains Rating: 400 A  
Bus Rating: 400 A  
GFP:

Notes:  
12-2: 12 AWG WIRE

CCT	Circuit Description	Rating	Poles	Options	Wire and Conduit...	A	B	C	A	B	C	Wire and Conduit...	Options	Poles	Rating	Circuit Description	CCT
1						0 VA			0 VA								2
3	EXISTING	90 A	3				0 VA			0 VA				3	20 A	A - D - EDH-16-1D	4
5								0 VA			0 VA						6
7						0 VA			648 VA								8
9	EXISTING	90 A	3				0 VA			1500 VA		12-2	1	20 A	1	LITES ISO. CELL 140	10
11								0 VA			356 VA	12-2	1	20 A	1	LITES OFFICE 128	12
13	LIGHTING - 168	20 A	1			0 VA			311 VA			12-2	1	20 A	1	LITES	14
15							0 VA		0 VA		0 VA						16
17	EXISTING	100 A	3				0 VA		0 VA		0 VA			3	30 A	B - C - EDH-2C	18
19						0 VA			0 VA		0 VA						20
21							0 VA		0 VA		0 VA						22
23	B - A - EDH-2A	20 A	3				0 VA		0 VA		0 VA			3	30 A	B - D - EDH-2D	24
25						0 VA			0 VA								26
27							0 VA			0 VA							28
29	B - B - EDH-2B	30 A	3				0 VA		0 VA		0 VA			3	30 A	A - A - EDH-1A	30
31						0 VA			0 VA								32
33							0 VA			0 VA							34
35	A - C - EDH-1C	40 A	3					0 VA		0 VA	0 VA			3	30 A	A - B - EDH-1B	36
37						0 VA			0 VA								38
39	SPACE	--	1			--				0 VA				1	20 A	SPARE	40
41	SPACE	--	1				--				--			1	--	SPACE	42
						950 VA			1500 VA		356 VA						
						3.8 A			5.7 A		1.3 A						

Load Classification	Connected Load	Demand Factor	Estimated Demand	Panel Totals
Lighting	0 VA	0.00%	0 VA	
LITES	2814 VA	125.00%	3517 VA	
				Total Conn. Load: 2814 VA
				Total Est. Demand: 3517 VA
				Total Conn.: 3.4 A
				Total Est. Demand: 4.2 A

Notes:  
Motor = LARGEST MOTOR  
MN = MOTOR (NON-SEASONAL)  
L = LIGHTING (CONTINUOUS)  
R = RECEPTACLE  
C = CONTINUOUS  
PN = POWER NON-SEASONAL (NON-CONTINUOUS)  
VT = VERTICAL TRANSPORTATION

THE  
LUNZ  
GROUP

MES  
GROUP

550 North Reo Street  
Suite 203, Tampa, FL  
33609  
813.289.4700  
COA # 8304

HCSO MENTAL HEALTH CLINIC

2310 N. FALKENBURG ROAD  
TAMPA, FLORIDA 33619

ELECTRICAL RISER AND SCHEDULES

#	ISSUED FOR	DATE
	DIS - JIA	06.26.24
	75% - JIA	07.26.24
	PERMIT/BID	08.26.24
	ADDENDUM #1	09.26.24

DRAWN BY: SLJB  
REVIEW BY: DK

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P: 883.682.1882  
F: 883.687.6346  
E: ALISA@LUNZ.COM

lunz.com

24001.01

E-601



GENERAL NOTES	
1.	THESE DRAWINGS ARE DIAGRAMMATIC IN NATURE AND INDICATIVE OF WORK TO BE PROVIDED (FURNISHED AND INSTALLED) UNDER THIS CONTRACT. DRAWINGS SHOULD NOT BE SCALED.
2.	THE CONTRACTOR IS RESPONSIBLE TO EXAMINE THE EXISTING CONDITIONS UNDER WHICH THEY SHALL OPERATE AND VERIFY THE EXTENT OF WORK REQUIRED TO COMPLETE THE WORK UNDER THIS CONTRACT.
3.	PRIOR TO ORDERING AND FABRICATING ANY EQUIPMENT, IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO EXAMINE THE PHYSICAL CONDITIONS AT THE PROJECT SITE AND VERIFY SPACE AND SUFFICIENT CLEARANCES ARE AVAILABLE FOR INSTALLING EQUIPMENT, DUCTWORK, PIPING, AND APPURTENANCES, AND TO DETERMINE ANY NECESSARY MODIFICATIONS.
4.	PERFORM ALL WORK IN COMPLIANCE WITH ALL APPLICABLE FEDERAL, STATE, AND LOCAL CODES, REGULATIONS, AND STANDARDS ADOPTED BY THE AUTHORITY HAVING JURISDICTION. IF CONFLICTS EXIST BETWEEN THESE ENGINEERING DOCUMENTS AND CODES, THE MOST STRINGENT REQUIREMENTS SHALL GOVERN.
5.	ALL CONSTRUCTION WORK SHALL ALSO MEET THE FOLLOWING CODE REQUIREMENTS: <ul style="list-style-type: none"><li>FLORIDA BUILDING CODE (FBC) 2023</li><li>FLORIDA EXISTING BUILDING CODE 2023</li><li>FBC MECHANICAL 2023</li><li>FBC PLUMBING 2023</li><li>FBC ENERGY CONSERVATION 2023</li><li>FLORIDA FIRE PREVENTION CODE 2023</li><li>NFPA 1-2021, THE UNIFORM FIRE CODE</li><li>NFPA 101-2021, THE LIFE SAFETY CODE</li><li>NFPA 51B-2019, STANDARD FOR FIRE PREVENTION DURING WELDING, CUTTING AND OTHER HOT WORK</li><li>NFPA 13-2019, STANDARD FOR THE INSTALLATION OF SPRINKLER SYSTEMS</li><li>NFPA 70-2020, NATIONAL ELECTRICAL CODE</li><li>NFPA 90A-2021, STANDARD FOR THE INSTALLATION OF AIR CONDITIONING AND VENTING SYSTEMS</li><li>NFPA 241-2019, STANDARD FOR SAFEGUARDING CONSTRUCTION, ALTERATION AND DEMOLITION OPERATIONS.</li></ul>
6.	CONTRACTOR SHALL COORDINATE AND SEQUENCE DEMOLITION, CLEANING, AND CONSTRUCTION WORK.
7.	CONTRACTOR SHALL NOTE ANY SPECIAL REQUIREMENTS FOR INSTALLATION OF WORK UNDER THIS CONTRACT. DISMANTLE AND REASSEMBLE EQUIPMENT AS NECESSARY FOR ENTRY INTO THE BUILDING AND THE LOCATION OF INSTALLATION.
8.	THE CONTRACTOR SHALL MAINTAIN A COMPLETE PROJECT SCHEDULE AND SHALL UPDATE THIS SCHEDULE WEEKLY. ANY CHANGES SHALL BE NOTED AND AN UPDATED SCHEDULE SHALL BE PROVIDED TO THE OWNER.
9.	ALL PERMITS, FEES, TAXES, ETC SHALL BE PAID BY CONTRACTOR AS PART OF THE TOTAL PROJECT COST.
10.	MAINTAIN THE INTEGRITY OF ALL FIRE AND SMOKE RATED WALLS, PARTITIONS, CEILINGS, AND FLOORS. SEAL ALL PENETRATIONS THROUGH RATED ASSEMBLIES WITH FIRESTOP MATERIAL IN ACCORDANCE WITH U.L. REQUIREMENTS TO MAINTAIN THE ASSEMBLY RATING.
11.	CONTRACTOR SHALL FURNISH U.L. APPROVED DRAWINGS FOR EACH TYPE OF FIRE AND SMOKE RATED ASSEMBLY PENETRATED BY DUCTS, PIPES, OR CONDUITS, AND SHALL DISPLAY THESE DRAWINGS ON THE JOB SITE AT ALL TIMES DURING CONSTRUCTION.
12.	CONTRACTOR SHALL REFER TO ALL DETAILS FOR PROPER GUIDANCE.
13.	THE CONTRACTOR SHALL SUBMIT SHOP DRAWINGS AND EQUIPMENT SUBMITTALS FOR ALL PRODUCTS USED ON PROJECT.
14.	THE ENGINEER'S APPROVAL OF SUBMITTAL DATA SHALL NOT RELIEVE THE CONTRACTOR OF RESPONSIBILITY FOR DEVIATIONS FROM THE REQUIREMENTS OF CONTRACT DOCUMENTS UNLESS THE CONTRACTOR HAS RECEIVED WRITTEN APPROVAL FROM THE ENGINEER TO THE SPECIFIC DEVIATION. THE ENGINEER'S APPROVAL OF SUBMITTAL DATA SHALL NOT RELIEVE THE CONTRACTOR OF RESPONSIBILITY FOR ERRORS OR OMISSIONS IN HIS OR HER SUBMITTAL DATA.
15.	THE CONTRACTOR IS REQUIRED TO SUBMIT THREE COMPLETE O&M MANUALS IN THREE RING BINDERS AT SUBSTANTIAL COMPLETION. MANUALS SHALL INCLUDE INSTALLATION AND MAINTENANCE DATA ON ALL NEW EQUIPMENT AND MATERIALS, CERTIFIED TECHNICAL PRODUCT DATA, EQUIPMENT SHOP DRAWINGS, SPARE PARTS DATA, ETC. PROVIDE AN INDEX AND ASSOCIATED DIVIDERS.
16.	CLOSE OUT DOCUMENTS: THE CONTRACTOR IS TO MAINTAIN ONE SET OF CONSTRUCTION DRAWINGS ON SITE AND KEEP CURRENT WITH MARK UP AS-BUILT CONDITIONS DURING CONSTRUCTION OF THE PROJECT. THIS SET IS TO INCLUDE ALL CONTRACT CHANGES, MODIFICATIONS AND CLARIFICATIONS. THIS SET ALONG WITH ALL SHOP DRAWINGS SHALL BE TURNED OVER TO THE ARCHITECT/ENGINEER AFTER CONSTRUCTION COMPLETION.
17.	IT IS THE RESPONSIBILITY OF ALL BIDDERS TO THOROUGHLY REVIEW AND UNDERSTAND ALL CONSTRUCTION DOCUMENTS. THIS INCLUDES BUT IS NOT LIMITED TO ALL DRAWINGS, SPECIFICATION SECTIONS, ETC. THE DRAWINGS ARE SCHEMATIC IN NATURE. THEREFORE BEFORE STARTING ANY WORK, THE CONTRACTOR SHALL REVIEW ALL OTHER CONSTRUCTION DOCUMENTS, VERIFY FIELD CONDITIONS AND SHALL MAKE ANY REQUIRED MINOR ADJUSTMENTS WITHOUT EXTRA COST TO THE OWNER. ANY MAJOR DISCREPANCIES FOUND SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT/ENGINEER. THE BASE BID SHALL REFLECT THE TOTAL COST OF NEW EQUIPMENT INSTALLATION. THIS INCLUDES LABOR, EQUIPMENT AND MATERIALS. NO CHANGE ORDERS SHALL BE ISSUED WITHOUT WRITTEN CONSENT AND APPROVAL FROM ENGINEER AND ARCHITECT.

PLUMBING SHEET LIST - JIA	
Sheet Number	Sheet Name
P001A	PLUMBING NOTES, LEGENDS, & SCHEDULES - JIA
PD101A	PLUMBING DEMOLITION PLAN - SANITARY AND VENT - JIA
PD201A	PLUMBING DEMOLITION PLAN - DOMESTIC WATER - JIA
P101A	PLUMBING RENOVATION PLAN - SANITARY AND VENT - JIA
P201A	PLUMBING RENOVATION PLAN - DOMESTIC WATER - JIA
P401A	PLUMBING RENOVATION - ENLARGED PLANS - JIA
P501A	PLUMBING DETAILS - JIA
P901A	SANITARY & VENT ISOMETRIC - JIA
P902A	DOMESTIC WATER ISOMETRIC - JIA

DRAWN BY: JTD  
REVIEW BY: NPS

THE LUNZ GROUP  
©/COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
888.682.1082  
786.887.6346  
E: ALUNA@LUNZ.COM

lunz.com

24001.01

P001A

GENERAL MECHANICAL SYMBOLS	
	REVISION NUMBER - SHOWN ON PLANS
	POINT WHERE NEW CONNECTS TO EXISTING
	LIMIT OF DEMOLITION
	KEYNOTE
	CONTINUATION SYMBOL
	ROOM NAME AND NUMBER
	ITEM TO BE DEMOLISHED
	AREA NOT IN CONTRACT
	PIPE SIZE TAG (DIAMETER)
	ABOVE GROUND PIPING
	PIPE SLOPE TAG
	BELOW GROUND PIPING
	PIPE INVERT ELEVATION TAG
	EXISTING PIPE TAG
	PIPING BEING DEMOLISHED

ABBREVIATIONS			
ABV	ABOVE	NIC	NOT IN CONTRACT
AAV	AIR ADMITTANCE VALVE	NO	NUMBER
AD	AREA DRAIN	NTS	NOT TO SCALE
AFF	ABOVE FINISHED FLOOR	PD	PRESSURE DROP
BFF	BELOW FINISHED FLOOR	PLBG	PLUMBING
BLW	BELOW	PRESS	PRESSURE
CLG	CEILING	PRV	PRESSURE REDUCING VALVE
CO	CLEAN OUT	PSI	POUNDS PER SQUARE INCH
CW	COLD WATER	RD	ROOF DRAIN
D	DEGREE	RED	REDUCER
DN	DOWN	SF	SQUARE FOOT
DOM.	DOMESTIC	SAN	SANITARY
ET	EXPANSION TANK	SP	STATIC PRESSURE
EWC	ELECTRIC WATER COOLER	TEMP	TEMPERATURE
EWT	ENTERING WATER TEMPERATURE	TYP	TYPICAL
EXIST	EXISTING	V	VENT
F	FAHRENHEIT	VTR	VENT THROUGH ROOF
FCO	FLOOR CLEAN OUT	WCO	WALL CLEAN OUT
FD	FLOOR DRAIN	WH	WALL HYDRANT
FL	FLOOR		
FS	FLOOR SINK		
FT	FOOT/FEET		
GPM	GALLONS PER MINUTE		
GW	GAS WATER HEATER		
HB	HOSE BIBB		
HW	HOT WATER		
IN	INCH		
LWT	LEAVING WATER TEMPERATURE		

PLUMBING AND PIPING SYMBOLS	
	DOMESTIC COLD WATER
	DOMESTIC HOT WATER
	HOT WATER RECIRCULATION
	SANITARY VENT
	SANITARY SEWER
	PIPE DROP
	PIPE RISE
	PIPE TEE
	CAP
	PLUG
	REDUCING 45 DEGREE TEE
	45 DEGREE TEE
PIPE ACCESSORY TAGS	
	2" DOM. WM
	GLOBE VALVE
	2" BALANCING VALVE
	2" BUTTERFLY VALVE
	2" SHUT-OFF VALVE
	1/4 TURN BALL VALVE
	2" CHECK VALVE
	2" TMV
	3-WAY MIXING VALVE
	GATE VALVE
	TEMP PRESSURE RELIEF VALVE
	ANGLE HOSE VALVE
DRAIN TAGS	
	4" FD-1
	4" AD-6
	4" FD-3P
	4" FS-4
	4" FD-13
	6 DFU
PLUMBING FIXTURE TAGS	
	WC-1A
	WC-1
	LAV-1A
	U-1
	0.75 CWFU
	0.75 HWFU
	4" WCO
*NOTE*	
ALL OF GENERAL NOTES ON THIS SHEET ARE TO BE APPLIED TO ALL OTHER DRAWINGS IN THIS SET. THE SYMBOLS AND ABBREVIATIONS SHOWN ON THIS SHEET MAY OR MAY NOT BE USED IN THIS SET OF DRAWINGS.	


PLUMBING NOTES	
1.	ALL WORK SHALL COMPLY WITH APPLICABLE NATIONAL, STATE, AND LOCAL CODES. THIS SHALL INCLUDE, BUT NOT BE LIMITED TO, THE 2023 FLORIDA PLUMBING CODE, WHERE CONFLICTS OCCUR BETWEEN CODES, OR BETWEEN CONSTRUCTION DOCUMENTS AND CODES, THE MOST RESTRICTIVE REQUIREMENTS SHALL GOVERN.
2.	REVIEW PLANS OF ALL TRADES PRIOR TO BIDDING AND BEGINNING WORK. INSTALLATIONS SHALL INCLUDE ALL PLUMBING FOR COMPLETE SYSTEMS SHOWN ON THE PLANS AND AS REQUIRED.
3.	COORDINATE WITH OTHER TRADES TO PREVENT INTERFERENCE WITH HVAC DUCTS, STRUCTURE, ELECTRICAL, LIGHTING, AND OTHER PIPING IN THE CEILING SPACE. VENT PIPING AND WATER PIPING SHALL BE HELD EITHER ABOVE OR BELOW HVAC DUCTWORK, AS COORDINATED WITH THE HVAC CONTRACTOR.
4.	ALL CHANGES SHALL BE REVIEWED BY THE ARCHITECT.
5.	COORDINATE WITH ARCHITECTURAL DRAWINGS BEFORE ROUGHING-IN PLUMBING FIXTURES AND EQUIPMENT SUPPLIES.
6.	THE PLUMBING SUBCONTRACTOR SHALL FURNISH AND INSTALL ALL PLUMBING FIXTURES, UNLESS NOTED OTHERWISE.
7.	VERIFY MOUNTING HEIGHT AND WATER CONNECTION SIZES OF ALL PLUMBING FIXTURES PRIOR TO ROUGH-IN. FURNISH CUT-OUT TEMPLATES, FOR PLUMBING FIXTURES TO BE INSTALLED IN MILLWORK, TO THE GENERAL CONTRACTOR.
8.	MAKE PROPER HOT AND COLD WATER, WASTE AND VENT PIPING CONNECTIONS TO ALL FIXTURES AND EQUIPMENT EVEN THOUGH ALL FITTINGS AND CONNECTIONS ARE NOT SHOWN ON DRAWINGS.
9.	VERIFY LOCATION OF WATER SERVICE AND THE LOCATION/INVERTS OF SANITARY PIPING PRIOR TO INSTALLATION.
10.	CUT AND PATCH CONCRETE AS REQUIRED.
11.	IT IS NOT THE INTENT OF THESE DRAWINGS TO COVER ALL WORK AND MATERIAL. ANY EQUIPMENT, PLUMBING FIXTURE, TRIM HARDWARE AND/OR DEVICES USUALLY UTILIZED IN THE CLASS OF WORK, THOUGH NOT SPECIFICALLY MENTIONED OR SHOWN ON THESE DRAWINGS, BUT WHICH MAY BE NECESSARY FOR THE SATISFACTORY COMPLETION OF THE WORK (AS DETERMINED BY THE ARCHITECT) SHALL BE FURNISHED AND INSTALLED BY THE CONTRACTOR AS PART OF HIS TOTAL WORK.
12.	THE EQUIPMENT ROUGH-IN ITEMS AND THEIR DIMENSIONED LOCATIONS FOR ALL CONNECTIONS ARE ACCURATE TO THE BEST OF OUR KNOWLEDGE. IN SOME INSTANCES THE OWNER OR SUPPLIER MAY MAKE SUBSTITUTIONS OR EQUIPMENT ITEMS MAY VARY FROM WHAT IS SHOWN. THEREFORE, THESE ITEMS AND DIMENSIONS SHALL BE VERIFIED WITH THE EQUIPMENT SUPPLIER, OWNER AND/OR EQUIPMENT ROUGH-IN DRAWING. FAILURE OF THE APPROPRIATE CONTRACTOR TO VERIFY ROUGH-INS OR THEIR LOCATIONS SHALL PLACE THE RESPONSIBILITY FOR ANY SUBSEQUENT RELOCATION AND/OR ADDITIONAL ROUGH-INS DIRECTLY UPON THAT CONTRACTOR.
13.	CONTRACTOR SHALL SUPPLY TO THE ARCHITECT/ENGINEER THE REQUIRED COPIES OF SHOP DRAWINGS FOR APPROVAL SO THE QUALITY OF INTENDED MATERIALS OR EQUIPMENT CAN BE REVIEWED BEFORE INSTALLATION. THERE WILL BE NO INSTALLATION UNTIL SHOP DRAWINGS HAVE BEEN SUBMITTED AND REVIEWED BY THE ARCHITECT/ENGINEER.
14.	DO NOT SCALE THIS DRAWING. REFER TO ARCHITECTURAL FLOOR PLAN FOR BUILDING DIMENSIONS.
15.	THESE DRAWINGS ARE DIAGRAMMATIC IN NATURE AND DESIGNED AROUND BASIS OF DESIGN PRODUCTS WHICH HAVE ESTABLISHED THE PERFORMANCE CRITERIA FOR THIS PROJECT. PRODUCTS SUBMITTED BY THE CONTRACTOR MAY BE ARRANGED DIFFERENTLY AND THE PRODUCTION OF CONTRACTOR COORDINATED DRAWINGS IS REQUIRED TO BE SUBMITTED PRIOR TO THE START OF CONSTRUCTION. THESE DIAGRAMMATIC DRAWINGS DO NOT NECESSARILY SHOW ALL ELBOWS, OFFSETS, UNIONS, VALVES, FITTINGS, AND ACCESSORIES REQUIRED TO COMPLETE THE INSTALLATION OF WORK. THE SUBMISSION OF A PROPOSAL SHALL BE CONSTRUED AS EVIDENCE THAT THE CONTRACTOR HAS FAMILIARIZED THEMSELVES WITH THE PLANS AND BUILDING SITE. CLAIMS MADE SUBSEQUENT TO THE PROPOSAL FOR MATERIALS AND LABOR BECAUSE OF DIFFICULTIES ENCOUNTERED WILL NOT BE RECOGNIZED IF THEY COULD HAVE BEEN FORESEEN HAD PROPER EXAMINATION BEEN MADE.
16.	VERIFY SERVICE POINTS AND METERING LOCATIONS FOR PROJECTS WITH LOCAL UTILITIES AND/OR LANDLORD (DOMESTIC WATER, SANITARY SEWER, GAS, ETC.).
17.	THE CONTRACTOR SHALL COOPERATE FULLY AMONG ALL TRADES.
18.	ALL ROOF PENETRATIONS FOR ROOF DRAINS AND PLUMBING SHALL BE MADE IN ACCORDANCE WITH ROOF SYSTEM MANUFACTURER'S GUIDELINES. COORDINATE WITH ARCHITECTURAL DETAILS AND/OR MANUFACTURER FOR ROOF SYSTEM USED.
19.	ALL PLUMBING VENTS IN EXTERIOR WALLS SHALL BE OFFSET A MINIMUM OF 3'-0" BEFORE ROOF PENETRATION.
20.	INSTALL 1" INSULATION WITH ALL-SERVICE JACKET ON ALL ROOF LEADERS ABOVE CEILING.
21.	INSTALL PLENUM RATED INSULATION WRAP ON ALL PLASTIC VENT, SANITARY AND STORM PIPING LOCATED WITHIN A RETURN AIR PLENUM.
22.	PLUMBING CONTRACTOR SHALL VERIFY WITH THE LOCAL HEALTH DEPARTMENT AND/OR WATER COMPANY AS TO THE METER AND VALVING ARRANGEMENTS OF THE DOMESTIC WATER LINE WHICH ENTERS THE BUILDING. SHOULD A BACKFLOW PREVENTER ASSEMBLY AND/OR PRESSURE REDUCING VALVE ASSEMBLY BE REQUIRED, PLUMBING CONTRACTOR SHALL FURNISH AND INSTALL AS REQUIRED PER LOCAL AND STATE REQUIREMENTS. THE BACKFLOW ASSEMBLY SHALL BE A "WATTS" SERIES #9089 OR APPROVED EQUAL, MEETING ASSE STANDARDS 1013, 1015, & 1020. IF BACKFLOW PREVENTER IS REQUIRED, PROVIDE PROPERLY SIZED THERMAL EXPANSION TANK IN SUPPLY PIPING OF WATER HEATER. IF WATER PRESSURE IS 65 PSI OR ABOVE, THE PRESSURE REDUCING VALVE ASSEMBLY SHALL BE A "WATTS" SERIES #U5 SET AT 50 PSI DELIVERY PRESSURE, UNLESS OTHERWISE NOTED.
23.	THE POTABLE WATER SUPPLY SHALL BE PROTECTED AGAINST BACKFLOW AND SIPHONAGE, BOTH NATURAL AND INDUCED. ALL EQUIPMENT CONNECTED TO THE POTABLE WATER SYSTEM BEING CAPABLE OF POLLUTING OR CONTAMINATING THE POTABLE WATER DISTRIBUTION SYSTEM OR ANY PART THEREOF BY MEANS OF A REVERSAL OF FLOW, PRESSURE DROP, PRESSURE LOSS, INDUCED VACUUM, OR BY INJECTION BECAUSE OF ANY PRIMARY OR AUXILIARY PUMPING SYSTEM CONNECTED, MUST BE ISOLATED AND CONTAINED BY MEANS OF APPROVED BACKFLOW DEVICES, CHECK VALVES, AIR GAPS, OR VACUUM BREAKERS. PLUMBING CONTRACTOR SHALL FURNISH AND INSTALL THESE DEVICES PER LOCAL CODE REQUIREMENTS.
24.	THE WATER PIPING SYSTEM SHALL BE FLUSHED AND STERILIZED IN ACCORDANCE WITH LOCAL REGULATIONS.
25.	HOT AND COLD WATER SUPPLY BRANCHES FOR ALL SYSTEMS HAVING QUICK CLOSING VALVES OF ANY TYPE SHALL HAVE WATER HAMMER ARRESTORS INSTALLED AT THE HIGH POINT ON THE END OF EACH BRANCH AND AS REQUIRED.
26.	ALL PIPES HANGING FROM SINGLE VERTICAL RODS / HANGERS SHALL NOT MOVE OR SWAY DURING OPERATION. SUITABLE LATERAL SUPPORTS OR BRACING SHALL BE USED TO PREVENT SWAY OR MOVEMENT.
27.	PROVIDE SHUT-OFF BALL VALVES AND DIELECTRIC UNIONS FOR ALL EQUIPMENT HOT AND COLD WATER LINES. PLUMBING CONTRACTOR SHALL MAKE ALL FINAL CONNECTIONS TO EQUIPMENT. COORDINATE WITH EQUIPMENT SUPPLIER FOR EXACT REQUIREMENTS.

PLUMBING NOTES	
28.	VERIFY MOUNTING HEIGHTS OF ALL BARRIER FREE FIXTURES WITH ARCHITECTURAL PLANS.
29.	PROVIDE COPPER INDIRECT WASTE PIPING REQUIRED FROM EQUIPMENT TO FLOOR DRAINS, OPEN RECEPTACLES, OR FLOOR SINKS. PIPING SHALL COMPLY WITH STATE AND LOCAL CODES. COORDINATE WITH ALL EQUIPMENT SUPPLIERS AND SIZES AS REQUIRED BY PIECE OF EQUIPMENT SERVED. HOLD PIPING TIGHT TO WALL WHERE APPLICABLE. PROPERLY SECURE AS REQUIRED. COORDINATE WITH CASEWORK SUPPLIER FOR MAXIMUM CLEARANCE UNDER CABINETS.
30.	PROVIDE CHROME PLATED ESCUTCHEONS AT ALL WALL PENETRATIONS.
31.	INSTALL STORM AND CONDENSATE PIPING WITH A MINIMUM SLOPE OF 1/8" PER FOOT UNLESS OTHERWISE REQUIRED. CONTRACTOR IS RESPONSIBLE FOR PROPER DRAINAGE OF ALL SYSTEMS.
32.	INSTALL SANITARY PIPING LESS THAN 3" WITH A MINIMUM SLOPE OF 1/4" PER FOOT. 3" TO 6" WITH A MINIMUM SLOPE OF 1/8" PER FOOT. GREATER THAN 6" WITH A MINIMUM SLOPE OF 1/16" PER FOOT. CONTRACTOR IS RESPONSIBLE FOR PROPER DRAINAGE OF ALL SYSTEMS.
33.	ALL FLOOR DRAINS ARE TO BE PROVIDED WITH MINIMUM 3" DRAIN LINES, DEEP SEAL TRAPS, AND AUTOMATIC TRAP PRIMERS. TRAP PRIMERS SHALL BE LOCATED IN A SERVICEABLE LOCATION AND INSTALLED PER MANUFACTURER'S INSTALLATION INSTRUCTIONS. HOLD TOP OF FLOOR DRAINS FLUSH WITH FINISHED FLOOR; SEE ARCHITECTURAL SHEETS FOR FLOOR SLOPES AND PROPER FINISHED FLOOR ELEVATION.
34.	ALL VENT PIPE TO BE COMPATIBLE WITH STRUCTURE, MECHANICAL EQUIPMENT, DUCTWORK, ELECTRICAL EQUIPMENT, AND LIGHTING. ALL VTR'S SHALL BE EXTENDED TO A MINIMUM OF 2" ABOVE PARAPET HEIGHT AND MAINTAINED 10'-0" MINIMUM FROM ALL OUTSIDE AIR INTAKES.
35.	MATERIALS, EQUIPMENT, ASSEMBLIES AND SYSTEMS SHALL MEET ALL PERTINENT REQUIREMENTS OF NATIONALLY RECOGNIZED TESTING ORGANIZATIONS SUCH AS UL, ASTM, ASSE, AWWE, AGA AND NFPA AS WELL AS THE MOST CURRENT ADOPTED VERSION OF THE STATE AND LOCAL CODES.
36.	ALL INSTALLED SYSTEMS, DEVICES AND RELATED ITEMS SHALL BE TESTED IN PLACE. REPLACE ANY AND ALL CONTRACTOR SUPPLIED DEFECTIVE DEVICES, ITEMS, OR SYSTEMS AT CONTRACTOR'S EXPENSE, BEFORE COMPLETION OF PROJECT.
37.	WHERE JOB CONDITIONS REQUIRE CHANGES FROM THE CONTRACT DOCUMENTS THAT DO NOT CHANGE THE SCOPE OR NATURE OF WORK REQUIRED, THE CONTRACTOR SHALL MAKE SUCH CHANGES WITHOUT ADDITIONAL COST TO THE OWNER. NO OTHER CHANGES MAY BE MADE WITHOUT WRITTEN PERMISSION FROM THE ENGINEER.
38.	ALL EQUIPMENT, FIXTURES AND MATERIALS SHALL BE NEW AND UNUSED, AND INSTALLED IN STRICT CONFORMANCE TO MANUFACTURER'S RECOMMENDATIONS (UNLESS OTHERWISE NOTED). PROVIDE COMPLETE WITH ALL TRIM STOPS, HANGERS, CARRIERS, SUPPORTS, ETC., INCLUDING PROVISIONS FOR BARRIER FREE USE, IF REQUIRED. WHERE FIXTURES ARE ACCESSIBLE THEY MUST COMPLY WITH ALL FEDERAL ADA REGULATIONS.
39.	CONTRACTOR SHALL GUARANTEE ALL WORK FOR WHICH MATERIALS ARE FURNISHED, FABRICATED, FIELD ERECTED, ALL FACTORY ASSEMBLED EQUIPMENT FOR WHICH NO SPECIFIC MANUFACTURER'S GUARANTEE IS FURNISHED, AND ALL WORK IN CONNECTION WITH INSTALLATION OF MANUFACTURER'S GUARANTEED EQUIPMENT. THE CONTRACTOR'S GUARANTEE SHALL LAST ONE YEAR FROM THE FINAL OWNER ACCEPTANCE OF THE WORK AND SHALL APPLY TO ALL DEFECTS IN MATERIALS AND WORKMANSHIP OF ANY KIND.
40.	ALL FAUCET CONTROLS SHALL BE OPERABLE WITH ONE HAND AND NOT REQUIRE TIGHT GRASPING.
41.	ALL BARRIER FREE WATER CLOSET CONTROLS SHALL BE LOCATED ON UNIT TOWARDS WIDE SIDE OF STALL. VERIFY IF RIGHT OR LEFT SIDE LOCATION.



PLUMBING ACCESSORIES	
FD:	FLOOR DRAIN - ZURN ZN415B-P-V-P; 6" CAST-IRON FLOOR DRAIN BODY AND COLLAR, 3" THREADED DRAIN OUTLET WITH 3" DEEP SEAL P-TRAP, 1/2" TRAP SEAL PRIMER CONNECTION WITH PRESSURE ACTIVATED TRAP PRIMER VALVE. PROVIDE WITH VANDAL-PROOF SECURED TOP.  TRAP PRIMER - ZURN Z1022 SANI-GUARD; CONNECT TO CW WITH VALVE, EXTEND TRAP PRIMER TO FLOOR DRAIN AS REQUIRED. 1/2" CW.  DEEP SEAL TRAP - ZURN Z1000; DURA-COATED CAST IRON BODY WITH BOTTOM BRONZE CLEANOUT PLUG. 3" PIPE SIZE.  REFER TO PLUMBING DRAWINGS FOR FLOOR DRAIN LOCATIONS WITH EITHER A TRAP PRIMER CONNECTION OR DEEP SEAL P-TRAP.
FCO:	FLOOR CLEANOUT - ZURN ZN1400-K; CAST-IRON ADJUSTABLE HOUSING FLOOR CLEANOUT; RAISED, TAPERED THREAD BRONZE CLOSURE PLUG; NEOPRENE RUBBER GASKET; NICKEL-BRONZE ROUND SCORATED TOP COVER; INSIDE CAULK OUTLET, SAME SIZE AS CONNECTED DRAINAGE PIPING; ASME A112.36.2M.
WCO:	WALL CLEANOUT - ZURN Z1446; CAST-IRON CLEANOUT TEE; RECESSED, TAPERED THREAD BRONZE PLUG; STAINLESS STEEL OR CHROME-PLATED BRASS WALL ACCESS COVER PLATE; SAME SIZE AS CONNECTED DRAINAGE PIPING; ASME A112.36.2M.
GCO:	GRADE CLEANOUT - ZURN ZN1400-HD; CAST-IRON ADJUSTABLE HOUSING CLEANOUT FERRULE; RECESSED, TAPERED THREAD, BRONZE CLOSURE PLUG; NEOPRENE RUBBER GASKET; SAME SIZE AS CONNECTED DRAINAGE PIPING; INSTALL IN 24" X 24" X 12" DEEP CONCRETE PAD FLUSH WITH GRADE; ASME A112.36.2M. INSTALL END-OF-LINE CLEANOUT WITH LONG SWEEP ELBOW; INSTALL 2-WAY CLEANOUT WITH 2-WAY CLEANOUT FITTING.
PCO:	PINNED CLEANOUT - ACORN PC; 2-1/2" NPT BRASS CLEAN-OUT PLUG. PERMANENT 5/32" STAINLESS STEEL PIN.

PLUMBING FIXTURE SCHEDULE		ROUGH-IN PIPE SIZES				WATER SUPPLY DURATION		DRAINAGE	BASIS OF DESIGN MAKE	BASIS OF DESIGN MODEL
FIXTURE MARK	FIXTURE DESCRIPTION	COLD WATER SUPPLY	HOT WATER SUPPLY	FIXTURE TRAP	FIXTURE DRAIN	COLD WATER	HOT WATER			
WC-1	COMBINATION LAVATORY AND WATER CLOSET - 14 GAUGE TYPE 304 STAINLESS STEEL, FLOOR MOUNTED, WALL OUTLET, HARD-WIRED FLUSH VALVE, 1.28 GPF. PROVIDE WITH PENAL BUBBLER. PROVIDE HARD-WIRED SECONDARY CONTROL OF FLUSH VALVE TO BE LOCATED IN CHASE.	LAV: 1/2" WC: 1"	LAV: 1/2" WC: -	LAV: 2" WC: 4"	LAV: 2" WC: 4"	LAV: 0.5 WC: 6	LAV: 0.5 WC: -	LAV: 1 WC: 4	ACORN	1432ALAR
WC-2	WATER CLOSET - 14 GAUGE TYPE 304 STAINLESS STEEL, FLOOR MOUNTED, WALL OUTLET, MECHANICAL FLUSH VALVE, 1.6 GPF.	1"	N/A	4"	4"	6	N/A	4	ACORN	1695
WC-3	WATER CLOSET - BARRIER FREE FLOOR MOUNTED 17" HIGH, ELONGATED, 1-1/2" TOP SPUD, VITREOUS CHINA, 1.6 GPF. ROUND FRONT SEAT COVER, STAINLESS STEEL HINGE. PROVIDE ALL REQUIRED ACCESSORIES FOR COMPLETE INSTALLATION.	1"	N/A	4"	4"	6	N/A	4	AMERICAN STANDARD; SLOAN	215BA; 111
LAV-1	LAVATORY - 14 GAUGE TYPE 304 STAINLESS STEEL, WALL OUTLET, PNEUMATICALLY OPERATED, HEMISPHERICAL PUSH BUTTONS, ADA COMPLIANT, HEMISPHERICAL BUBBLER, AND INTEGRAL SELF-DRAINING SOAP DISH.	1/2"	1/2"	2"	2"	1.5	1.5	1	ACORN	LR1652
LAV-2	LAVATORY, BARRIER FREE - 20X18" VITREOUS CHINA, WALL HUNG, SINGLE HOLE. PROVIDE FLOOR CARRIER WITH CONCEALED ARMS. CHROME FAUCET, GRID DRAIN ASSEMBLY. TOP OF FRONT RIM MOUNTED 34" FROM FINISHED FLOOR. PROVIDE STOPS, SUPPLIES, TRAP, ETC., TO MAKE A COMPLETE INSTALLATION.	1/2"	1/2"	2"	2"	0.5	0.5	1	AMERICAN STANDARD; DELTA	0355; 27CA974
MS-1	MOP SINK - 24X24X10" ONE-PIECE CONSTRUCTION, INTEGRALLY MOLDED CENTER DRAIN WITH SEAL. PROVIDE WITH HOSE AND HOSE HOOK, MOP BRACKET, VACUUM BREAKER, AND WALL GUARDS.	1/2"	1/2"	3"	3"	2.25	2.25	2	FIAT; MOEN	TSB-3010; 8230
SH-1	SHOWER - 14 GAUGE TYPE 304 STAINLESS STEEL, PNEUMATICALLY OPERATED, PRESSURE BALANCING MIXING VALVE, AND INTEGRAL SERVICE STOPS.	1/2"	1/2"	2"	2"	3	3	2	ACORN	1741-8MV-RD
WH-1	WALL HYDRANT - ENCASED, NON-FREEZE, ANTI-SIPHON FLUSH WALL HYDRANT, NICKEL BRONZE FACE WITH LOCKING HINGED COVER, INCLUDED OPERATING KEY.	3/4"	N/A	N/A	N/A	5	N/A	N/A	ZURN	Z1320XL-NB
BPH-1	BED PAN HOPPER - VITREOUS CHINA, WALL-HUNG, BLOWOUT FLUSHING RIM SERVICE SINK, FLUSH VALVE. SLOAN "ROYAL" 117 BED PAN WASHER. CHICAGO 910-G777-19KCP	3/4"	3/4"	4"	4"	2.25	2.25	2	CRANE	7H544

LU: 1/10/2024 8:15:57 AM



1 PLUMBING DEMOLITION PLAN - SANITARY AND VENT - JIA  
1/8" = 1'-0"

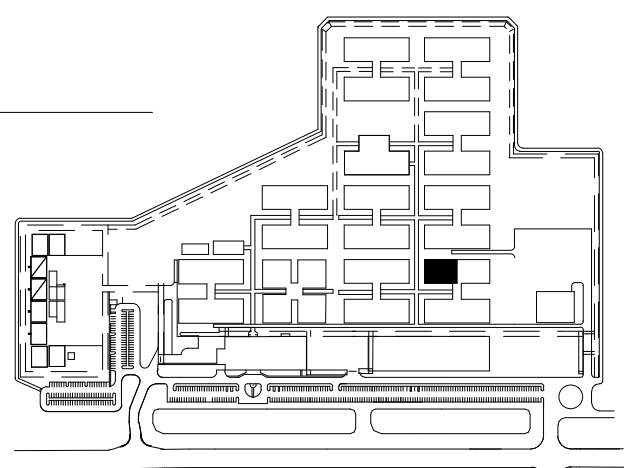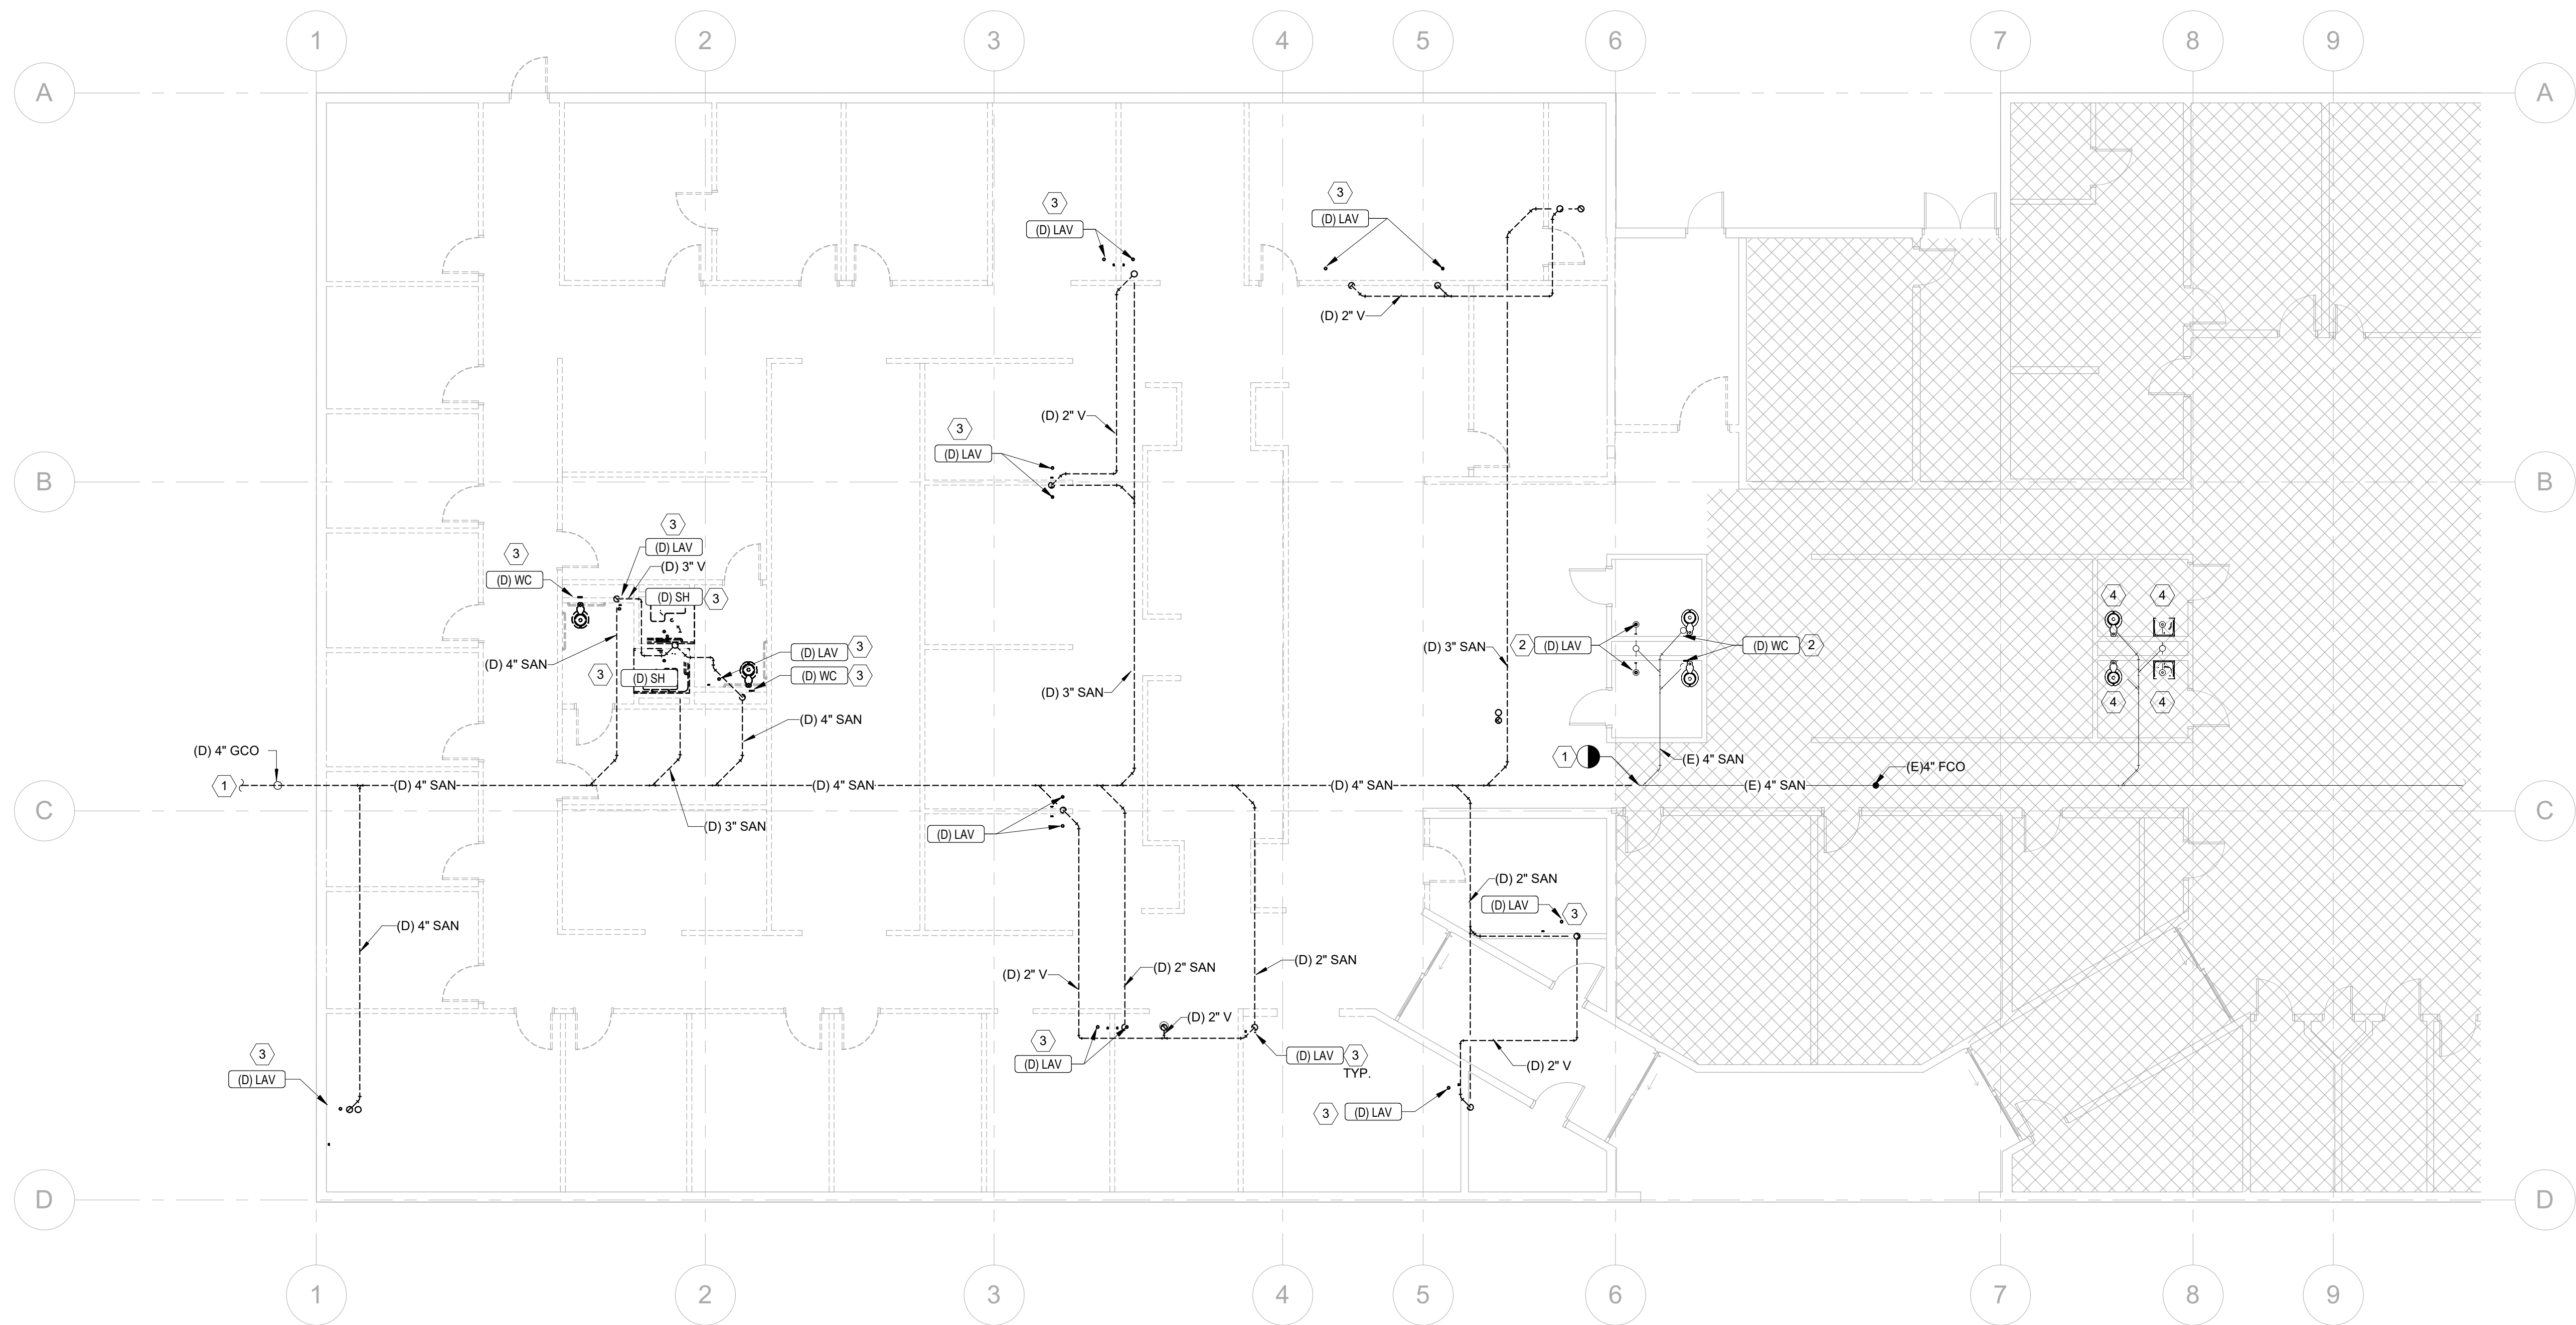

KEY PLAN

- KEYNOTES**
- 1 EXISTING 4" SANITARY PIPING SHALL BE DEMOLISHED FROM LIMIT OF DEMOLITION BACK TO MAIN UNDERGROUND SEWER CONNECTION. CONTRACTOR SHALL COORDINATE DEMOLITION WORK WITH HILLSBOROUGH COUNTY WATER RESOURCES DEPARTMENT (WASTEWATER).
  - 2 REMOVE AND PROPERLY DISPOSE OF EXISTING PLUMBING FIXTURES. PREPARE EXISTING PIPING FOR RECONNECTION. TEMPORARILY CAP EXISTING SANITARY, VENT, AND DOMESTIC WATER PIPING FOR REUSE. REFER TO PLUMBING RENOVATION PLAN FOR ADDITIONAL INFORMATION.
  - 3 REMOVE AND PROPERLY DISPOSE OF EXISTING PLUMBING FIXTURE AND ASSOCIATED PIPING. REPAIR FLOORING AND SLAB AS REQUIRED. REFER TO ARCHITECTURAL DRAWINGS FOR ADDITIONAL INFORMATION.
  - 4 NOTED PLUMBING FIXTURES EXISTING TO REMAIN. CONTRACTOR SHALL CLEAN PLUMBING FIXTURES AND ENSURE PROPER OPERATION AS PART OF THIS PROJECT.

- PLUMBING GENERAL NOTES**
- A. THESE DRAWINGS ARE DIAGRAMMATIC IN NATURE AND DO NOT SHOW ALL ELBOWS, OFFSETS, UNIONS, VALVES, OR FITTINGS REQUIRED TO COMPLETE INSTALLATION.
  - B. EXISTING CONDITIONS ARE BASED ON FIELD OVSERVATIONS AND 'AS-BUILT' DOCUMENTS. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS AND REPORT DISCREPANCIES TO ENGINEER PRIOR TO DISTURBING EXISTING INSTALLATION.
  - C. CONTRACTOR SHALL FIELD VERIFY ALL CONNECTION POINTS TO EXISTING SYSTEM PIPING AFFECTED.
  - D. ALL EXISTING PIPING TO BE REUSED SHALL BE PRESSURE TESTED, THOROUGHLY CLEANED, AND SANITIZED TO AVOID POSSIBLE CONTAMINATION.
  - E. PLUMBING CONTRACTOR SHALL ENSURE NO DEAD LEGS ARE LEFT IN ANY PIPING WITHIN THE AREA OF WORK.

HCSO MENTAL HEALTH CLINIC

2310 N. FALKENBURG ROAD  
TAMPA, FLORIDA 33619

PLUMBING DEMOLITION PLAN - SANITARY AND VENT - JIA

#	ISSUED FOR	DATE
	00 - JIA	06.20.24
	75% - JIA	07.26.24
	PERMIT/BID	08.20.24
	ADDENDUM #1	09.05.24

DRAWN BY: JTD  
REVIEW BY: NPS

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P 883.682.7182  
F 883.687.6346  
lic: A004778

lunz.com

24001.01


PD101A



#	KEYNOTES
1	REMOVE AND PROPERLY DISPOSE OF EXISTING PIPING BACK TO LIMIT OF DEMOLITION.
2	NOTED PLUMBING FIXTURES EXISTING TO REMAIN. CONTRACTOR SHALL CLEAN PLUMBING FIXTURES AND ENSURE PROPER OPERATION AS PART OF THIS PROJECT.
3	REMOVE AND PROPERLY DISPOSE OF EXISTING PLUMBING FIXTURES. PREPARE EXISTING PIPING FOR RECONNECTION. TEMPORARILY CAP EXISTING SANITARY, VENT, AND DOMESTIC WATER PIPING FOR REUSE. REFER TO PLUMBING RENOVATION PLAN FOR ADDITIONAL INFORMATION.
4	REMOVE AND PROPERLY DISPOSE OF EXISTING PLUMBING FIXTURE AND ASSOCIATED PIPING. REPAIR FLOORING AND SLAB AS REQUIRED. REFER TO ARCHITECTURAL DRAWINGS FOR ADDITIONAL INFORMATION.

## PLUMBING GENERAL NOTES

- A. THESE DRAWINGS ARE DIAGRAMMATIC IN NATURE AND DO NOT SHOW ALL ELBOWS, OFFSETS, UNIONS, VALVES, OR FITTINGS REQUIRED TO COMPLETE INSTALLATION.
- B. EXISTING CONDITIONS ARE BASED ON FIELD OBSERVATIONS AND 'AS-BUILT' DOCUMENTS. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS AND REPORT DISCREPANCIES TO ENGINEER PRIOR TO DISTURBING EXISTING INSTALLATION.
- C. CONTRACTOR SHALL FIELD VERIFY ALL CONNECTION POINTS TO EXISTING SYSTEM PIPING AFFECTED.
- D. ALL EXISTING PIPING TO BE REUSED SHALL BE PRESSURE TESTED, THOROUGHLY CLEANED, AND SANITIZED TO AVOID POSSIBLE CONTAMINATION.
- E. PLUMBING CONTRACTOR SHALL ENSURE NO DEAD LEGS ARE LEFT IN ANY PIPING WITHIN THE AREA OF WORK.



2310 N. FALKENBURG ROAD  
TAMPA, FLORIDA 33619

# PLUMBING DEMOLITION PLAN - DOMESTIC WATER - JIA

DRAWN BY: JTD  
REVIEW BY: NPS

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
p 863.682.1882  
f 863.687.6346  
lic. AR94778

lunz.com

24001.01

# PD201A







**1 PLUMBING RENOVATION PLAN - DOMESTIC WATER - JIA**  
1/8" = 1'-0"

WATER SUPPLY FIXTURE UNITS (JIA)						
FIXTURE MARK	FIXTURE TYPE	WATER SUPPLY FIXTURE UNIT (WSFU)			QUANTITY	TOTAL WSFU
		COLD	HOT	TOTAL		
WC-1	COMBINATION LAVATORY AND WATER CLOSET	6.5	0.5	6.7	13	87.1
WC-2	WATER CLOSET	6.0	-	6.0	4	24.0
WC-3	WATER CLOSET	6.0	-	6.0	2	12.0
LAV-1	LAVATORY	1.5	1.5	2.0	4	8.0
LAV-2	LAVATORY	0.5	0.5	0.7	2	1.4
MS-1	MOP SINK	2.25	2.25	3.0	1	3.0
SH-1	SHOWER	3.0	3.0	4.0	5	20.0
BPH-1	BED PAN HOPPER	2.25	2.25	3.0	1	6.0
WH-1	WALL HYDRANT	2.5	-	2.5	1	2.5
TOTALS					33	164

#	KEYNOTES
1	PROVIDE DOMESTIC HOT, COLD, AND RECIRCULATION PIPING TO NEW PLUMBING FIXTURES AND CONNECT TO EXISTING PIPING OUTSIDE OF MECHANICAL ROOM.
2	FLOOR DRAIN SHALL BE PROVIDED WITH TRAP SEAL.
3	FLOOR DRAIN SHALL BE PROVIDED WITH TRAP PRIMER.
4	1/2" TRAP PRIMER SHALL BE ROUTED UNDERGROUND AND CONNECTED TO DOMESTIC COLD WATER LINE LOCATED IN CHASE. REFER TO DETAIL.
5	NEW PLUMBING FIXTURES SHALL BE CONNECTED TO EXISTING HOT WATER, COLD WATER, AND HOT WATER RECIRCULATING PIPES.
6	EXISTING 3/4" DCW UP TO MEZZANINE MECHANICAL PENTHOUSE TO SERVE EXISTING HOSE BIBB.
7	REFER TO POTABLE HOT WATER RETURN BALANCING VALVE STATION DETAIL FOR MORE INFORMATION.

PLUMBING GENERAL NOTES
A. THESE DRAWINGS ARE DIAGRAMMATIC IN NATURE AND DO NOT SHOW ALL ELBOWS, OFFSETS, UNIONS, VALVES, OR FITTINGS REQUIRED TO COMPLETE INSTALLATION.
B. EXISTING CONDITIONS ARE BASED ON FIELD OBSERVATIONS AND 'AS-BUILT' DOCUMENTS. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS AND REPORT DISCREPANCIES TO ENGINEER PRIOR TO DISTURBING EXISTING INSTALLATION.
C. CONTRACTOR SHALL FIELD VERIFY ALL CONNECTION POINTS TO EXISTING SYSTEM PIPING AFFECTED.
D. ALL EXISTING PIPING TO BE REUSED SHALL BE PRESSURE TESTED, THOROUGHLY CLEANED, AND SANITIZED TO AVOID POSSIBLE CONTAMINATION.
E. PLUMBING CONTRACTOR SHALL ENSURE NO DEAD LEGS ARE LEFT IN ANY PIPING WITHIN THE AREA OF WORK.

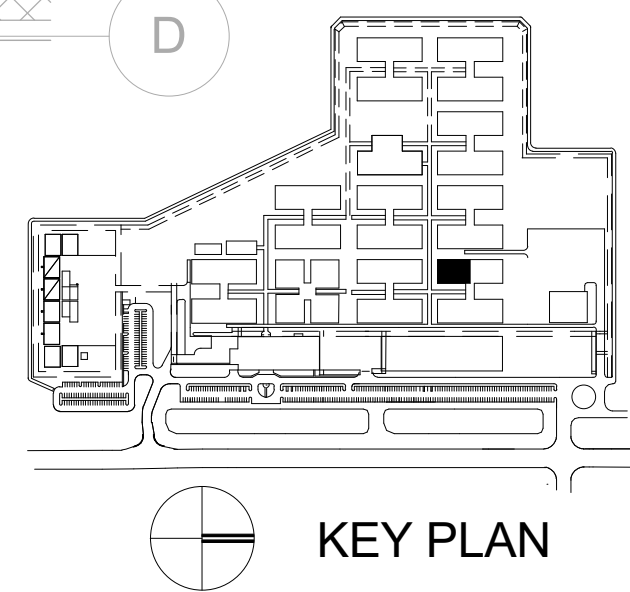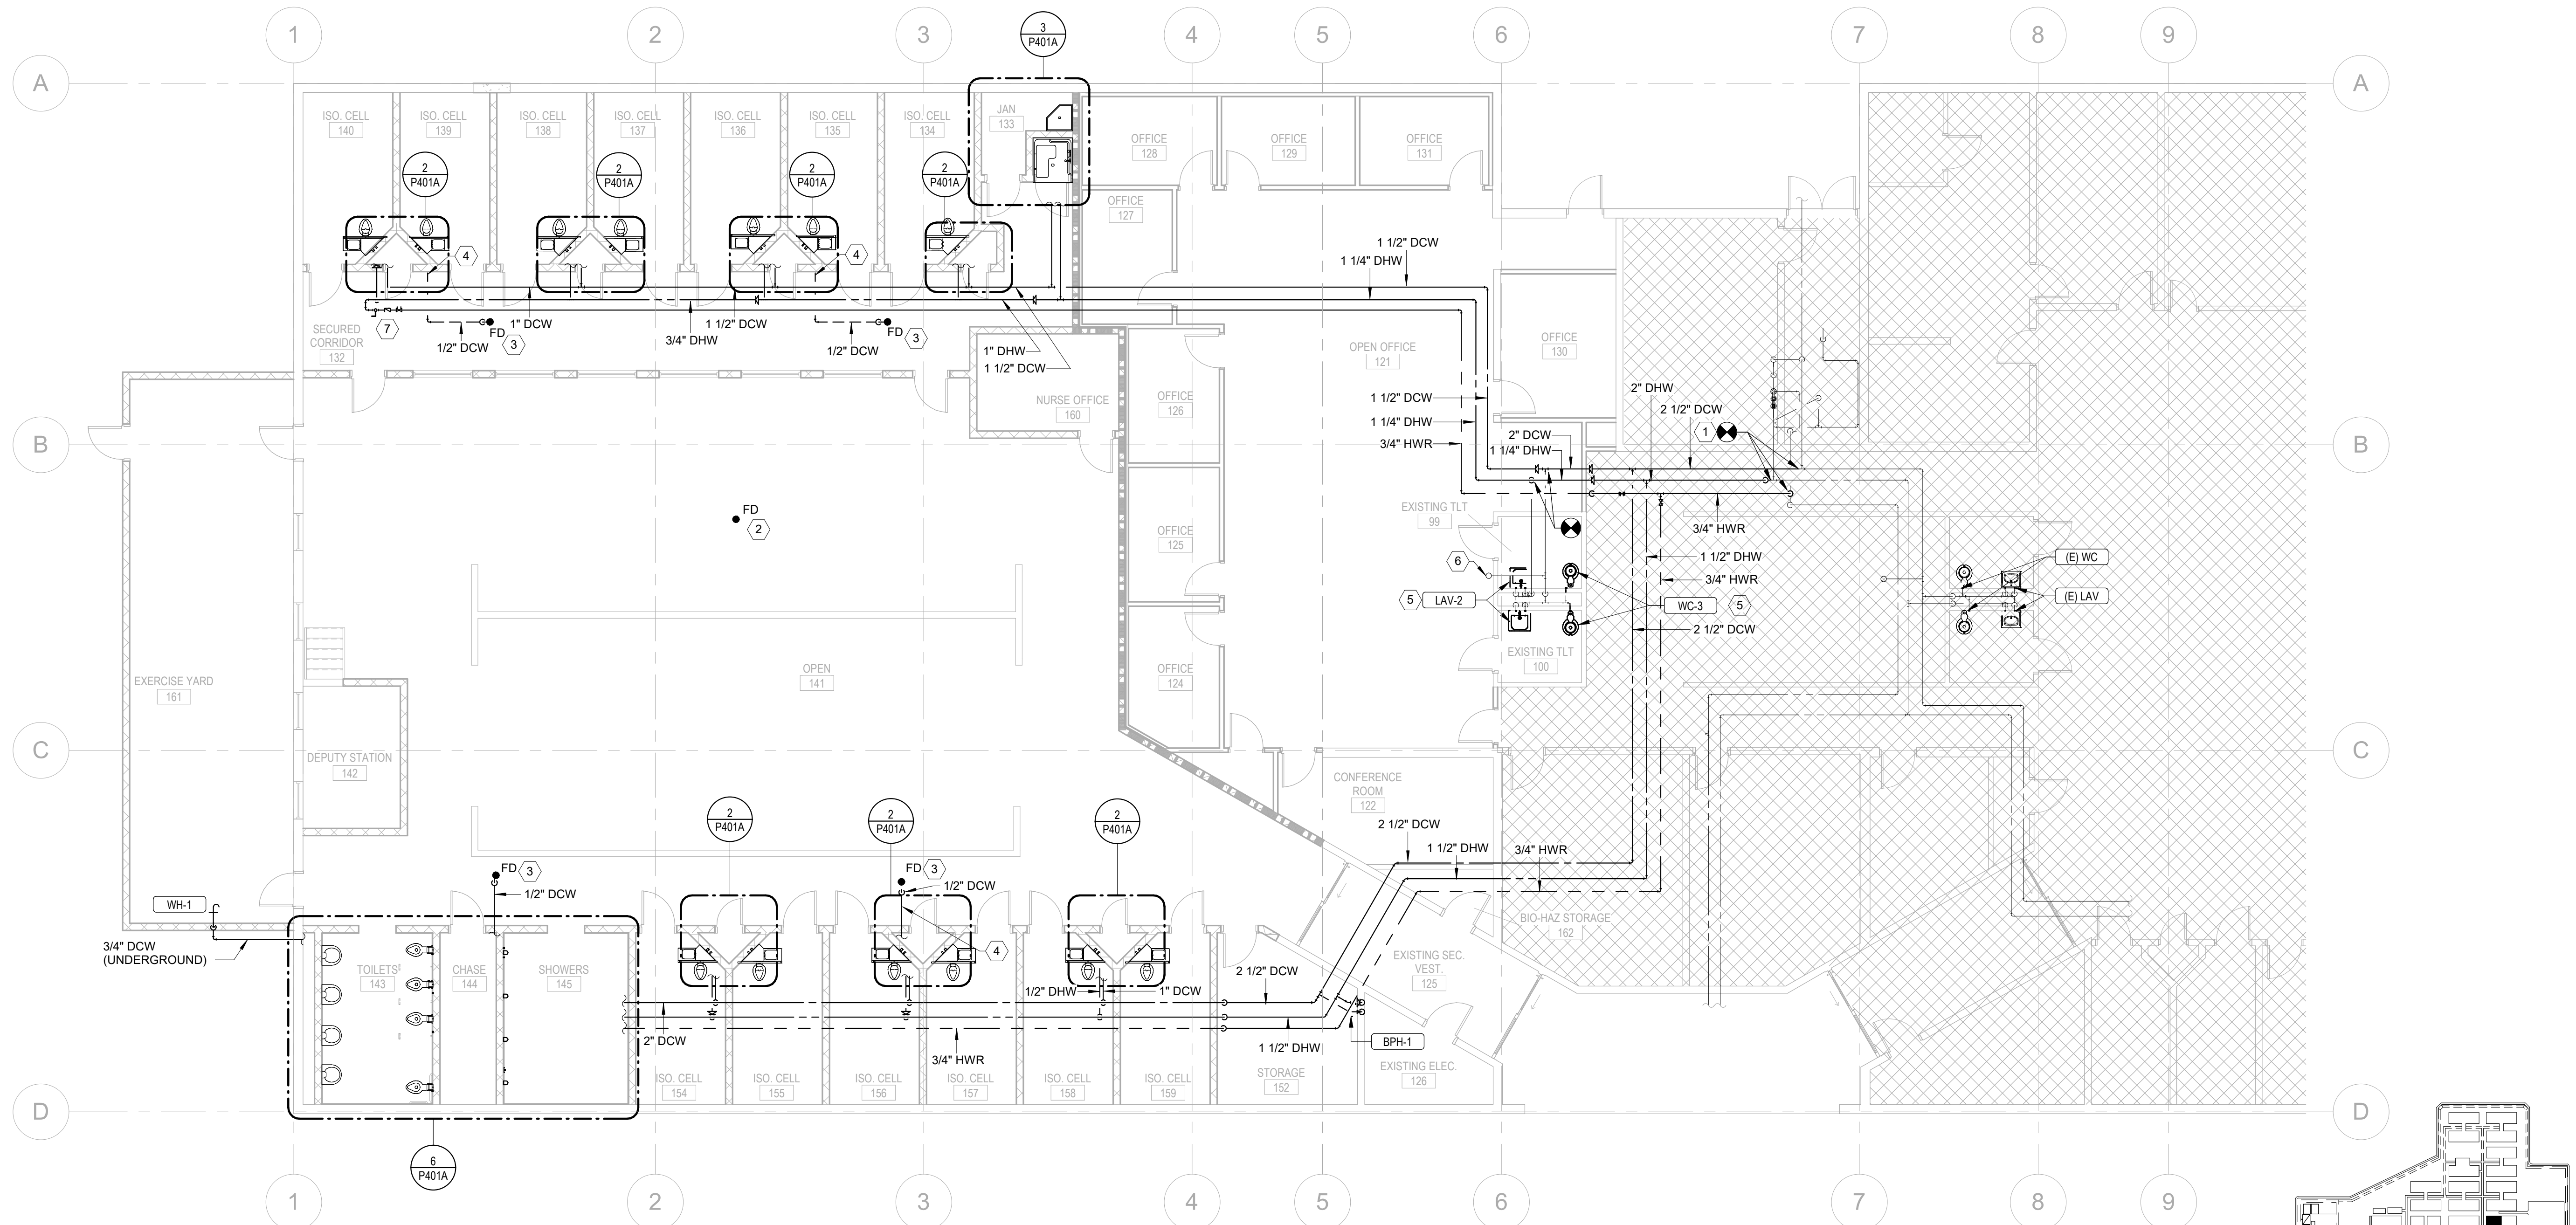

HCSO MENTAL HEALTH CLINIC

2310 N. FALKENBURG ROAD  
TAMPA, FLORIDA 33619

#	ISSUED FOR	DATE
1	ISS - JIA	06.20.24
2	75% - JIA	07.26.24
3	PERMIT/BID	08.20.24
4	ADDENDUM #1	09.05.24

DRAWN BY: JTD  
REVIEW BY: NPS

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P 883.682.1082  
F 883.687.6346  
lor.4004778

lunz.com

24001.01

P201A


PLUMBING RENOVATION PLAN - DOMESTIC WATER - JIA







LU: 1/10/2024 & 10/5/24 AM

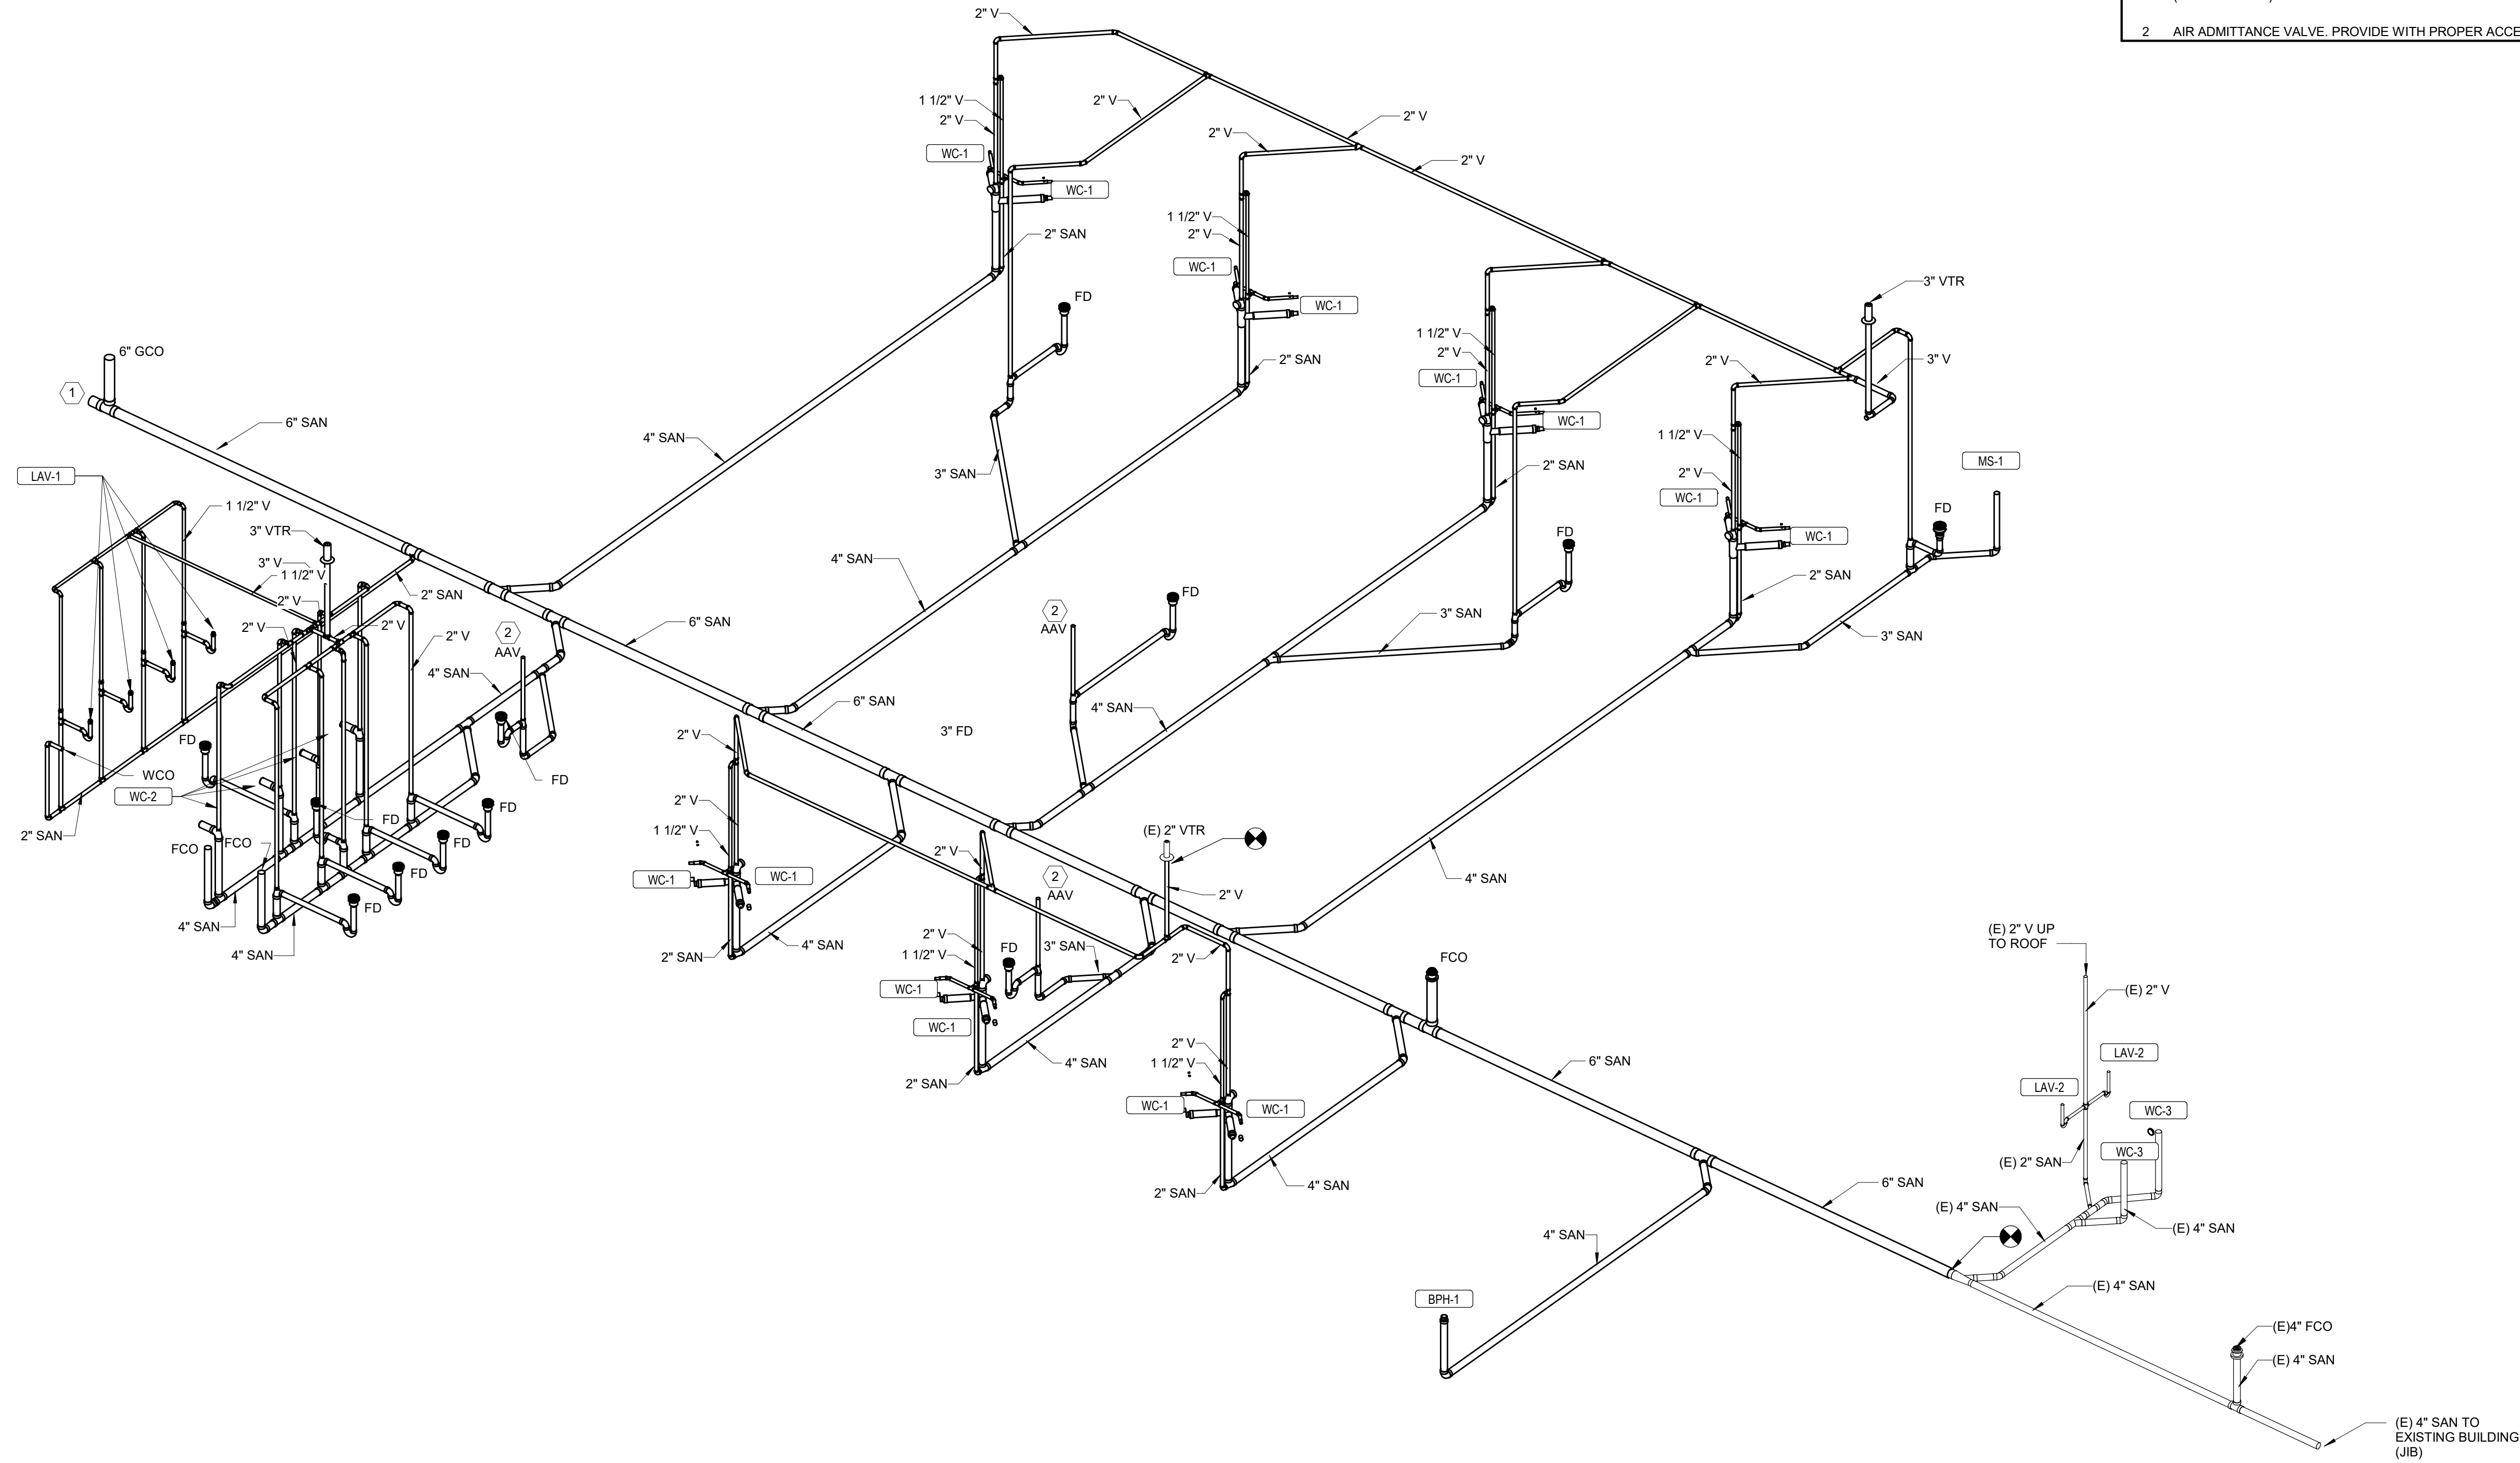

- | # | KEYNOTES  |
|---|---|
| 1 | NEW 6\"/>   |
| 2 | AIR ADMITTANCE VALVE. PROVIDE WITH PROPER ACCESS FOR SERVICING. |

1 SANITARY AND VENT ISOMETRIC - JIA  
NOT TO SCALE

HCSO MENTAL HEALTH CLINIC  
2310 N. FALKENBURG ROAD  
TAMPA, FLORIDA 33619  
SANITARY & VENT ISOMETRIC - JIA

#	ISSUED FOR	DATE
	DIS - JIA	06.20.24
	75% - JIA	07.26.24
	PERMIT/BID	08.20.24
	ADDENDUM #1	09.05.24

DRAWN BY: JTD  
REVIEW BY: NPS  
  
THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P 883.682.1052  
F 883.687.6346  
E: AG0478

lunz.com

24001.01

P901A


THE  
LUNZ  
GROUP

MES  
GROUP

550 North Reo Street  
Suite 203, Tampa, FL  
33609  
813.289.4700  
COA # 8304



LU: 1/10/2024 8:55:54 AM

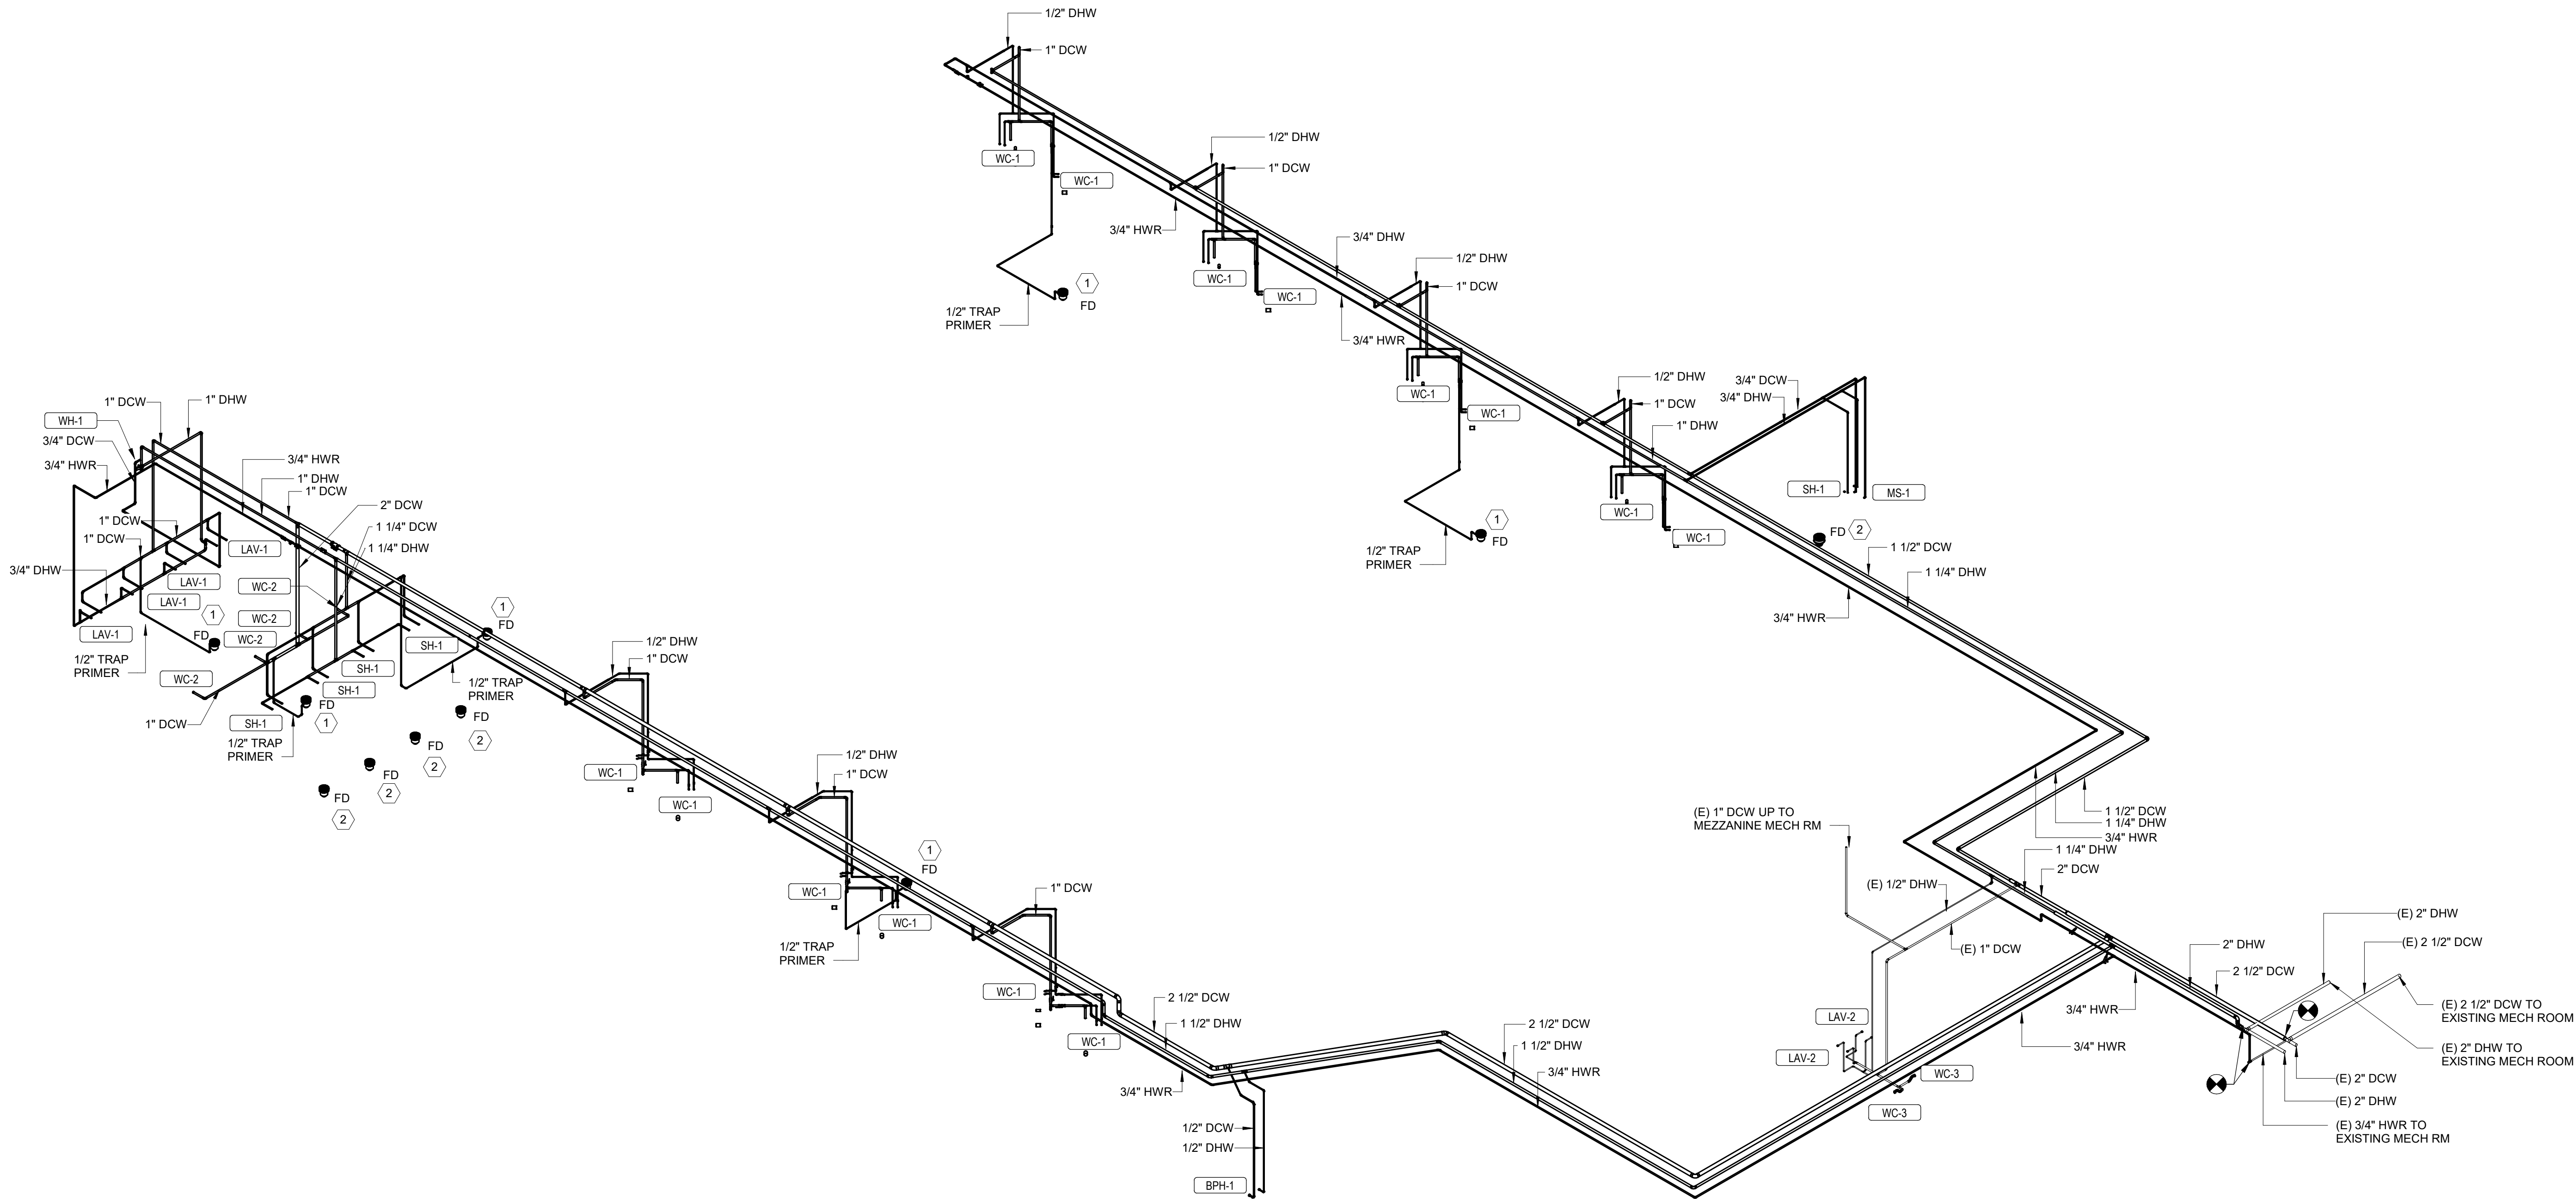

#	KEYNOTES
1	FLOOR DRAIN SHALL BE PROVIDED WITH TRAP PRIMER.
2	FLOOR DRAIN SHALL BE PROVIDED WITH TRAP SEAL.

# 1 PLUMBING ISOMETRIC - DOMESTIC WATER

NOT TO SCALE

#	ISSUED FOR	DATE
	DS - JIA	06.20.24
	75% - JIA	07.26.24
	PERMIT/BID	08.20.24
	ADDENDUM #1	09.05.24

DRAWN BY: JTD  
REVIEW BY: NPS

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P 883.682.1082  
F 883.687.6346  
W: AOL478

lunz.com



24001.01

P902A

DELEGATED DESIGN REQUIREMENTS


- A. THESE FIRE PROTECTION SYSTEM ENGINEERING DOCUMENTS, AS DEFINED PER F.A.C. 61G15-32.002(5), REPRESENT THE OVERALL SCOPE, DESIGN INTENT, AND COVERAGE AREA FOR THE FIRE PROTECTION SYSTEM WITHIN THE PROJECT SCOPE. DELEGATED ENGINEER IS RESPONSIBLE FOR DESIGNING A FIRE PROTECTION SYSTEM FOR THE ENTIRE BUILDING, PERMITTED AND APPROVED PER NFPA AND BY THE AUTHORITY HAVING JURISDICTION.
- B. DELEGATED ENGINEER SHALL PROVIDE FIRE PROTECTION SYSTEM LAYOUT DOCUMENTS TO THE ENGINEER OF RECORD AND AUTHORITY HAVING JURISDICTION, INCLUDING THE FOLLOWING AS APPLICABLE, BUT NOT LIMITED TO:
- SPRINKLER SYSTEM DRAWINGS, INCLUDING SPRINKLER SYSTEM LAYOUT, NODE IDENTIFICATION AND NODE SPOT ELEVATIONS.
  - HYDRAULIC CALCULATIONS AND PIPE SIZES. SIZE PIPING TO PROVIDE AN EXCESS RESIDUAL PRESSURE OF 10 PSI AT THE HYDRAULICALLY MOST DEMANDING POINT AT SYSTEM DESIGN FLOW.
  - SPRINKLER SYSTEM DESIGN, CALCULATIONS, DETAILED WORKSHEETS, WATER SUPPLY CURVE, AND SPRINKLER SYSTEM DEMAND CURVE.
  - SPRINKLER HEAD PRODUCT DATA SHEETS WITH SPECIFIC SYSTEM COMPONENTS IDENTIFIED.
  - ADDITIONAL SPRINKLER SYSTEM SPECIFICATIONS AS REQUIRED FOR COMPLIANCE WITH NFPA 13, CHAPTER 27 PLANS AND CALCULATIONS, PRIOR TO AUTOMATIC SPRINKLER SYSTEMS INSTALLATION.
  - ALL NECESSARY COMPONENTS, SYSTEMS MATERIALS, ASSEMBLIES, EQUIPMENT, AND SUPPORT SYSTEMS REQUIRED.
- C. FIRE SPRINKLER CONTRACTOR SHALL COORDINATE THE LOCATION OF RISERS, CROSS MAINS, BRANCH LINES, AND SPRINKLER HEADS WITH ALL OTHER TRADE SYSTEMS TO AVOID CONFLICTS AND MAINTAIN ARCHITECTURAL ELEMENTS OF THE BUILDING.
- D. COORDINATE SPRINKLER HEAD TYPES AND LOCATIONS WITH ARCHITECTURAL FINISHES AND OTHER CEILING MOUNTED DEVICES.

FIRE PROTECTION SYMBOLS

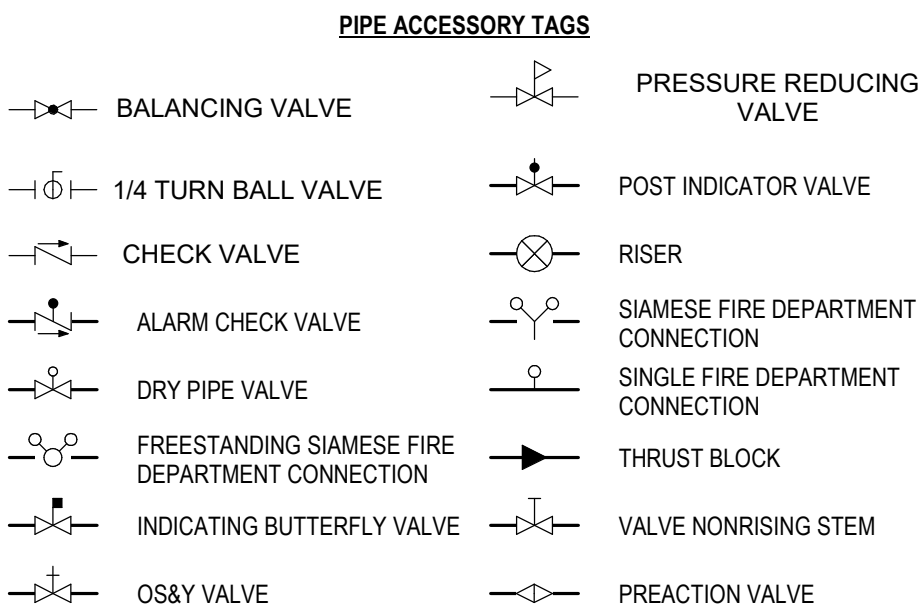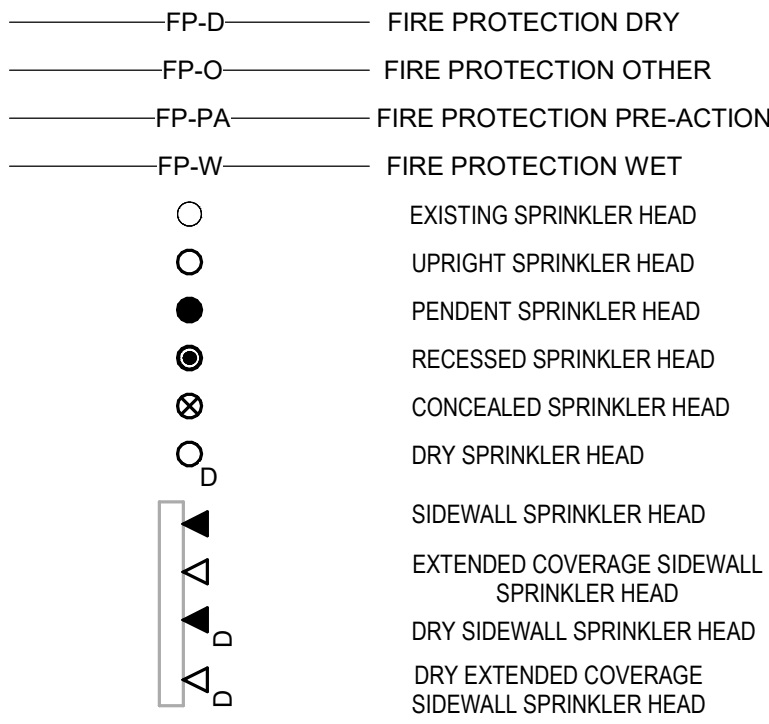

\*NOTE\*  
ALL OF GENERAL NOTES ON THIS SHEET ARE TO BE APPLIED TO ALL OTHER DRAWINGS IN THIS SET. THE SYMBOLS AND ABBREVIATIONS SHOWN ON THIS SHEET MAY OR MAY NOT BE USED IN THIS SET OF DRAWINGS.

GENERAL MECHANICAL SYMBOLS

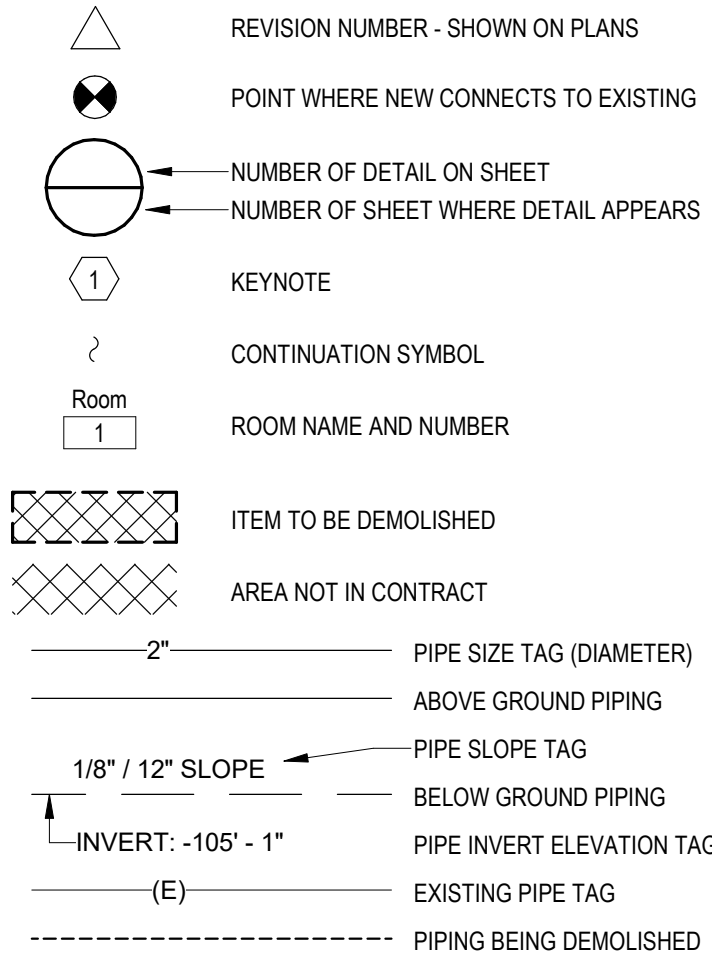

ABBREVIATIONS


Ø	DIAMETER	INV	INVERT
ABV	ABOVE	LB	POUND
AFF	ABOVE FINISHED FLOOR	MAX	MAXIMUM
ARCH	ARCHITECT/ARCHITECTURAL	MECH	MECHANICAL
BFF	BELOW FINISHED FLOOR	MIN	MINIMUM
BLW	BELOW	MISC	MISCELLANEOUS
CAP	CAPACITY	NIC	NOT IN CONTRACT
CLG	CEILING	NO	NUMBER
D	DEGREE	NTS	NOT TO SCALE
DN	DOWN	PD	PRESSURE DROP
ELEC	ELECTRICAL	PIV	POST INDICATOR VALVE
F	FAHRENHEIT	PSI	POUNDS PER SQUARE INCH
FDC	FIRE DEPARTMENT CONNECTION	REC	RECESSED
FPM	FEET PER MINUTE	RM	ROOM
FT	FOOT/FEET	SF	SQUARE FOOT/FEET
GAL	GALLON	SP	STANDPIPE
GPM	GALLONS PER MINUTE	SP	STATIC PRESSURE
HYD	HYDRANT	TYP	TYPICAL
IN	INCH	UG	UNDERGROUND

GENERAL NOTES


- THESE DRAWINGS ARE DIAGRAMMATIC IN NATURE AND INDICATIVE OF WORK TO BE PROVIDED (FURNISHED AND INSTALLED) UNDER THIS CONTRACT. DRAWINGS SHOULD NOT BE SCALED.
- CONTRACTOR SHALL NOTE ANY SPECIAL REQUIREMENTS FOR INSTALLATION OF WORK UNDER THIS CONTRACT. DISMANTLE AND REASSEMBLE EQUIPMENT AS NECESSARY FOR ENTRY INTO THE BUILDING AND THE LOCATION OF INSTALLATION.
- THE CONTRACTOR SHALL MAINTAIN A COMPLETE PROJECT SCHEDULE AND SHALL UPDATE THIS SCHEDULE WEEKLY. ANY CHANGES SHALL BE NOTED AND AN UPDATED SCHEDULE SHALL BE PROVIDED TO THE OWNER.
- ALL PERMITS, FEES, TAXES, ETC SHALL BE PAID BY CONTRACTOR AS PART OF THE TOTAL PROJECT COST.
- MAINTAIN THE INTEGRITY OF ALL FIRE AND SMOKE RATED WALLS, PARTITIONS, CEILINGS, AND FLOORS. SEAL ALL PENETRATIONS THROUGH RATED ASSEMBLIES WITH FIRESTOP MATERIAL IN ACCORDANCE WITH U.L. REQUIREMENTS TO MAINTAIN THE ASSEMBLY RATING.
- ALL CONSTRUCTION WORK SHALL ALSO MEET THE FOLLOWING CODE REQUIREMENTS:
  - FLORIDA BUILDING CODE (FBC) 2023
  - FLORIDA EXISTING BUILDING CODE 2023
  - FBC MECHANICAL 2023
  - FBC PLUMBING 2023
  - FBC ENERGY CONSERVATION 2023
  - FLORIDA FIRE PREVENTION CODE 2023
  - NFPA 1-2021, THE UNIFORM FIRE CODE
  - NFPA 101-2021, THE LIFE SAFETY CODE
  - NFPA 51B-2019, STANDARD FOR FIRE PREVENTION DURING WELDING, CUTTING AND OTHER HOT WORK
  - NFPA 13-2019, STANDARD FOR THE INSTALLATION OF SPRINKLER SYSTEMS
  - NFPA 70-2020, NATIONAL ELECTRICAL CODE
  - NFPA 90A-2021, STANDARD FOR THE INSTALLATION OF AIR CONDITIONING AND VENTING SYSTEMS.
  - NFPA 241-2019, STANDARD FOR SAFEGUARDING CONSTRUCTION, ALTERATION AND DEMOLITION OPERATIONS.
- CONTRACTOR SHALL FURNISH U.L. APPROVED DRAWINGS FOR EACH TYPE OF FIRE AND SMOKE RATED ASSEMBLY PENETRATION BY DUCTS, PIPES, OR CONDUITS, AND SHALL DISPLAY THESE DRAWINGS ON THE JOB SITE AT ALL TIMES DURING CONSTRUCTION.
- CONTRACTOR SHALL REFER TO ALL DETAILS FOR PROPER GUIDANCE.
- THE CONTRACTOR SHALL SUBMIT SHOP DRAWINGS AND EQUIPMENT SUBMITTALS FOR ALL PRODUCTS USED ON PROJECT.
- THE ENGINEER'S APPROVAL OF SUBMITTAL DATA SHALL NOT RELIEVE THE CONTRACTOR OF RESPONSIBILITY FOR DEVIATIONS FROM THE REQUIREMENTS OF CONTRACT DOCUMENTS UNLESS THE CONTRACTOR HAS RECEIVED WRITTEN APPROVAL FROM THE ENGINEER TO THE SPECIFIC DEVIATION. THE ENGINEER'S APPROVAL OF SUBMITTAL DATA SHALL NOT RELIEVE THE CONTRACTOR OF RESPONSIBILITY FOR ERRORS OR OMISSIONS IN HIS OR HER SUBMITTAL DATA.
- THE CONTRACTOR IS REQUIRED TO SUBMIT THREE COMPLETE O&M MANUALS IN THREE RING BINDERS AT SUBSTANTIAL COMPLETION. MANUALS SHALL INCLUDE INSTALLATION AND MAINTENANCE DATA ON ALL NEW EQUIPMENT AND MATERIALS, CERTIFIED TECHNICAL PRODUCT DATA, EQUIPMENT SHOP DRAWINGS, SPARE PARTS DATA, ETC. PROVIDE AN INDEX AND ASSOCIATED DIVIDERS.
- CLOSE OUT DOCUMENTS: THE CONTRACTOR IS TO MAINTAIN ONE SET OF CONSTRUCTION DRAWINGS ON SITE AND KEEP CURRENT WITH MARK UP AS-BUILT CONDITIONS DURING CONSTRUCTION OF THE PROJECT. THIS SET IS TO INCLUDE ALL CONTRACT CHANGES, MODIFICATIONS AND CLARIFICATIONS. THIS SET ALONG WITH ALL SHOP DRAWINGS SHALL BE TURNED OVER TO THE ARCHITECT/ENGINEER AFTER CONSTRUCTION COMPLETION.
- IT IS THE RESPONSIBILITY OF ALL BIDDERS TO THOROUGHLY REVIEW AND UNDERSTAND ALL CONSTRUCTION DOCUMENTS. THIS INCLUDES BUT IS NOT LIMITED TO ALL DRAWINGS, SPECIFICATION SECTIONS, ETC. THE DRAWINGS ARE SCHEMATIC IN NATURE. THEREFORE BEFORE STARTING ANY WORK, THE CONTRACTOR SHALL REVIEW ALL OTHER CONSTRUCTION DOCUMENTS, VERIFY FIELD CONDITIONS AND SHALL MAKE ANY REQUIRED MINOR ADJUSTMENTS WITHOUT EXTRA COST TO THE OWNER. ANY MAJOR DISCREPANCIES FOUND SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT/ENGINEER. THE BASE BID SHALL REFLECT THE TOTAL COST OF NEW EQUIPMENT INSTALLATION. THIS INCLUDES LABOR, EQUIPMENT AND MATERIALS. NO CHANGE ORDERS SHALL BE ISSUED WITHOUT WRITTEN CONSENT AND APPROVAL FROM ENGINEER AND ARCHITECT.

FIRE PROTECTION NOTES

- THE SYSTEM SHALL BE INSTALLED ACCORDING TO MANUFACTURER'S SPECIFICATIONS AND RECOMMENDATIONS AND AS PER REQUIREMENTS OF THE STATE BUILDING CODE, LOCAL FIRE DEPARTMENT, AND ALL FEDERAL, STATE, AND LOCAL AUTHORITIES, NFPA, AND FACTORY MUTUAL.
- THIS CONTRACTOR SHALL COORDINATE PHASING OF SPRINKLER WORK WITH THE GENERAL CONTRACTOR PRIOR TO STARTING WORK.
- PROVIDE A COMPLETE WET/DRY TYPE FIRE PROTECTION SYSTEM AS REQUIRED TO ACCOMMODATE THE FLOOR PLAN AND CEILING TYPES INCLUDING MAINS, BRANCHES, HEADS, VALVES, AND ACCESSORIES AS REQUIRED. THE SYSTEM SHALL BE INSTALLED ACCORDING TO MANUFACTURER'S SPECIFICATIONS AND RECOMMENDATIONS OF THE STATE BUILDING CODE, LOCAL FIRE DEPARTMENT, AND ALL FEDERAL, STATE, AND LOCAL AUTHORITIES, NFPA, AND FACTORY MUTUAL.
- TH SPRINKLER SYSTEM SHALL BE DESIGNED BASED UPON ACTUAL WATER FLOW TEST DATA OBTAINED AT OR NEAR THE JOB SITE.
- REFER TO REFLECTED CEILING PLANS FOR ADDITIONAL INFORMATION REGARDING SPRINKLER HEAD LOCATION AND PIPE, UNLESS NOTED OTHERWISE.
- DIVISION 21 CONTRACTOR SHALL COORDINATE WITH THE ELECTRICAL CONTRACTOR FOR PROPER INSTALLATION OF THE FIRE PROTECTION SYSTEMS ALARM DEVICES INVOLVED WITH FIRE SPRINKLER SYSTEM.
- ALL SPRINKLER SYSTEM PIPING SHALL BE CONCEALED ABOVE THE SUSPENDED CEILING SYSTEM, UNLESS NOTED OTHERWISE. WRITTEN AUTHORIZATION SHALL BE OBTAINED FROM THE ARCHITECT PRIOR TO EXPOSING ANY PIPING IN ANY ROOM WHICH HAS A SUSPENDED CEILING.
- CONTRACTOR SHALL PROVIDE ALL ADDITIONAL SPRINKLER HEADS AS REQUIRED TO ENSURE AN APPROVED FIRE PROTECTION SYSTEM AT NO ADDITIONAL COST TO THE OWNER.
- AUXILIARY DRAINS SHALL BE EXPOSED WITH 1" DRAIN VALVES. WHEN 5 OR MORE GALLONS ARE TRAPPED, THIS CONTRACTOR SHALL PROVIDE FIXED PIPING TO AN ADEQUATELY SIZED RECEPTOR WHICH IS CAPABLE OF ACCEPTING THE FULL FLOW OF THE DRAIN. WHEN LESS THAN 5 GALLONS ARE TRAPPED, A HOSE BIB SHALL BE PROVIDED AT THE DRAIN VALVE.
- AUXILIARY DRAINS SHALL NOT BE LOCATED ABOVE PLASTER OR GYPSUM BOARD CEILING SYSTEMS. ONLY BY A SPECIFIC WRITTEN INSTRUCTION FROM THE ENGINEER WILL A VARIANCE BE PROVIDED.
- AN INSPECTOR'S TEST CONNECTION SHALL BE PROVIDED FOR EACH FIRE SPRINKLER ZONE. THIS CONTRACTOR SHALL PROVIDE FIXED PIPING FROM THE TEST CONNECTION TO AN ADEQUATELY SIZED RECEPTOR WHICH IS CAPABLE OF ACCEPTING THE FULL FLOW OF THE TEST. EXTERIOR DISCHARGE OF THE TEST CONNECTION SHALL BE PERMITTED ONLY BY SPECIFIC WRITTEN INSTRUCTION FROM THE ENGINEER.
- SHOW ALL ROOM NUMBERS ON SHOP DRAWING PLANS.
- ROUTE SPRINKLER PIPING SUCH THAT IT DOES NOT RUN ABOVE ELECTRICAL PANELS, SWITCHGEAR, OR SIMILAR EQUIPMENT. SPRINKLER MAINS SHALL NOT RUN THROUGH ELECTRICAL OR COMMUNICATION ROOMS. SPRINKLER HEADS IN THESE ROOMS SHALL BE SERVED BY A DEDICATED BRANCH LINE FOR EACH ROOM.
- THIS DRAWING SET INDICATES A GENERAL PIPING ARRANGEMENT AND SUGGESTED SIZING ONLY. THE FIRE PROTECTION CONTRACTOR SHALL DETERMINE THE ACTUAL PIPE SIZING REQUIRED AND COORDINATE WORK WITH ALL OTHER TRADES TO AVOID CONFLICTS.
- THE FIRE PROTECTION CONTRACTOR SHALL PREPARE HYDRAULIC CALCULATIONS BASED UPON THE CONFIGURATION OF THE ACTUAL SYSTEM DESIGN AS SHOWN ON THIS CONTRACTOR'S SHOP DRAWINGS.
- COORDINATE AND PROVIDE AUTOMATIC AIR VENTS AND ASSOCIATED RELIEF PIPING FOR EACH SPRINKLER SYSTEM WITHIN BUILDING.
- FORWARD FLOW TESTING OF BACKFLOW PREVENT SHALL BE ACCOMPLISHED AT BACKFLOW PREVENTER. REFER TO DETAILS FOR MORE INFORMATION.

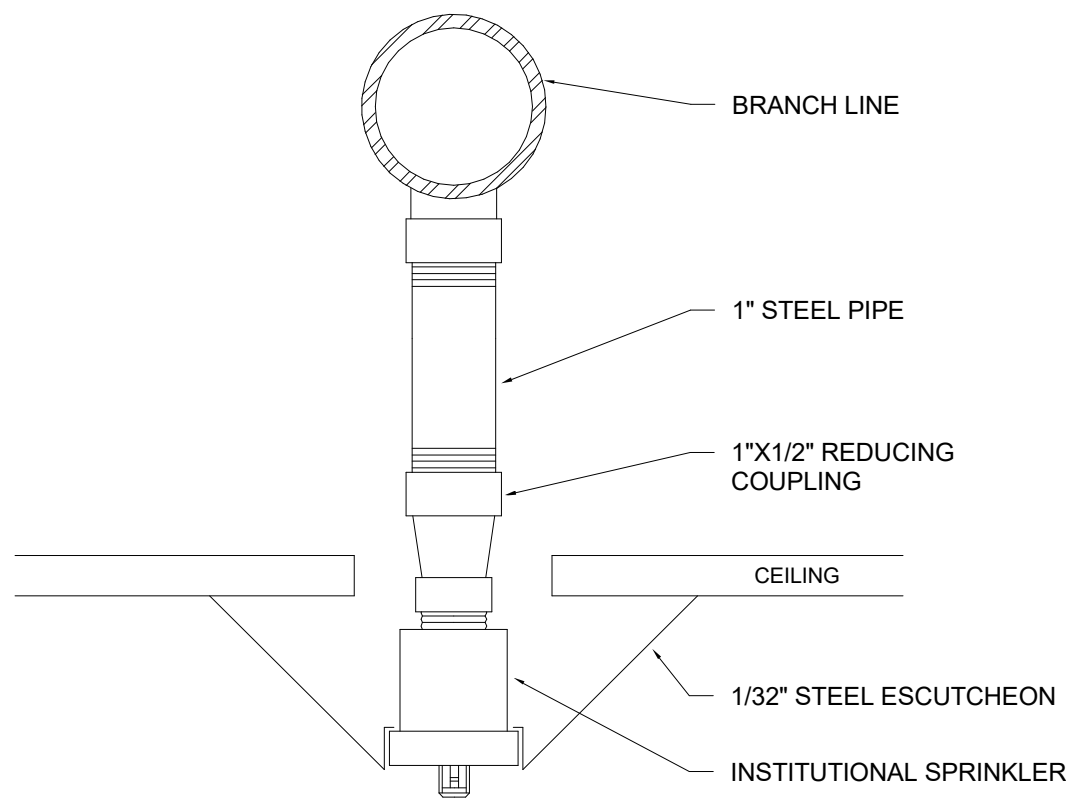


2 INSTITUTIONAL PENDENT SPRINKLER HEAD N.T.S.

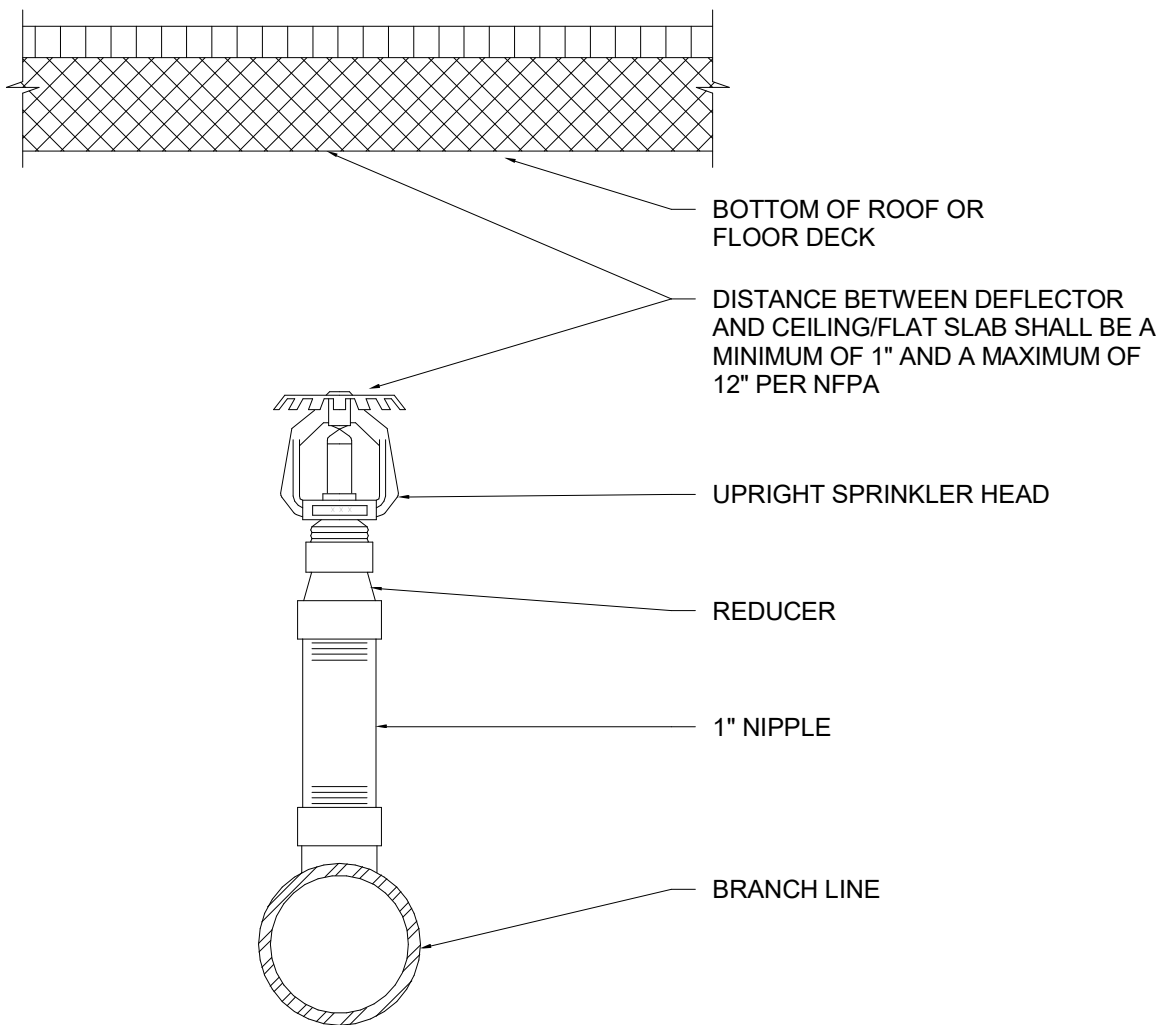

3 UPRIGHT SPRINKLER HEAD DETAIL

N.T.S.

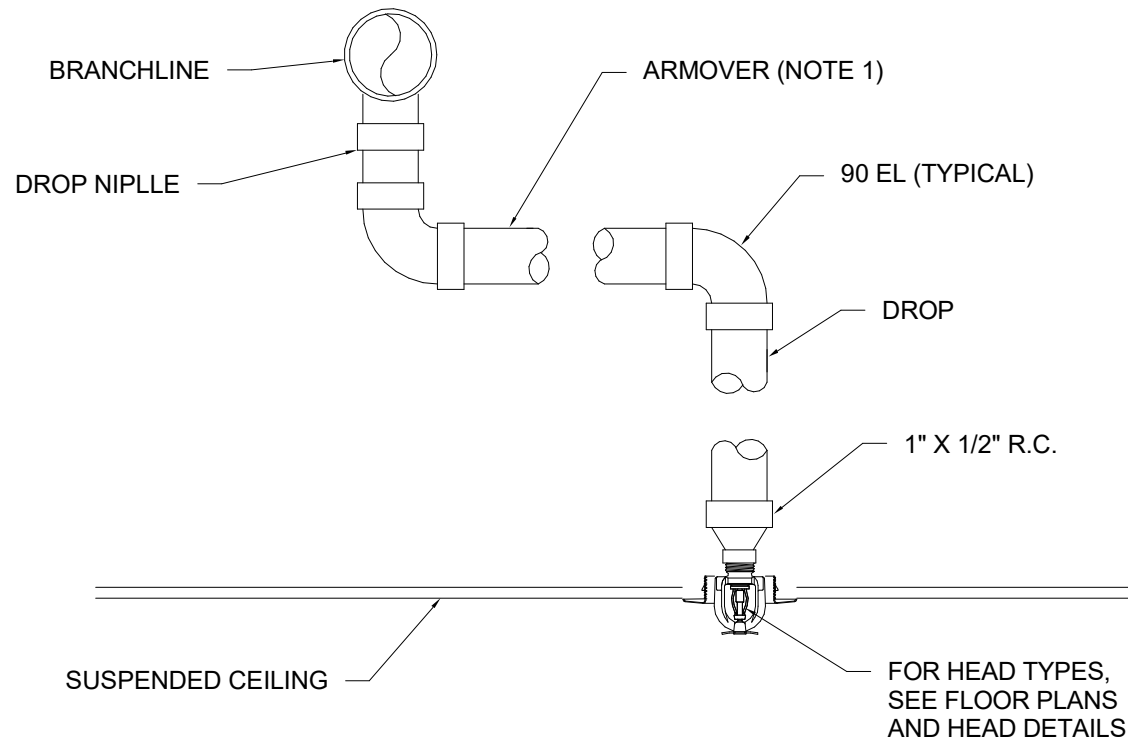

NOTE:  
1. PROVIDE HANGER FOR ARMOVERS GREATER THAN 24" IN LENGTH.

1 SWING ARM ASSEMBLY DETAIL

N.T.S.

FIRE PROTECTION SPRINKLER SYSTEM DESIGN CRITERIA

HAZARD SYMBOL	SPACE TYPE	HAZARD CLASSIFICATION	SYSTEM TYPE	DISCHARGE DENSITY	REMOTE AREA	MAXIMUM COVERAGE AREA PER SPRINKLER	MAXIMUM SPACING	WATER SUPPLY DURATION	OUTSIDE HOSE ALLOWANCE	TEMPERATURE CLASSIFICATION	SPRINKLER TYPE	NOTES
				GPM/FT²	FT²	FT²	FT.	MINUTES	GPM			
	GENERAL, EXCEPT AS LISTED BELOW	LIGHT HAZARD	WET PIPE	0.10	1,500	225	15	30	100	ORDINARY	INSTITUTIONAL PENDENT OR UPRIGHT, QUICK RESPONSE, UL LISTED	1
	ELECTRICAL ROOM	ORDINARY HAZARD GROUP 1	WET PIPE	0.15	1,500	130	15	60-90	250	INTERMEDIATE	INSTITUTIONAL PENDENT OR UPRIGHT, QUICK RESPONSE, UL LISTED	1
	JAN CLOSET, STORAGE	ORDINARY HAZARD GROUP 2	WET PIPE	0.20	1,500	130	15	60-90	250	ORDINARY	INSTITUTIONAL PENDENT OR UPRIGHT, QUICK RESPONSE, UL LISTED	1

NOTES:

- WATER DEMAND REQUIREMENTS ARE FOR HYDRAULIC CALCULATION METHOD. IF OTHER METHOD IS USED ADJUST VALUES ACCORDING TO NFPA 13 REQUIREMENTS.



550 North Reo Street  
Suite 203, Tampa, FL  
33609  
813.289.4700  
COA # 8304

HCSO MENTAL HEALTH CLINIC

2310 N. FALKENBURG ROAD  
TAMPA, FLORIDA 33619

NOTES & LEGENDS - FIRE PROTECTION - JIA

#	ISSUED FOR	DATE
	01 - JIA	06.20.24
	75% - JIA	07.26.24
	PERMIT/BID	08.20.24
	ADDENDUM #1	09.05.24

DRAWN BY: JTD  
REVIEW BY: NPS

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P: 883.682.1082  
F: 883.687.6346  
E: AL004778

lunz.com

24001.01


F001A

FIRE PROTECTION SHEET LIST


Sheet Number	Sheet Name
F001A	NOTES & LEGENDS - FIRE PROTECTION - JIA
FD101A	FIRE PROTECTION DEMOLITION PLAN - JIA
F101A	FIRE PROTECTION RENOVATION PLAN - JIA



LU: 1/2/2024 & 4/15/24

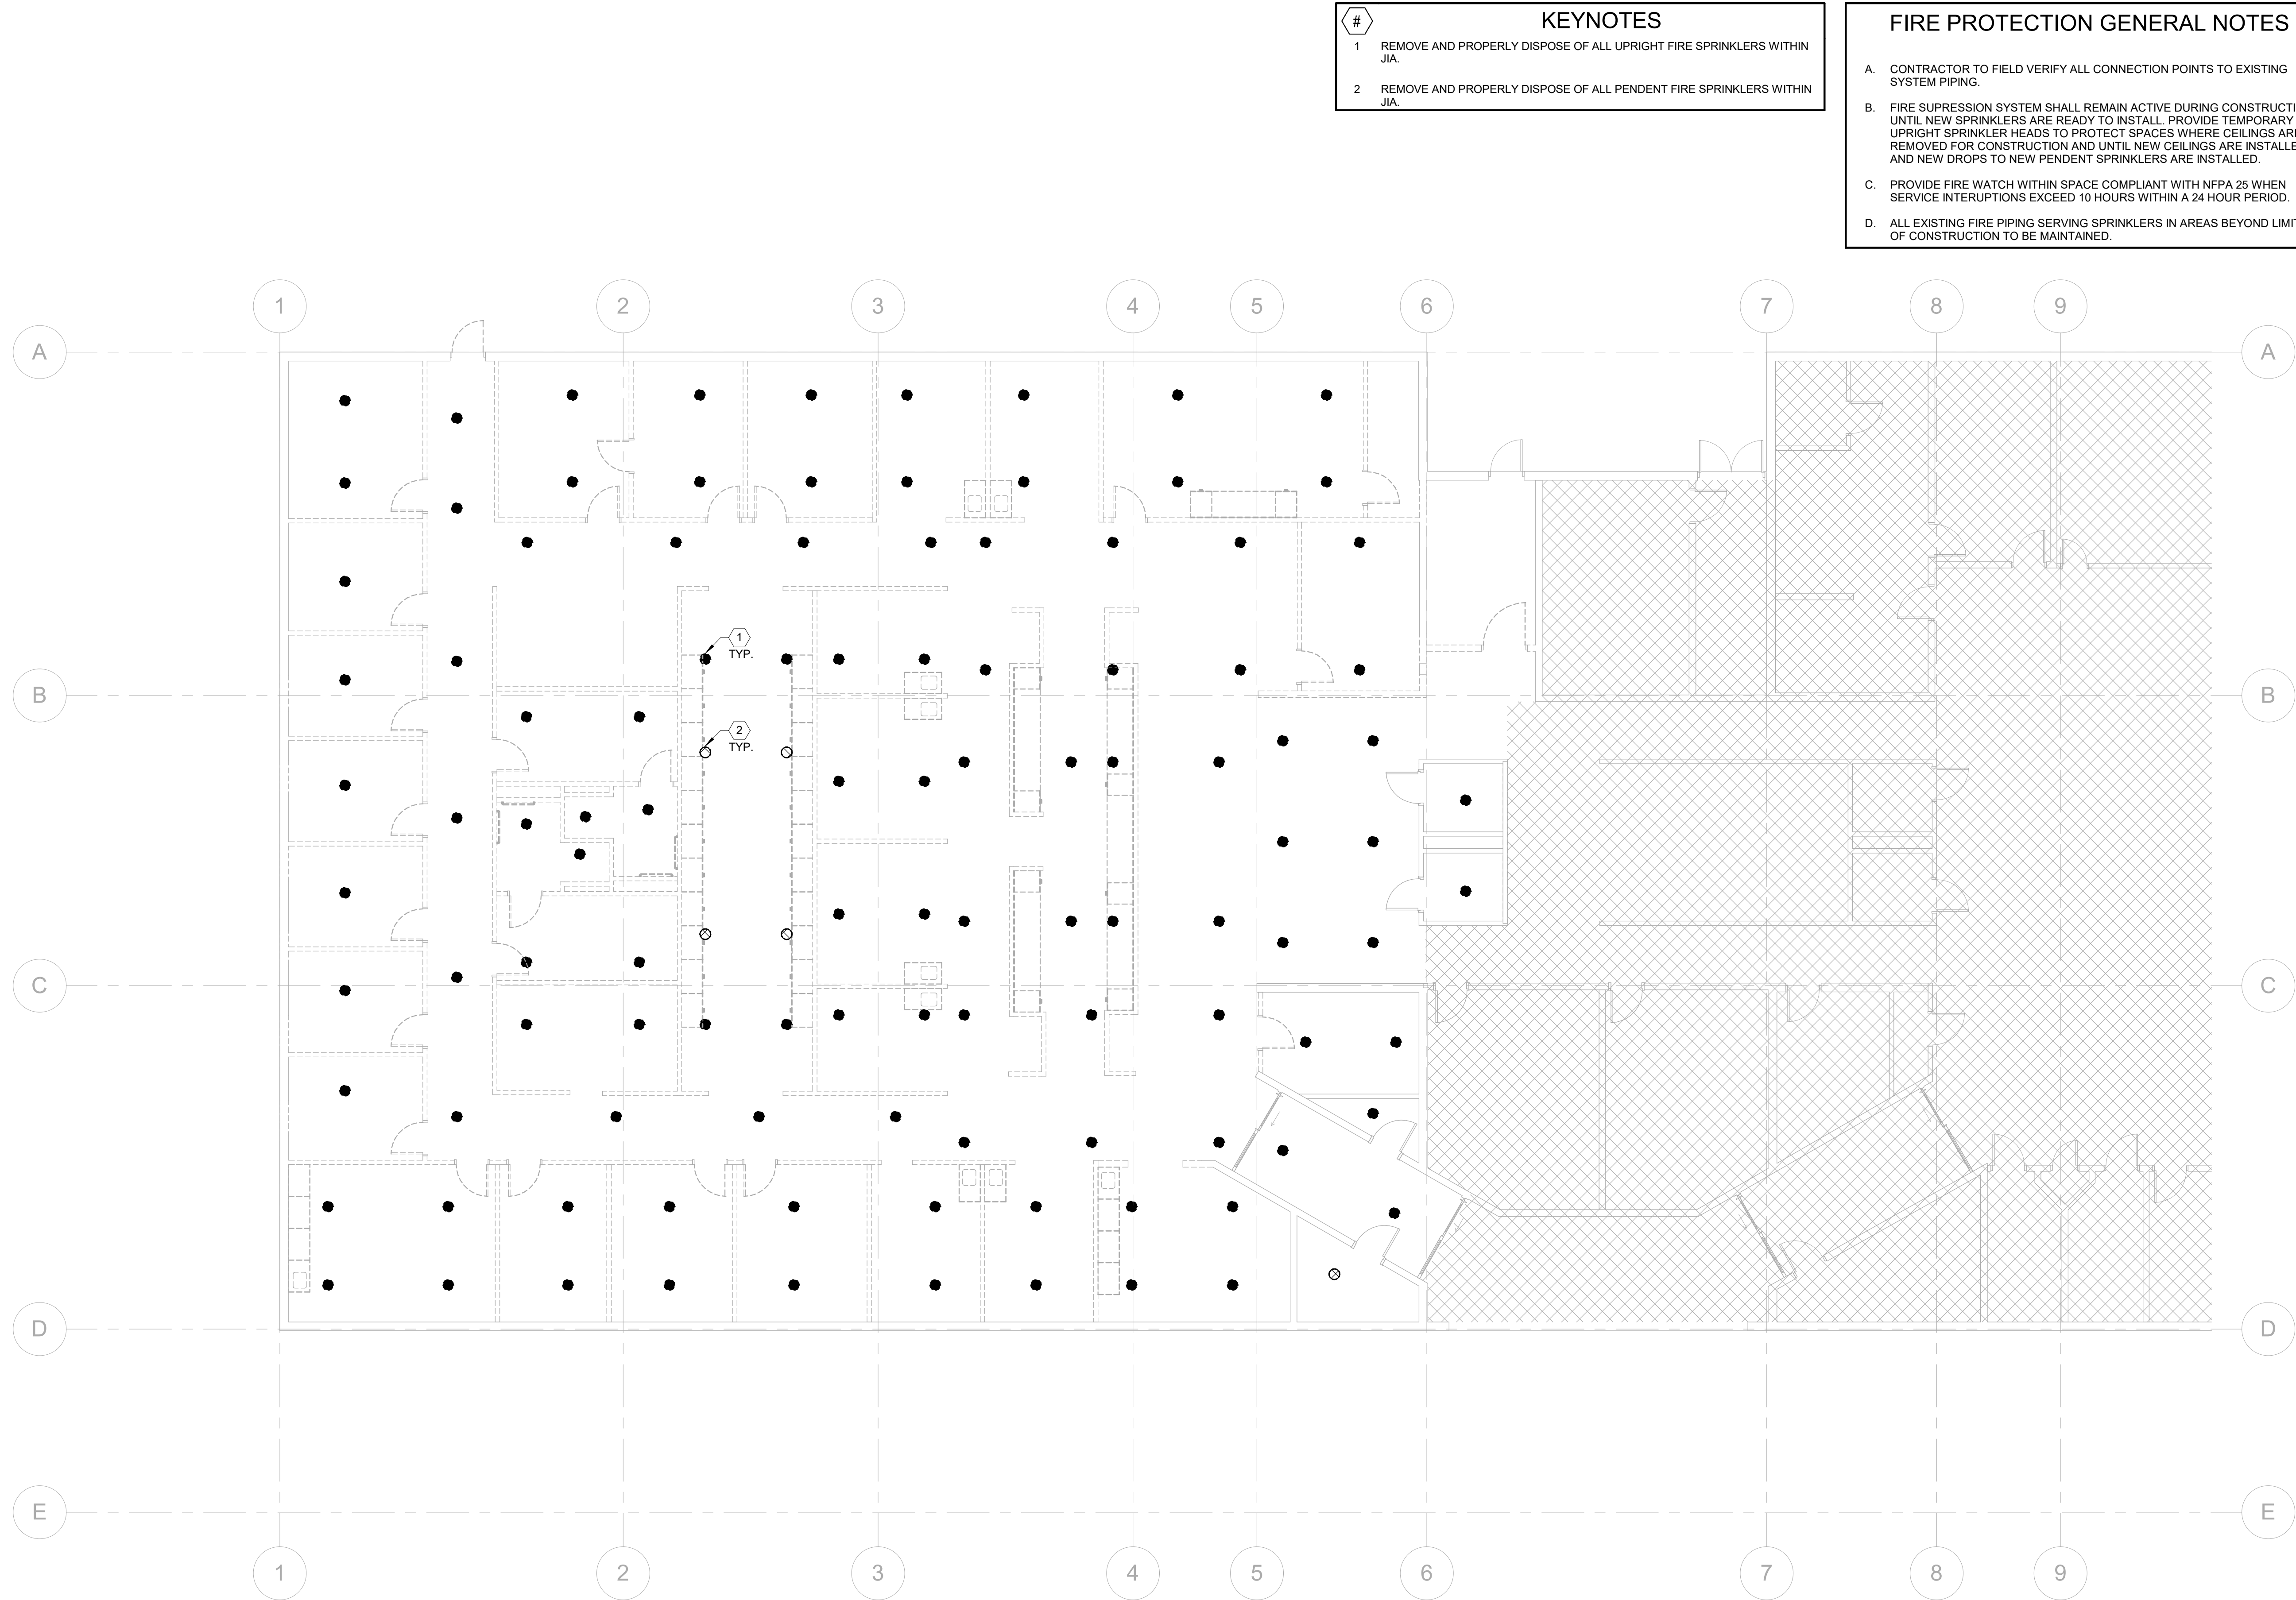

 1 FIRE PROTECTION DEMOLITION PLAN - JIA  
1/8" = 1'-0"

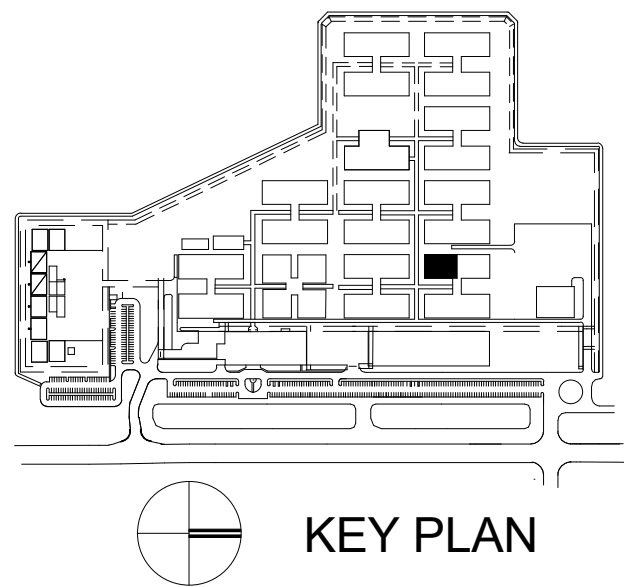

HCSO MENTAL HEALTH CLINIC

2310 N. FALKENBURG ROAD  
TAMPA, FLORIDA 33619

FIRE PROTECTION DEMOLITION PLAN - JIA

#	ISSUED FOR	DATE
	00 - JIA	06.20.24
	75% - JIA	07.26.24
	PERMIT/BID	08.20.24
	ADDENDUM #1	09.05.24

DRAWN BY: JTD  
REVIEW BY: NPS

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P 883.682.1182  
F 883.687.6346  
lic: A004778

lunz.com

24001.01

FD101A

FIRE PROTECTION DESIGN CRITERIA	
HAZARD SYMBOL	HAZARD CLASSIFICATION
	LIGHT HAZARD
	ORDINARY HAZARD GROUP 1
	ORDINARY HAZARD GROUP 2
	OUT OF SCOPE

- FIRE PROTECTION GENERAL NOTES
- A.

CONTRACTOR TO FIELD VERIFY ALL CONNECTION POINTS TO EXISTING SYSTEM PIPING.
- B.


FIRE SUPPRESSION SYSTEM SHALL REMAIN ACTIVE DURING CONSTRUCTION UNTIL NEW SPRINKLERS ARE READY TO INSTALL. PROVIDE TEMPORARY UPRIGHT SPRINKLER HEADS TO PROTECT SPACES WHERE CEILINGS ARE REMOVED FOR CONSTRUCTION AND UNTIL NEW CEILINGS ARE INSTALLED AND NEW DROPS TO NEW PENDENT SPRINKLERS ARE INSTALLED.
- C.

PROVIDE FIRE WATCH WITHIN SPACE COMPLIANT WITH NFPA 25 WHEN SERVICE INTERRUPTIONS EXCEED 10 HOURS WITHIN A 24 HOUR PERIOD.
- D.

ALL EXISTING FIRE PIPING SERVING SPRINKLERS IN AREAS BEYOND LIMITS OF CONSTRUCTION TO BE MAINTAINED.



**1** FIRE PROTECTION RENOVATION PLAN - JIA  
1/8" = 1'-0"

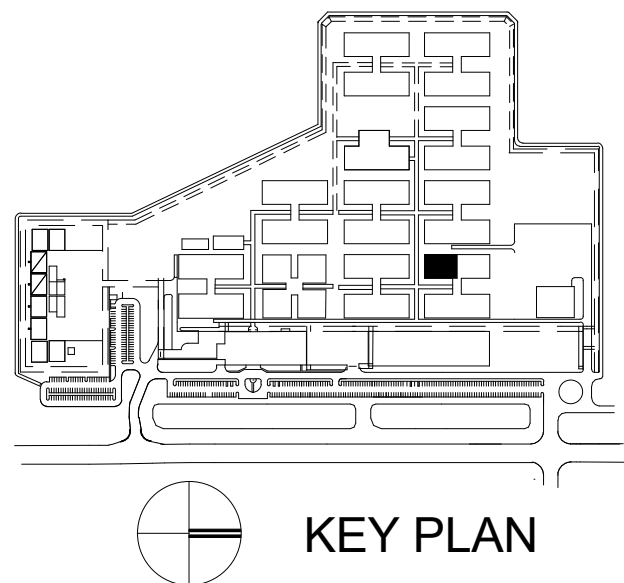

THE  
**LUNZ**  
GROUP

**MES**  
GROUP

550 North Reo Street  
Suite 203, Tampa, FL  
33609  
813.289.4700  
COA # 8304

HCSO MENTAL HEALTH CLINIC

2310 N. FALKENBURG ROAD  
TAMPA, FLORIDA 33619

FIRE PROTECTION RENOVATION PLAN - JIA

#	ISSUED FOR	DATE
	DIS - JIA	06.20.24
	75% - JIA	07.26.24
	PERMIT/BID	08.20.24
	ADDENDUM #1	09.05.24

DRAWN BY: JTD  
REVIEW BY: NPS

THE LUNZ GROUP  
© COPYRIGHT 2024 ALL RIGHTS RESERVED

58 Lake Morton Dr  
Lakeland, FL 33801  
P 883.682.1832  
F 883.687.6346  
E: AG04778

lunz.com

24001.01

F101A